


RT 9W ENTRANCE

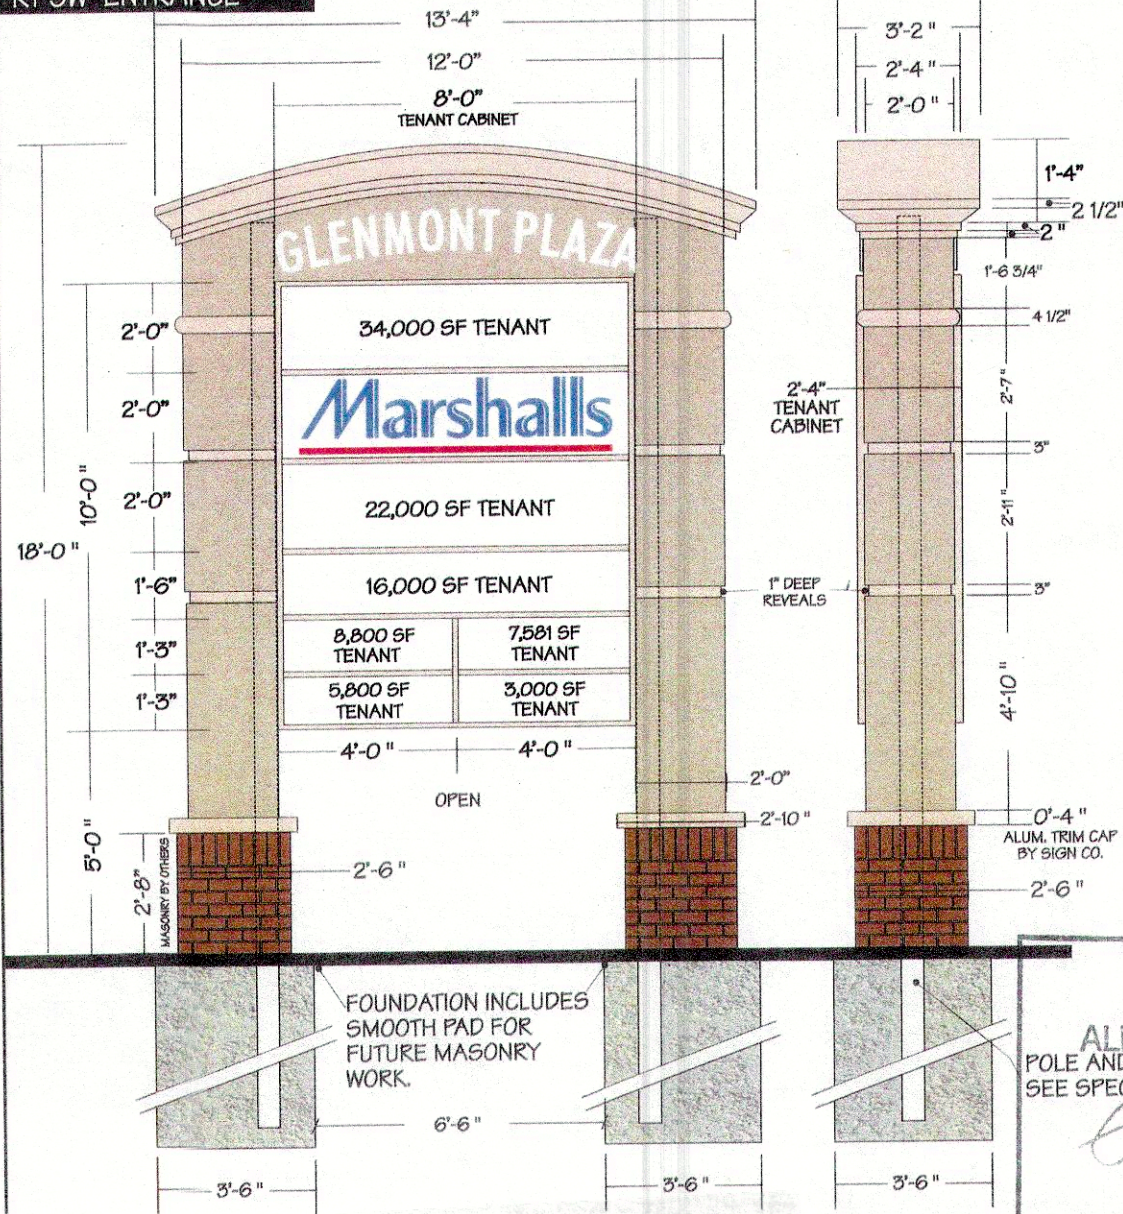

SPECIFICATIONS D.F. PYLON SIGN 3/8"=1'-0"

PLAZA CABINET: FAB. .090" ALUM. CABINET W / 1 1/2" ALUM. ANGLE FRAMEWORK TO PREVENT DEFLECTION. H.O. FLUORESCENT LAMPS 10" O.C. HORIZONTALLY. 800MA T-12 RAPID START. ALL WIRING TO BE RUN IN ALUM. RACEWAYS. .125" FLAT ALUMINUM FACES WITH ROUTED PUSH THRU COPY. THE ROUTED COPY IS TO BE BACKED WITH 1/4" PIGMENTED WHITE ACRYLIC WITH 3/4" CLEAR PUSH THRU ACRYLIC COPY. THE FACE OF THE ACRYLIC IS TO HAVE H.P. PSV INSTALLED FIRST SURFACE. THE ACRYLIC BACK-UP IS TO BE DRILLED OVERSIZE, MOUNTED WITH MECHANICAL FASTENERS AND SOLVENT WELDED AROUND THE ACRYLIC PERIMETER. EACH END OF THE CABINET IS TO HAVE REMOVABLE ACCESS PANELS INSTALLED WITH C.S. ALUMINUM FASTENERS.

TENANT CABINET: FAB. .090" ALUM. W/ EXTRUDED 2" ALUM. RETAINERS. 1 5/8" DIVIDER BARS. ILLUMINATION- SEE ABOVE SPECS. RETAINERS TO HAVE C.S. REMOVABLE SCREWS FOR ACCESS. .187" FLAT LEXAN POLYCARBONATE MATERIAL, SOLAR CLEAR FIRST SURFACE, WITH H.P. TRANSLUCENT PSV GRAPHICS ON THE FIRST SURFACE.

POLE COVERS: FAB. .090" SEAMLESS ALUM. W/ 1 1/2" ALUM. ANGLE FRAMEWORK TO PREVENT DEFLECTION. PLAZA SIDE FACE (INSIDE LEG) OF POLE COVER TO HAVE A FLUSH MOUNTED REMOVABLE ACCESS COVER.

MASONRY: BY OTHERS.

STEEL/FOUNDATION: STEEL STRUCTURE W/ CONCRETE FOUNDATIONS PER LOCAL CODE/ NATIONAL ENGINEERING WIND LOAD GUIDELINES. STRUCTURAL STEEL SHALL BE ASTM-36. STRUCTURAL STEEL TUBING SHALL BE ASTM-A55. ALL WELDING SHALL CONFORM TO AWS SPECIFICATIONS. STEEL TO BE PRIMED & PAINTED W/ A RUST PROHIBITING PAINT. 3000 PSI CONCRETE. SIGNS ARE TO HAVE FLAT CONCRETE PADS AT GRADE (DIMENSIONS AS SHOWN ON DRAWING TO THE LEFT) TO PROVIDE A SMOOTH SURFACE FOR THE MASONRY CONTRACTOR. THE SIGN COMPANY WILL FIRST INSTALL THE STEEL STRUCTURE AND CABINETS. THE MASONRY CONTRACTOR WILL THEN INSTALL THE MASONRY AROUND THE SIGN.

ELECTRICAL: ALL FABRICATION AND ELECTRICAL DETAILS SHALL MEET UL & NEC REQUIREMENTS. SIGNS TO HAVE UL LABELS DISPLAYED. **BDCI TO PROVIDE 120V ELECTRICAL SERVICE** TO THE BASE OF THE SIGNS W/ FINAL ELECTRICAL CONNECTION BY SIGN CONTRACTOR.

PAINT: ALL METAL SURFACES TO BE PRIMED AND PAINTED WITH AN ACRYLIC POLYURETHANE PAINT. ALL METAL SURFACES TO HAVE A SATIN FINISH.

GENERAL NOTES: MIG WELDED CONSTRUCTION THROUGHOUT, NO RIVETS. FACE SEAMS, IF ANY, TO BE FILLED W/ METAL FILLER AND GROUND SMOOTH TO PROVIDE A SEAMLESS APPEARANCE. THE QUOTATION IS TO INCLUDE THE TENANT GRAPHICS INDICATED AT THE TIME OF INSTALLATION. ALL EXCAVATED SPOILS ARE TO BE REMOVED FROM THE SITE. NO GAPS, LIGHT LEAKS OR "OIL CANNING" WILL BE ACCEPTED. AT COMPLETION OF INSTALLATION, ALL SURFACES ARE TO BE CLEANED IN ACCORDANCE WITH MANUFACTURERS INSTRUCTIONS.

PLANNING BOARD
TOWN OF BETHLEHEM
ALBANY COUNTY, NEW YORK

POLE AND FOUNDATION:
SEE SPECIFICATIONS SHEET

This Site Plan Approved
Parker D. Mathusa

Title Chairman
SPA 60-A10

Date 4-4-07

BENDERSON DEVELOPMENT
570 DELAWARE AVENUE, BUFFALO, NEW YORK 14202

PROPERTY GLENMONT PLAZA
GLENMONT, NEW YORK
PROP. # 4005 DRWG. # 4005PY/FAB/BID
DATE 12.26.06 BY D.MAVIS
REVISION

