


NOTES:
 ALL CONCRETE MASONRY SHALL HAVE A UNIT COMPRESSIVE STRENGTH = 3750 CONCRETE MASONRY NET AREA COMPRESSIVE STRENGTH = 2500 PSI
 ALL REINFORCING STEEL SHALL BE #4 BAR GRADE 60 STEEL
 ALL REINFORCEMENT SHALL BE GROUTED WITH GROUT HAVING A MINIMUM COMPRESSIVE STRENGTH = 2500 PSI



John Klekovic 1/16/07
 VALID P.E. STAMP IS RED (ORIGINAL)

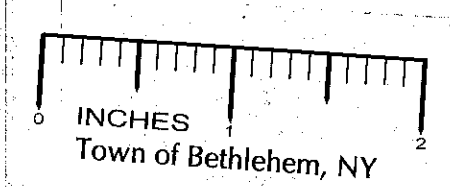

TOWN OF GLENMONT ALBANY COUNTY	REXFORD ENGINEERING JOHN KLEKOVIC, P.E. 23 FAIRWAY LANE, REXFORD, NY 12148 518-399-0153		
	COMMERCIAL / MERCANTILE NEW CONSTRUCTION	MICHAEL AND LISA CHENETTE 123 GEISER RD. WYNANTSKILL, NY 12198	
	REV 1, DATE 01/15/07	DWG. NO. RE-0701 SH. 4 OF 6	
JERICHO DRIVE IN ICE CREAM STAND WALL REINFORCEMENT TAX MAP NO. 109.14-3-4			