




PROFILE - BENDER LANE  
 SCALES: HOR. 1"=40'  
 VERT 1"=4'

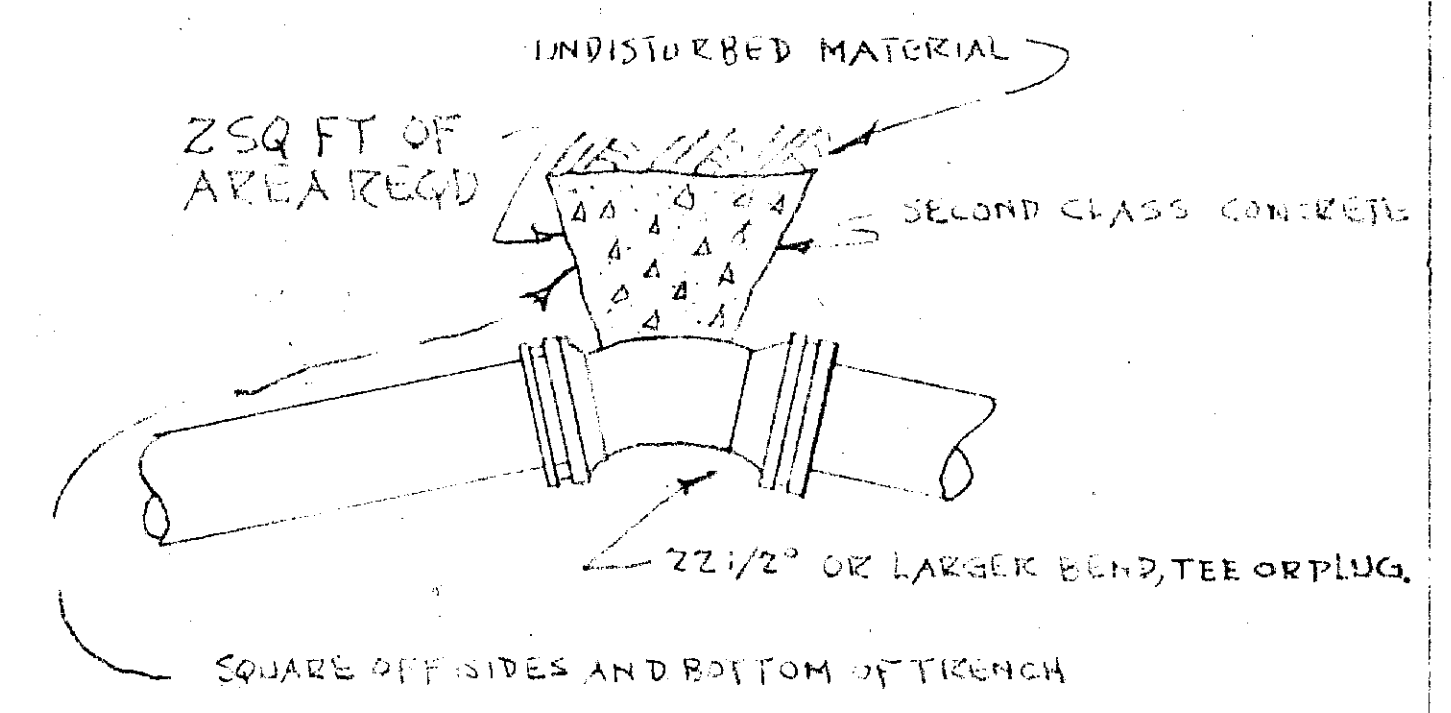

THRUST BLOCK DETAIL  
 NO SCALE

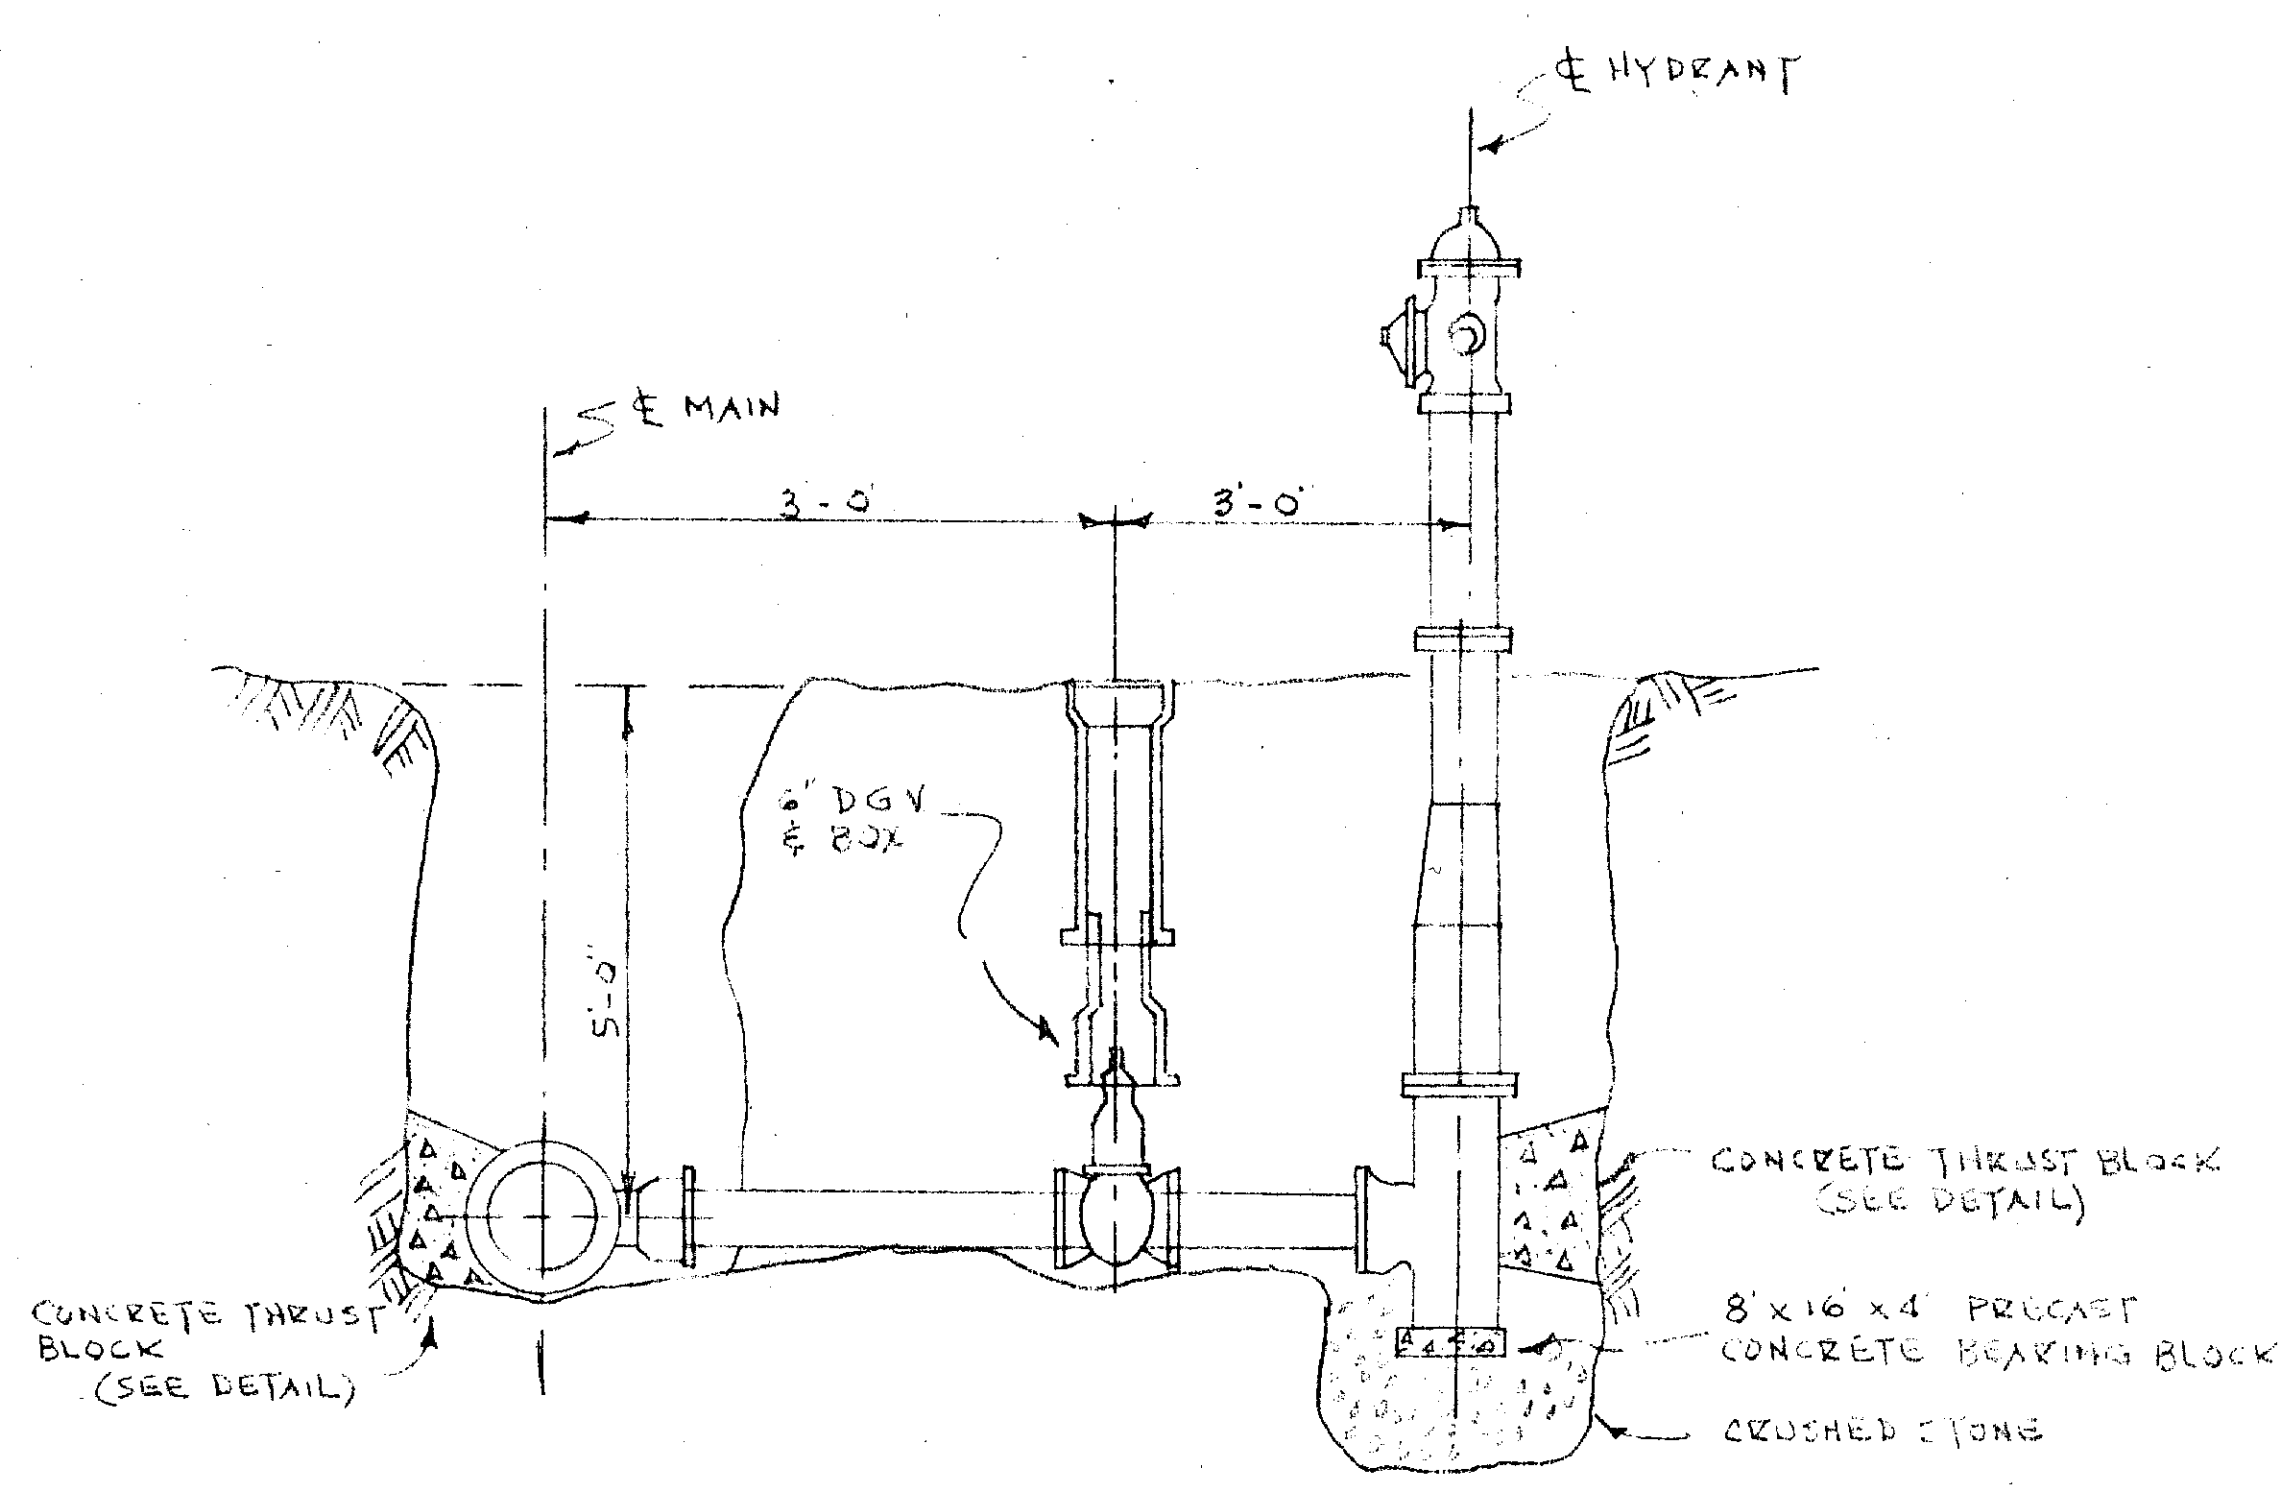


DETAIL OF TYPICAL HYDRANT CONNECTION  
 NO SCALE

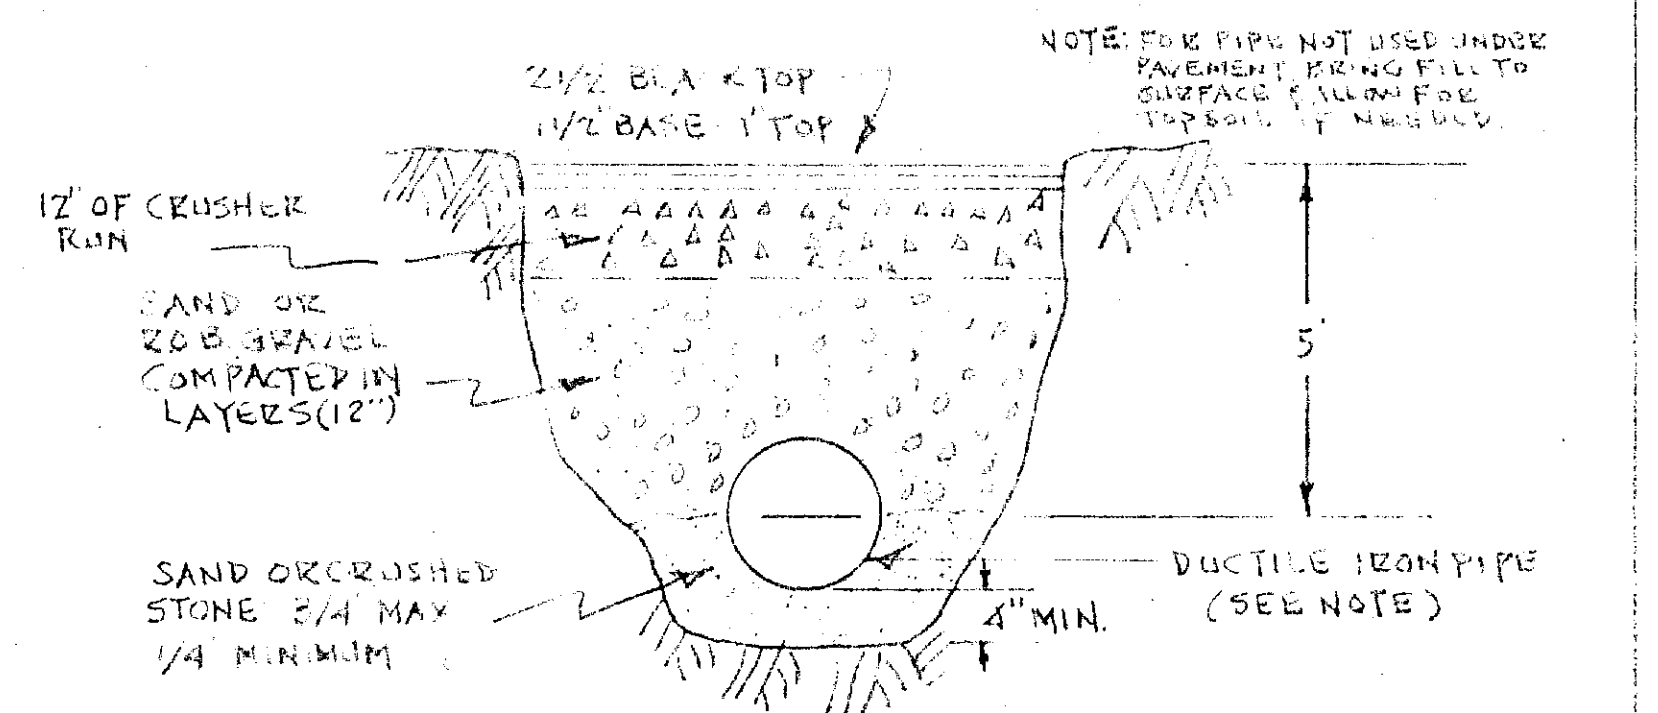


TYPICAL TRENCH  
 NO SCALE

- NOTES:
1. ALL NEW WATER MAINS SHALL BE 1.5" DIA. IRON CLASS 52 COATED LINED, DOUBLE THICKNESS.
  2. ALL MAINS TO BE PRESENCE & LEAKAGE TESTED AND SANITIZED IN ACCORDANCE WITH NYS DEC AND AWWA REQUIREMENTS.
  3. AT SANITARY SEWER CROSSINGS, WATER MAINS SHALL BE A MINIMUM OF 18" FROM THE INJECT OF THE WATER MAIN TO THE CROWN OF THE SEWER.
  4. AT STORM SEWER CROSSINGS, A MINIMUM OF 18" CLEARANCE SHALL BE ACHIEVED WITH A MINIMUM OF 2' COVER.

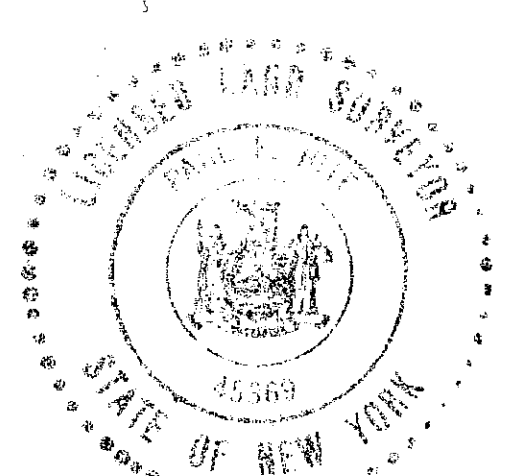

PAUL E. HITE, L.L.S. LIC. NO. 45269 N.Y.

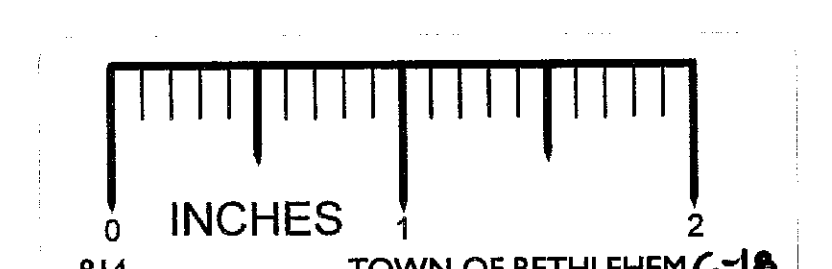

ALBANY COUNTY DEPT. OF HEALTH  
 DATE JAN 8 1979  
 These plans for *Water Main Extension*  
 EXAMINED AND APPROVED  
*Richard W. Arns, P.E.*  
 DIRECTOR, DIVISION OF ENVIRONMENTAL  
 HEALTH SERVICES

---

WATER DISTRICT NO. 1  
 TOWN OF BETHLEHEM  
 ALBANY COUNTY NEW YORK

---

WATER SUPPLY  
 BENDER LANE

---

PAUL E. HITE & WINNARD J. MORGAN

C-18