


- NOTE:
1. FILL ALL OPENINGS WITH NON-SHRINK GROUT.
 2. CONTRACTOR WILL BE RESPONSIBLE FOR MAINTENANCE OF SEWER DURING CONSTRUCTION.
 3. PROVIDE CAST IN FLEXIBLE SLEEVE OR FIELD INSTALLED SEAL FOR PVC PIPE CONNECTION TO MANHOLE.

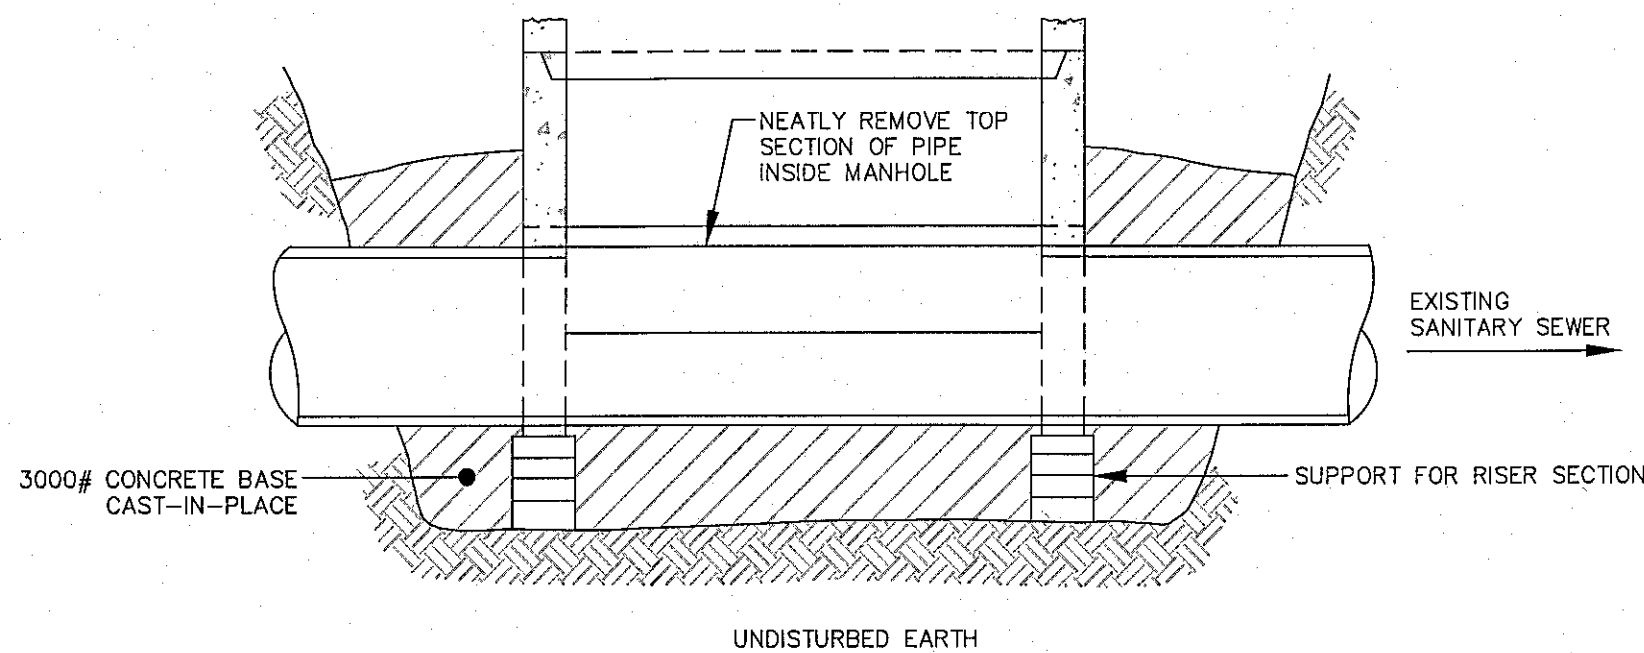

MANHOLE CONNECTION AT EXISTING SANITARY SEWER
SCALE: NONE

**ERDMAN
ANTHONY**

11 CENTURY HILL DRIVE, SUITE 105
Latham, NY 12110
Telephone (518)783-1205
Facsimile (518)783-0374
www.erdmananthony.com



DATE DATE

NOTE: UNAUTHORIZED ALTERATION OR ADDITION TO THIS
DRAWING IS A VIOLATION OF THE NEW YORK STATE
EDUCATION LAW ARTICLE 145, SECTION 7209.

REVISIONS			
NO.	DESCRIPTION	BY	DATE

ALL RIGHTS RESERVED: No part of this document may be reproduced, stored in a retrieval system, or transmitted, in any form or by any means electronic, mechanical, photocopying, recording, or otherwise without the prior written authorization of ERDMAN ANTHONY.

COPYRIGHT
©2015 Erdman Anthony

CLIENT:

**BENDERSON
DEVELOPMENT
COMPANY, LLC**

PROJECT NAME:

**GLENMONT PLAZA –
380 FEURA BUSH
ROAD PROPOSED
PAD SITE**

DRAWING TITLE:

**SANITARY SEWER
DETAILS**

PLANNING BOARD
TOWN OF BETHLEHEM
ALBANY COUNTY, NEW YORK
By direction of the Chairman.
These drawings are hereby approved.
See sheet(s) 6.3
for date and signature.

TOWN OF BETHLEHEM, NEW YORK
PLANNING DEPT. ORIGINAL
- SCANNED -

0 1 2
INCHES

PLANNING BOARD APPROVAL

SCALE: N.T.S.	DATE: FEB. 2013
DES. BY: RLD	DR. BY: MFJ
CK'D BY: RLD	EA PROJECT NO. 1700C.55
SHEET NO. 12 OF 13	DRAWING NO. C6.3