



16 Canal Street - Suite 1234
Bristol, PA 19007
Ph: 215.788.3898
Fax: 215.788.3876

CLIENT
Marshall's

LOCATION: **MARSHALL'S
GLENMONT, NY**

DESCRIPTION: **FACE LIT
CHANNEL LETTERS (6'-0")**

PROJECT #: **SS#13866-R2 (OPT. 2)**

SCALE: **AS NOTED**

DRAWN BY: **TF**

DATE: **1-18-05**

CLIENTS APPROVAL

BY: _____

DATE: _____

REVISION:

△ **2-26-06 TF (OPT. 2)**

△ **11-15-06 rjm (OPT. 2)**

△

△

△

CHANGE MADE ON REV:


VOLTAGE:

ALLOWABLE SQ. FT.:

PROPOSED SQ. FT.:

This drawing is submitted for your exclusive use, in connection with a project being planned by Service Select, Inc. It is not to be shown to anyone outside your organization, nor is it to be used, reproduced, copied or exhibited in any fashion, without the expressed permission of Service Select, Inc.

Page 2 of 2

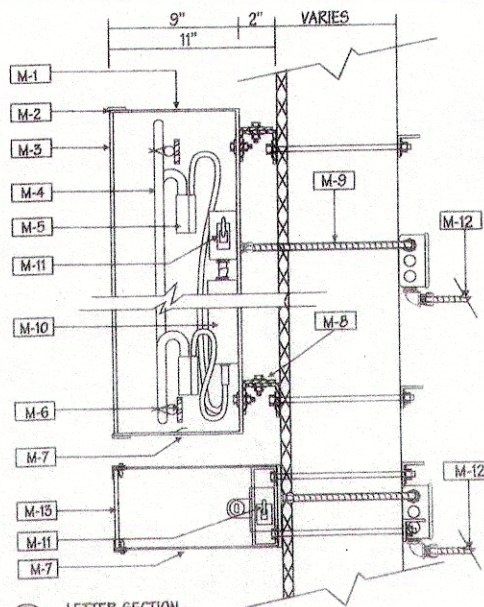

2 LETTER SECTION
SCALE: NOT TO SCALE

MATERIAL DESCRIPTION

- M1 .050 ALUMINUM RETURNS. FINISH TO BE SPRAYED WHITE. .090 ALUMINUM BACKS. INSIDE OF LETTERS WHITE. ALL PAINTS TO BE INDUSTRIAL POLY-URETHANE FINISH.
- M2 1" WHITE TRIM-CAP.
- M3 3/16" FLAT WHITE SG ACRYLITE # TL-015-2 (CYRO) W/ BLUE VINYL OVERLAY
- M4 15 MM 6500 WHITE NEON.
- M5 DOUBLE BACK ELECTRODES WITH U.L. APPROVED ELECTRODE BOOTS AND 15000 VOLT GTO WIRE.
- M6 CROSS BRACING BETWEEN RETURNS FOR TUBE SUPPORTS.
- M7 1/4" WEEP HOLES AS REQUIRED.
- M8 2" X 2" X 3/16" GALVANIZED STEEL CLIPS WITH MOUNTING HARDWARE (TYPE DEPENDING UPON WALL CONSTRUCTION).
- M9 1/2" "SEALTITE" FLEX CONDUIT AND CONNECTORS.
- M10 30 M.A. NORMAL POWER FACTOR SELF-CONTAINED TRANSFORMERS (GROUND FAULT PROTECTED AND 2161 U.L. APPROVED).
- M11 20 AMP DISCONNECT SWITCH ON OUTSIDE OF LETTERS.
- M12 J-BOXES AND PRIMARY ELECTRICAL LEADS.
- M13 UNDERSCORE: ALUMINUM RETURNS TO MATCH P.M.S. #186C (RED). 1" RED TRIM CAP. FACE TO BE WHITE LEXAN W/ VINYL OVERLAY (3M #3630-33 RED) 800 M. HIGH OUTPUT FLUORESCENT ILLUMINATION WITH (120 VOLT) H.Q. BALLASTS.



UL
REQUIRED

NEW UL 2151 G.E.P. SIGN TRANSFORMER
REQUIRE THAT ALL CIRCUITS MUST HAVE
DEDICATED HOT, NEUTRAL, GROUND
TERMINATING AT PANEL.
QUESTIONS: CALL HD CORP. 1-800-780-7446

CIRCUITS REQUIRED
TWO (2)
20 AMP 120 VOLT
CIRCUITS
REQUIRED

SIGN MUST BE
GROUNDING IN
COMPLIANCE WITH
ARTICLE 600 OF
THE NATIONAL
ELECTRIC CODE.



BRIGHT BLUE
3630-167 VINYL




LETTER RETURNS
WHITE



BAR FACE
OVERLAY WHITE
LEXAN
RED VINYL
3630-33 RED



BAR RETURNS
P.M.S. #186C RED

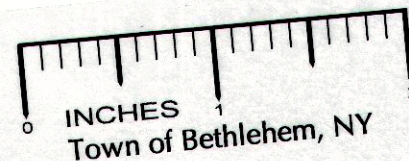

SQUARE FOOTAGE ACTUAL TOTAL: 115 SQ. FT.

MARB-72