

PARTIAL SITE PLAN  
SCALE: 1" = 3/32"


LANDS N/F CONSOLIDATED RAIL INC.

SPEEDER ROAD (PRIVATE ROAD - SEE NOTE 2 PAGE 1)

Proposed Sign  
Letters Painted On Building

Diversified Auto Inc.

- PP Power Pole
- WB Water Box Shut Off
- E/C/T- Electric/Cable/Telephone Lines
- G- Gas Lines
- W- Water Lines
- S- Sewer Lines
- FH Fire Hydrant
- MH Manhole For Sewer Lines
- DI Drop Inlet For Storm Sewer

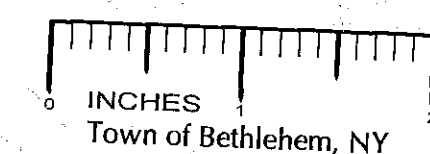


Errors And Omissions:  
Father & Sons Consultants Is unable to accept liability for any errors of omission in excess of the original purchase cost of the plans. While every attempt has been made in the preparation of this plan to avoid errors. Father & Sons Consultants cannot guarantee against human error and omissions. Therefore, the contractor must check all dimensions and details and be responsible for the same. Do Not Scale Drawings.

Sheet  
2  
or  
4  
Drawn by JBJ II  
1 Town Revision 1.10.08

No.	Revision	Date
1		

THIS DRAWING IS AND SHALL REMAIN THE PROPERTY OF FATHER AND SONS CONSULTANTS ANY USE OF THESE DRAWINGS WITHOUT THE EXPRESSED WRITTEN CONSENT OF FATHER AND SONS CONSULTANTS IS STRICTLY PROHIBITED BY LAW.

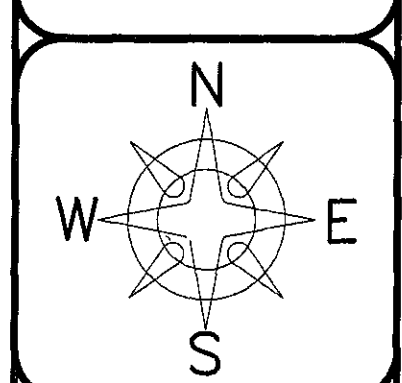

FATHER & SONS  
CONSULTING ENGINEERS  
122 MOHAWK STREET  
COHOES, NY 12047

C:\Users\Phenris\Desktop\tileprint.php.jpg

### SCOPE OF WORK:

DIVERSIFIED AUTO TO LEASE 73 AND 75 SPEEDER ROAD ONLY ALL WORK TO BE DONE ON PROPERTY IS TO BE CONFINED TO THESE TWO BUILDINGS.

BUILDING 73 SPEEDER ROAD IS TO BE CONVERTED TO STORAGE BUILDING FOR A 10,000 GAL DOUBLE WALL ABOVE GROUND FUEL STORAGE TANK

EXISTING CONCRETE BLOCK BUILDING TO BE REPAIRED AND REPAINTED WHITE WITH A SIGN PAINTED ON THE BUILDING BLUE IN COLOR THE SIGN TO BE 12 INCHES HIGH LETTERS AND SIGN SHOULD BE 12 FEET IN LENGTH.

EXTERIOR FLOOD LIGHTS WITH MOTION DETECTORS TO BE MOUNTED ON EXTERIOR OF 73 SPEEDER ROAD ON THE NORTH WEST END TO ILLUMINATE THE PUMPS AND CARD READER.

THERE WILL BE NO COLLECTION OR STORAGE OF WASTE ON PREMISES

THERE WILL BE NO OUTDOOR STORAGE ON SITE

ALL WEEDS IN THE AREA OF THE TWO BUILDINGS TO BE CUT TO GRAVEL AND SITE IS TO BE GRADED WITH GRAVEL TO EXISTING GRADES CLEANED AND NO STORAGE TO BE ALLOWED ON LEASED PROPERTY.

ALL DISTURBED AREA TO BE REGRADED TO ORIGINAL LEVEL AND ANY EXCESS MATERIALS TO BE REMOVED.

OFF LOAD AND SET (1) 10,000 GALLON DOUBLE WALL ABOVEGROUND FUEL STORAGE TANK (PROVIDED BY DIVERSIFIED AUTO) INTO THE EXISTING CONCRETE BLOCK BUILDING. TANK TO BE RE-CERTIFIED FOR NYS D.E.C.

PROVIDE AND INSTALL OPW EECO-1500 TANK MONITORING SYSTEM WITH (1) 8'-6" MAGNETOSTRICTIVE PROBE, (1) LIQUID ONLY SUMP PUMP SENSOR, (1) REMOTE EXTERNAL HIGH LEVEL WARNING ALARM.

PROVIDE AND INSTALL TOP TANK HARDWARE AND ACCESSORIES (1) OPW 61STOP AST OVERFILL VALVE, (1) OPW 3" SWING CHECK VALVE, (1) OPW 3" LOCKABLE FULL PORT TWO WAY BALL VALVE, (1) OPW 15-GALLON AST REMOTE FILL WITH 3" BOOT, (1) OPW 3"x3" TANK INLET SPOUT ADAPTER, (1) OPW 3" ALUMINUM KAMLOCK DUST CAP.

PROVIDE AND INSTALL (1) MORRISON BROS. 710 2" SOLENOID VALVE, (1) MORRISON BROS. 346DI 2" EXTERNAL EMERGENCY VALVE, (1) MORRISON BROS. 8" EMERGENCY VENT, (1) OPW 3" ALUMINUM TANK VENT.

PROVIDE AND INSTALL (1) PETROVEND FUEL MANAGEMENT 2-HOSE FUEL TERMINAL TO INCLUDE, READER (CARD, KEY, OR KEYLESS), JOURNAL PRINTER, PEDESTAL, HEATER AND PETRO-NET COMM BOX COVER, PETROVENT K800 PHOENIX PREMIER FOR WINDOWS SOFTWARE (ADD RECONCILIATION WITH OPW TANK GAUGE SYSTEM).


PROVIDE AND INSTALL OPW FLEX TRANSITION SUMP 29" X 22", OPW PISCES II 2" DOUBLE WALL PRIMARY, OPW FLEX 4" DOUBLE LAYER ACCESS PIPE, OPW 4" X 2" DOUBLE ENTRY BOOT FITTINGS, OPW FLEX CONDUIT ENTRY BOOTS, OPW FLEX 2" TEST BOOTS WITH AIR STEMS.

PROVIDE AND INSTALL (3) POMECCO 4' X 4' STANDARD ISLAND FORMS, (6) OPW 3.5" DIAMETER PIP GUARDS, (2) OPW 11" X 23" DISPENSER SUMPS, (2) OPW STABILIZER BAR KITS, (2) OPW 2" UNION TOP EMERGENCY SHEAR VALVES, (2) OPW 2" X 18" FLEX CONNECTOR.

PROVIDE AND INSTALL ALL NECESSARY SIGNS, DECALS, PLACARDS AS PER NYS D.E.C. REGULATIONS.

INSTALL BACKFLOW PREVENTERS ON ALL WATER LINES.

ALL CONSTRUCTION DEBRIS TO BE REMOVED FROM SITE.

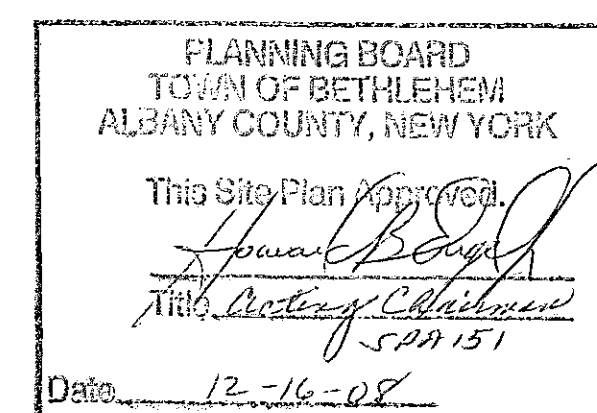

FATHER & SONS CONSULTANT ENGINEERS  
FRANCIS A. LASHWAY JR. P.E., (NY# 64314)  
122 MOHAWK STREET  
COHOES, NY, 12047  
PH (518) 283-5464 FAX (518) 283-5464

