



NOTES:
1. PROVIDE FULL DEPTH EXPANSION JOINTS AT 20'-0" O.C., MAX., OR 400 S.F. OF PAVEMENT AND AROUND ALL HARD OBJECTS.
2. PROVIDE 1" DEEP SCORE JOINTS AT 5'-0" O.C., MAX., OR 25 S.F. OF PAVEMENT.

CONCRETE PAVEMENT (PEDESTRIAN)
SCALE: NOT TO SCALE

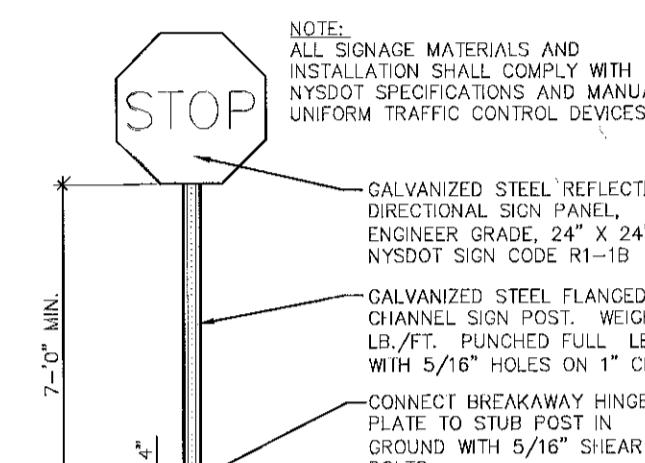


NOTE: CONCRETE MATERIALS AND INSTALLATION SHALL COMPLY WITH NYSDOT SPECIFICATIONS AND MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES

DIRECTIONAL SIGNAGE
SCALE: NOT TO SCALE

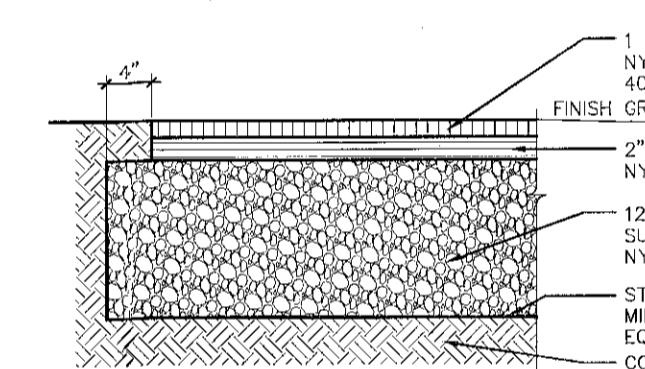


NOTES:
1. AGGREGATE SUBBASE COMPACTED TO 95% STANDARD PROCTOR.
2. CONTRACTOR SHALL PROVIDE DENSITY TESTING FROM A NEUTRAL DENSITY TEST LAB CONFORMING TO NYSDOT STANDARDS FOR ASPHALT AND SUBBASE COMPACTING.

LIGHT DUTY PAVEMENT
SCALE: NOT TO SCALE

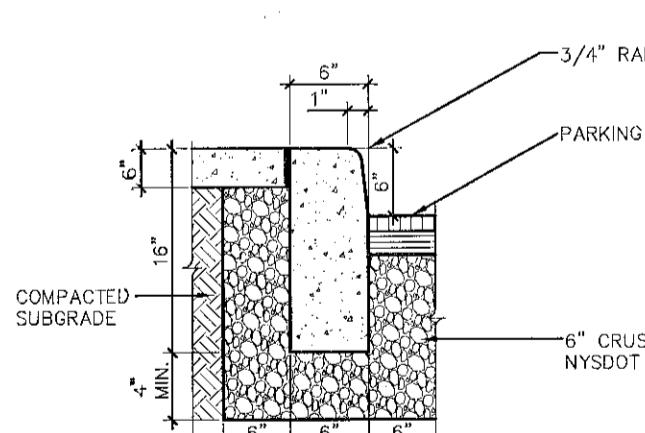


NOTES:
1. CONCRETE JOINTS 10 FEET ON CENTER TO DEPTH OF 1/4 INCH CURB THICKNESS.
2. EXPANSION JOINTS WITH PREMOLDED FILLER 50 FEET TO CENTER.
3. EXPOSED CONCRETE SURFACE TO HAVE A LIGHT BROOM FINISH.

CONCRETE CURB
SCALE: NOT TO SCALE

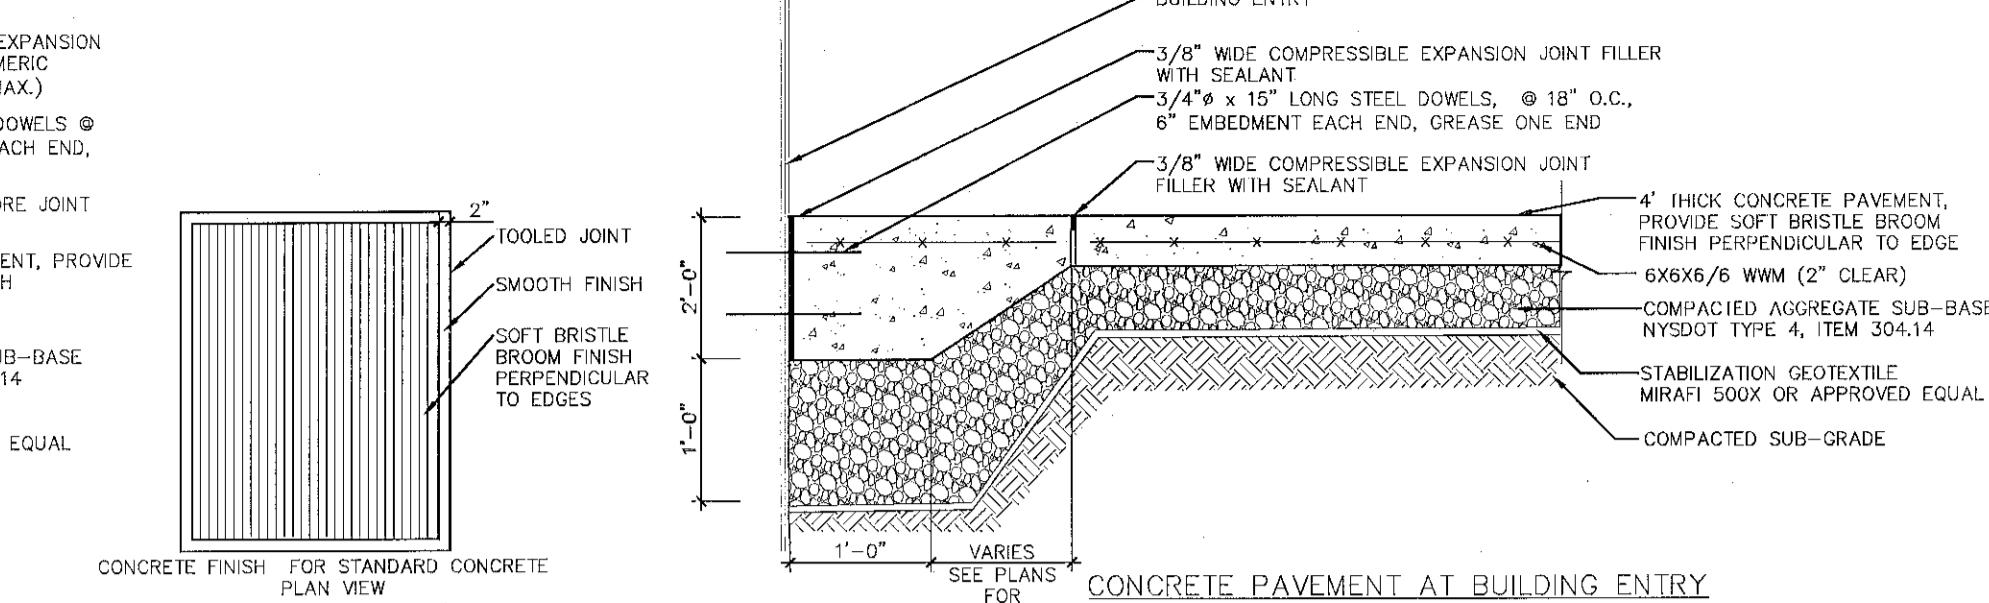

CONCRETE FINISH FOR STANDARD CONCRETE
PLAN VIEW
SCALE: NOT TO SCALE

CONCRETE PAVEMENT AT BUILDING ENTRY
SEE PLANS FOR PAVEMENT SCORE LOCATIONS

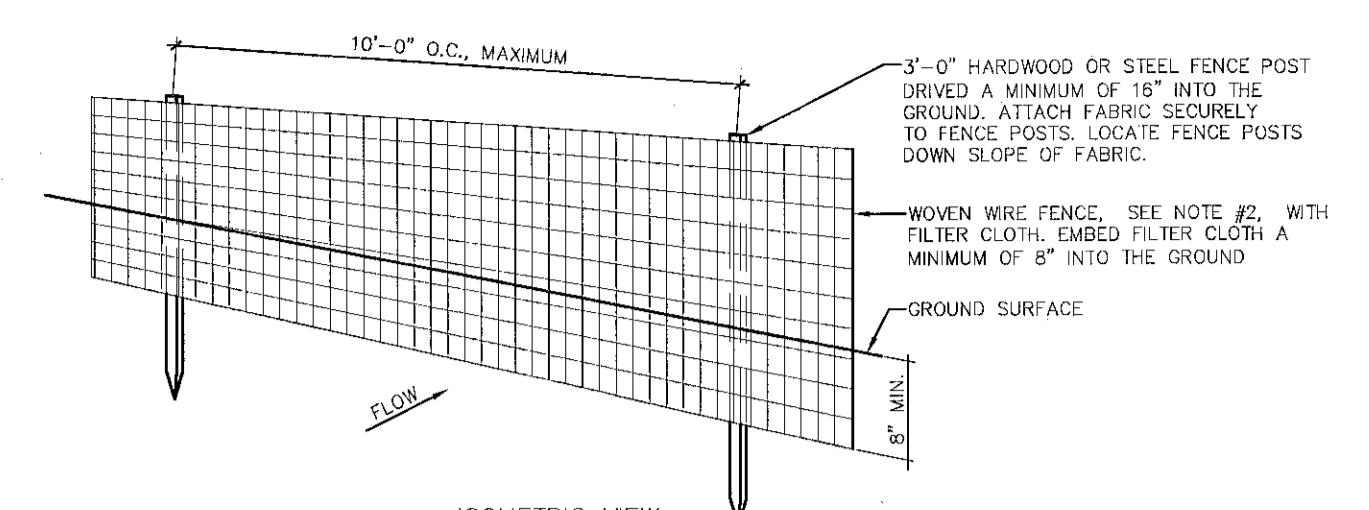

CONSTRUCTION SPECIFICATIONS:

1. WOVEN WIRE FENCE TO BE FASTENED SECURELY TO FENCE POSTS WITH WIRE TIES OR STAPLES. POSTS SHALL BE STEEL EITHER 'T' OR 'U' TYPE OR HARDWOOD.
2. FILTER CLOTH TO BE FASTENED SECURELY TO THE WOVEN WIRE FENCE WITH TIES SPACED EVERY 24" IN. AND MID-SECTION. FENCE SHALL BE 14 GAUGE WOVEN WIRE WITH 6" MAXIMUM MESH SPACING.
3. WHEN (2) SECTIONS OF FILTER CLOTH ADJOIN EACH OTHER THEY SHALL BE OVERLAPPED BY 6" AND FOLDED. FILTER CLOTH SHALL BE EITHER FILTER 'X', MIRAFI 100X, STABILINKA T100X OR APPROVED EQUAL.
4. PREFABRICATED UNITS SHALL BE GEOFAB, ENVIROFENCE OR APPROVED EQUAL.
5. MAINTENANCE SHALL BE PERFORMED AS NEEDED AND MATERIAL REMOVED WHEN "BULGES" DEVELOP IN THE SILT FENCE.

SEDIMENT CONTROL FENCE
SCALE: NOT TO SCALE

CONSTRUCTION SPECIFICATIONS:

1. FILTER FABRIC SHALL HAVE AN EOS OF 40-85. BURLAP MAY BE USED FOR SHORT TERM APPLICATION.
2. CUT FABRIC FROM A CONTINUOUS ROLL TO ELIMINATE JOINTS. IF JOINTS ARE NEEDED THEY WILL BE OVERLAPPED TO THE NEXT STAKE.
3. STAKE MATERIALS WILL BE STANDARD 2" X 4" WOOD OR EQUIVALENT, METAL WITH A MINIMUM LENGTH OF 3 FEET.
4. SPACE STAKES EVENLY AROUND INLET 3 FEET APART AND DRIVE A MINIMUM 18 INCHES DEEP, SPAN GREATER THAN 3 FEET MAY BE BRIDGED OVER THE INLET. THE FILTER FABRIC BEHIND THE FILTER FABRIC FOR OVER FLOW STABILITY.
5. FABRIC SHALL BE EMBEDDED 1 FOOT MINIMUM BELOW GROUND AND BACKFILLED. IT SHALL BE SECURELY FASTENED TO THE STAKES AND FRAME.
6. A 2" X 4" WOOD FRAME SHALL BE COMPLETED AROUND THE CREST OF THE FABRIC FOR OVER FLOW STABILITY.
7. MAXIMUM DRAINAGE AREA 1 ACRE.

INLET PROTECTION
SCALE: NOT TO SCALE

CONSTRUCTION SPECIFICATIONS:

1. LUMINAIRES: MODEL # DOS-100M-SG3-120-HS-DBC-1A-0N6X MANUFACTURED BY LUMEC OR APPROVED EQUAL
2. COMPLETE CATALOG # (Fixture and Pole) DOS-100M-SG3-120-HS-DBC-1A-0N6X MANUFACTURED BY LUMEC OR APPROVED EQUAL
3. POLE: MODEL # AMESF-16-A MANUFACTURED BY LUMEC OR APPROVED EQUAL

POLE
SECTION

ELEVATION

SECTION

PLAN

PLAN

SECTION

ELEVATION

SECTION

PLAN

SECTION