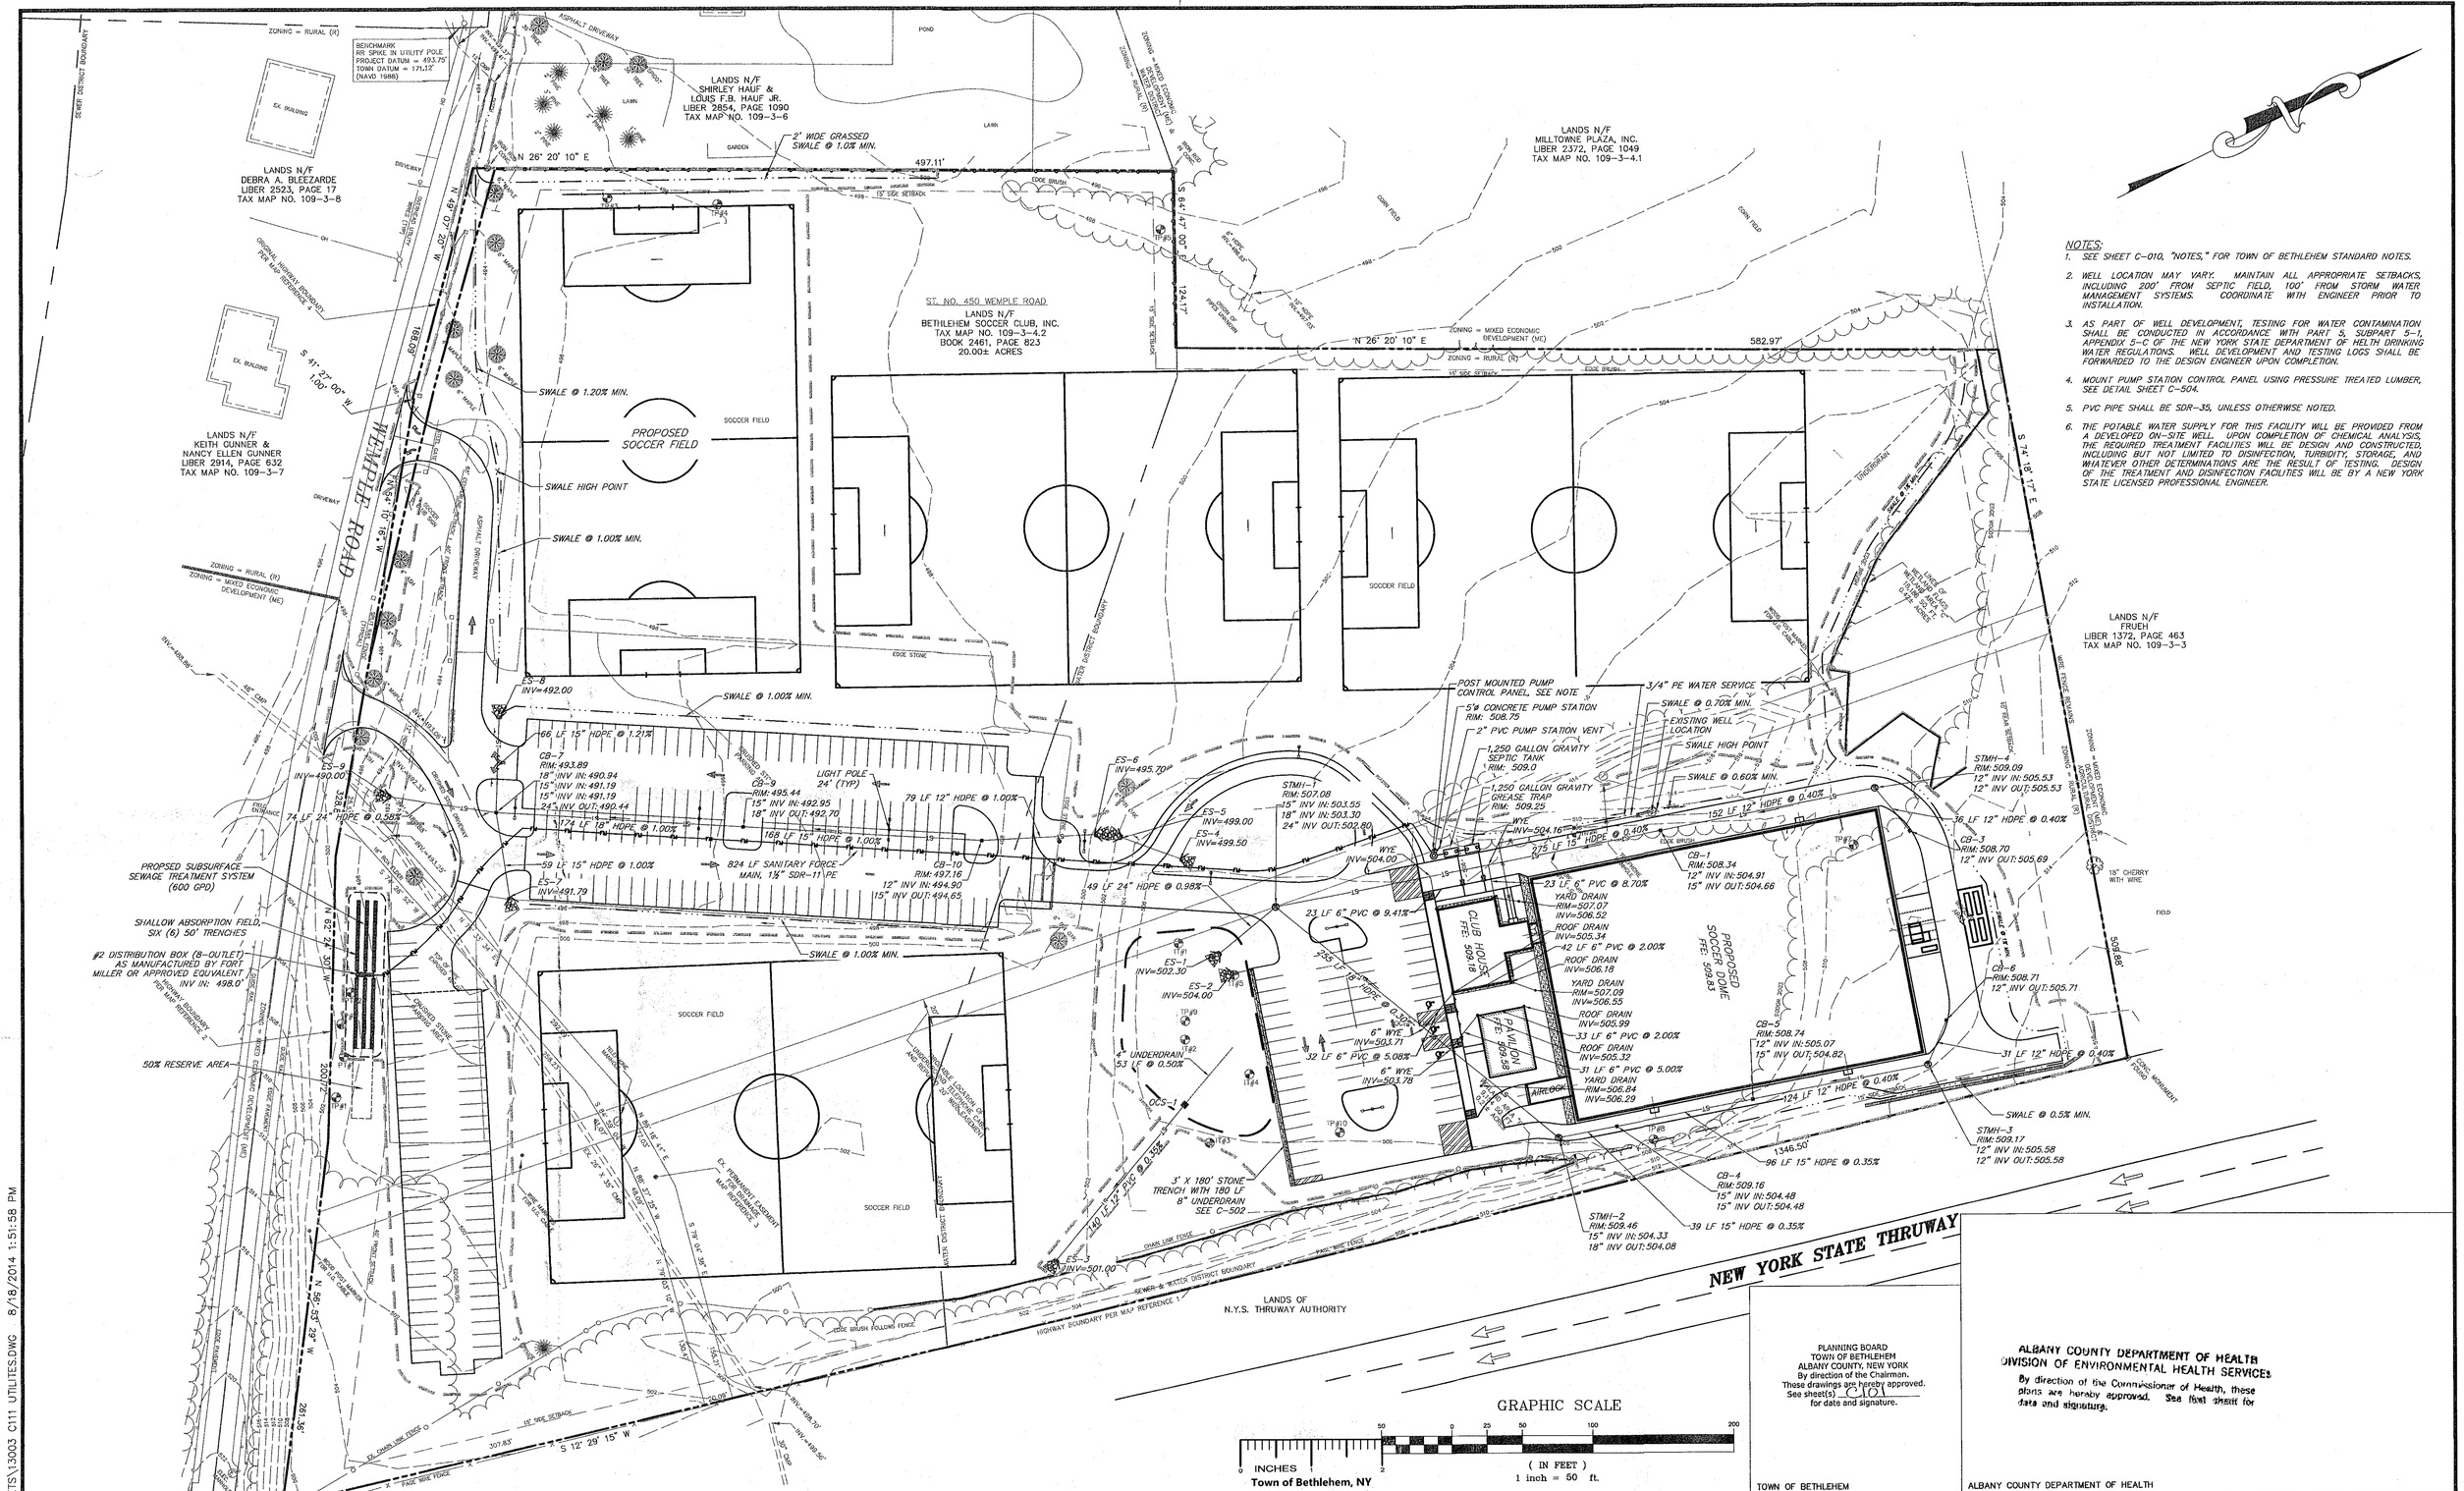

NOTES:

1. SEE SHEET C-010, "NOTES," FOR TOWN OF BETHLEHEM STANDARD NOTES.
2. WELL LOCATION MAY VARY. MAINTAIN ALL APPROPRIATE SETBACKS, INCLUDING 200' FROM SEPTIC FIELD, 100' FROM STORM WATER MANAGEMENT SYSTEMS. COORDINATE WITH ENGINEER PRIOR TO INSTALLATION.
3. AS PART OF WELL DEVELOPMENT, TESTING FOR WATER CONTAMINATION SHALL BE CONDUCTED IN ACCORDANCE WITH PART 5, SUBPART 5-1, APPENDIX 5-C OF THE NEW YORK STATE DEPARTMENT OF HELTH DRINKING WATER REGULATIONS. WELL DEVELOPMENT AND TESTING LOGS SHALL BE FORWARDED TO THE DESIGN ENGINEER UPON COMPLETION.
4. MOUNT PUMP STATION CONTROL PANEL USING PRESSURE TREATED LUMBER, SEE DETAIL SHEET C-504.
5. PVC PIPE SHALL BE SDR-35, UNLESS OTHERWISE NOTED.
6. THE POTABLE WATER SUPPLY FOR THIS FACILITY WILL BE PROVIDED FROM A DEVELOPED ON-SITE WELL. UPON COMPLETION OF CHEMICAL ANALYSIS, THE REQUIRED TREATMENT FACILITIES WILL BE DESIGN AND CONSTRUCTED, INCLUDING BUT NOT LIMITED TO DISINFECTION, TURBIDITY, STORAGE, AND WHATEVER OTHER DETERMINATIONS ARE THE RESULT OF TESTING. DESIGN OF THE TREATMENT AND DISINFECTION FACILITIES WILL BE BY A NEW YORK STATE LICENSED PROFESSIONAL ENGINEER.

GRAPHIC SCALE

INCHES 0 1 2 — (IN FEET) 50 25 0 50 100 200

1 inch = 50 ft.

Town of Bethlehem, NY

PLANNING BOARD
TOWN OF BETHLEHEM
ALBANY COUNTY, NEW YORK
By direction of the Chairman,
These drawings are hereby approved.
See sheet(s) C-10
for date and signature.

TOWN OF BETHLEHEM

ALBANY COUNTY DEPARTMENT OF HEALTH
DIVISION OF ENVIRONMENTAL HEALTH SERVICES
By direction of the Commissioner of Health, these plans are hereby approved. See final sheet for date and signature.

ALBANY COUNTY DEPARTMENT OF HEALTH

Rev no	Date	Description	By
E	08-18-14	ISSUED FOR CONSTRUCTION	AJV
D	04-18-14	RESPONSE TO COMMENTS	AJV
C	03-11-14	RESPONSE TO COMMENTS-FINAL APPROVAL	AJV
B	01-10-14	ISSUE FOR DOH APPROVAL	AJV
A	01-07-14	ISSUED FOR SITE PLAN REVIEW	AJV

REVISIONS

L. SIPPERLY & ASSOCIATES
ENGINEERS • SURVEYORS • LAND PLANNERS
696 TROY-SCHENECTADY ROAD, LATHAM, N.Y. 12110
PHONE: (518) 782-1800 FAX: (518) 782-1252

STATE OF NEW YORK — THOMAS JAMES KOCH — 074179 — LICENSED PROFESSIONAL ENGINEER

8/18/14

Date

UNAUTHORIZED ALTERATION OR ADDITION TO THIS DOCUMENT IS A VIOLATION OF SECTION 7209, SUB-DIVISION 2, OF THE NEW YORK STATE EDUCATION LAW.

DESIGNED BY:	AV
DRAWN BY:	AV
CHECKED BY:	TM
APPROVED BY:	LS
SCALE:	1" = 50'
DATE:	01-10-2014

AFRIM'S SPORTS DOME

AT BETHLEHEM SOCCER CLUB

UTILITY PLAN

450 WEMPLE ROAD
ALBANY COUNTY

TOWN OF BETHLEHEM
STATE OF NEW YORK

© COPYRIGHT 2013
L. SIPPERLY & ASSOCIATES
ALL RIGHTS RESERVED.
UNAUTHORIZED ALTERATION IS A VIOLATION OF APPLICABLE LAWS.

SHEET NUMBER

C-111

6 OF 13

REV. NO.	DWG. NO.
E	E-14004

P:\13003\CAD\SHEETS\13003 C111 UTILITES.DWG 8/18/2014 1:51:58 PM