


PARTS LIST - O.F.C.I.			
ITEM	PART NO.	DESCRIPTION	QTY.
①	MT-C649.01	84" x 3.5" O.D. PIPE	2
②	MT-C649.02	36" INSERT	2
③	MT-C649.03	VERTICAL MEMBER	9
④	MT-C649.04	HORIZONTAL MEMBER	4
⑤	MT-C6079	3-1/2" O.D. PIPE CAP	2
* ⑥	MT-514	3/8" ANGLE ADAPTOR	38
⑦	GU-84355	1/2 x 3-5/8 x 5" GALV. U-BOLT ASSY.	8
⑧	GB-04145	1/2 x 1-1/2" GALV. BOLT ASSY.	2
* ⑨	GB-03065	3/8 x 3/4" GALV. BOLT ASSY.	38
* ⑩	GW-F03	3/8" GALV. FLAT WASHER	38

* NOT SHOWN


+ TO PREVENT CORROSION, ENSURE THAT THE PIPE SLEEVE IS COMPLETELY BELOW GROUND LEVEL AND ENCASED IN CONCRETE.

- NOTES:
1. UNLESS OTHERWISE NOTED, ALL UNDERGROUND PVC TO BE SCH 40.
 2. ALL ABOVE GRADE PVC TO BE SCH 40. ALL CONNECTIONS TO BE SCH 40 PVC OR SEALTIGHT. VERIFY WITH CONSTRUCTION MANAGER PRIOR TO BID.
 3. ALL WIRE CONNECTIONS & CONDUITS TO BE SUPPLIED BY CONTRACTOR UNLESS OTHERWISE NOTED OR SPECIFIED BY CONSTRUCTION MANAGER.
 4. ADDITIONAL ANGLE ADAPTORS (NOT SHOWN) ARE USED TO MOUNT SERVICE BOXES TO THE VERTICAL MEMBERS.

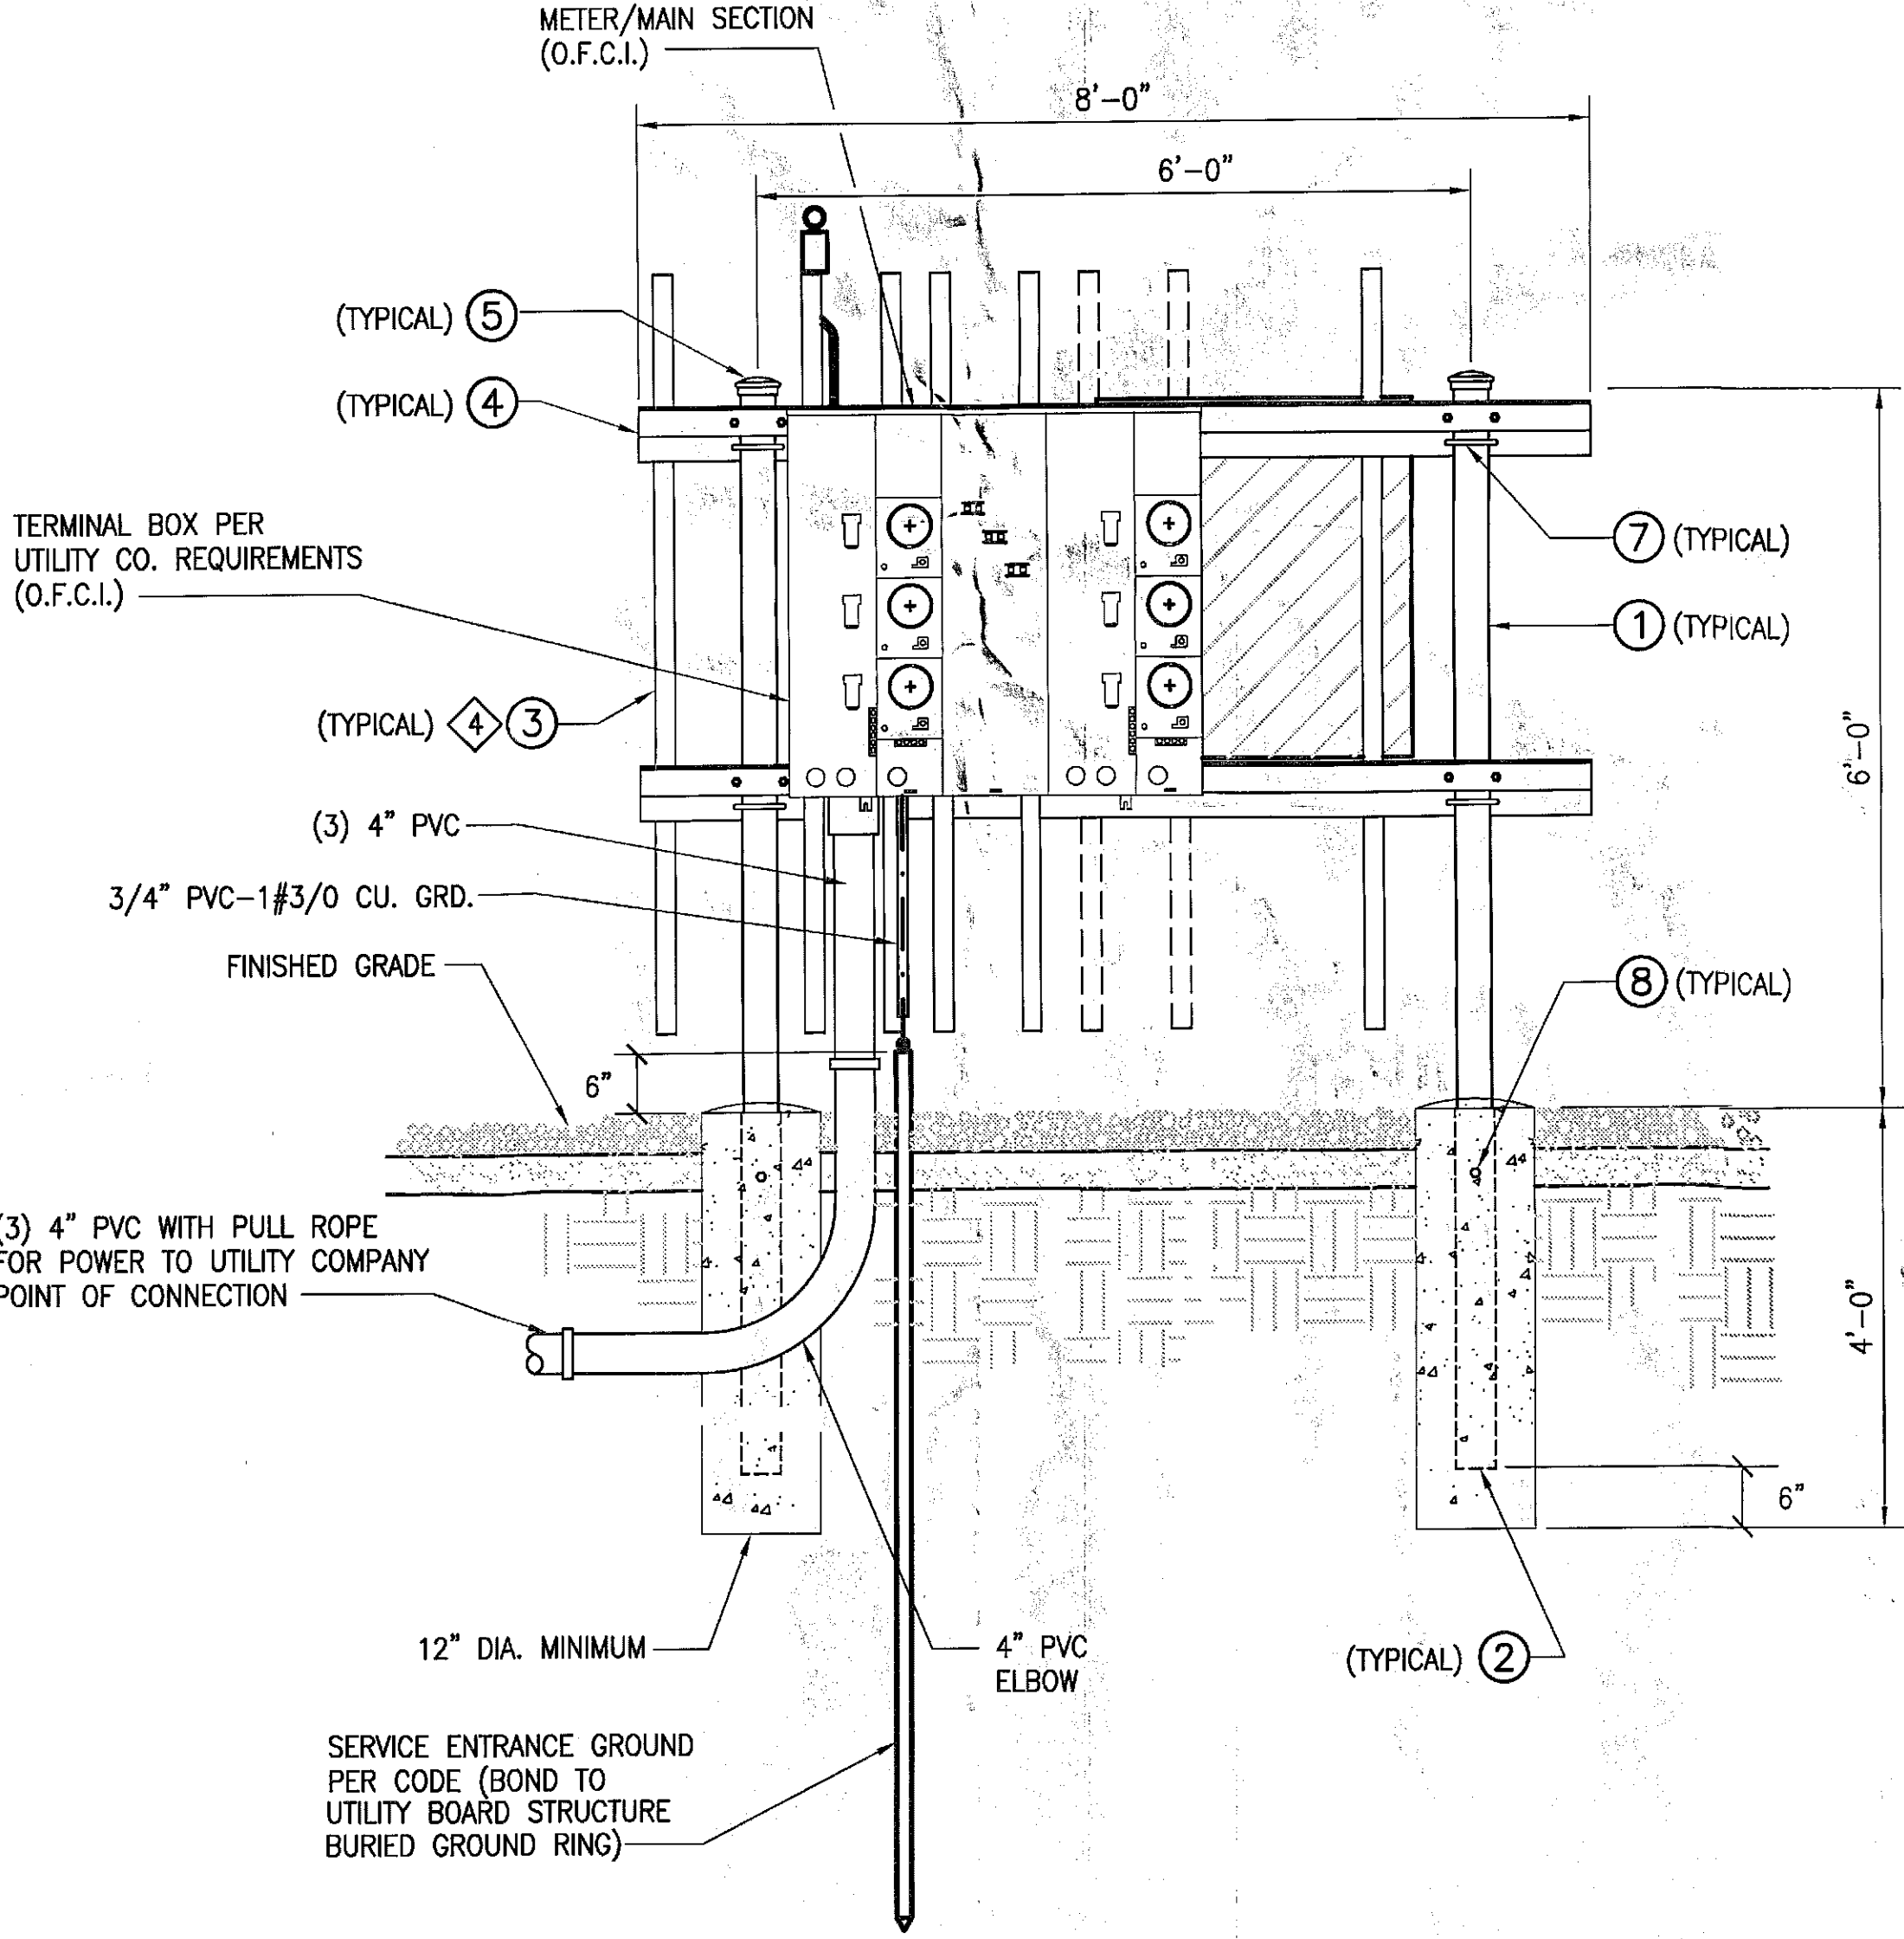

ELECTRICAL SIDE OF UTILITY RACK

1 UTILITY RACK DETAILS
NOT TO SCALE

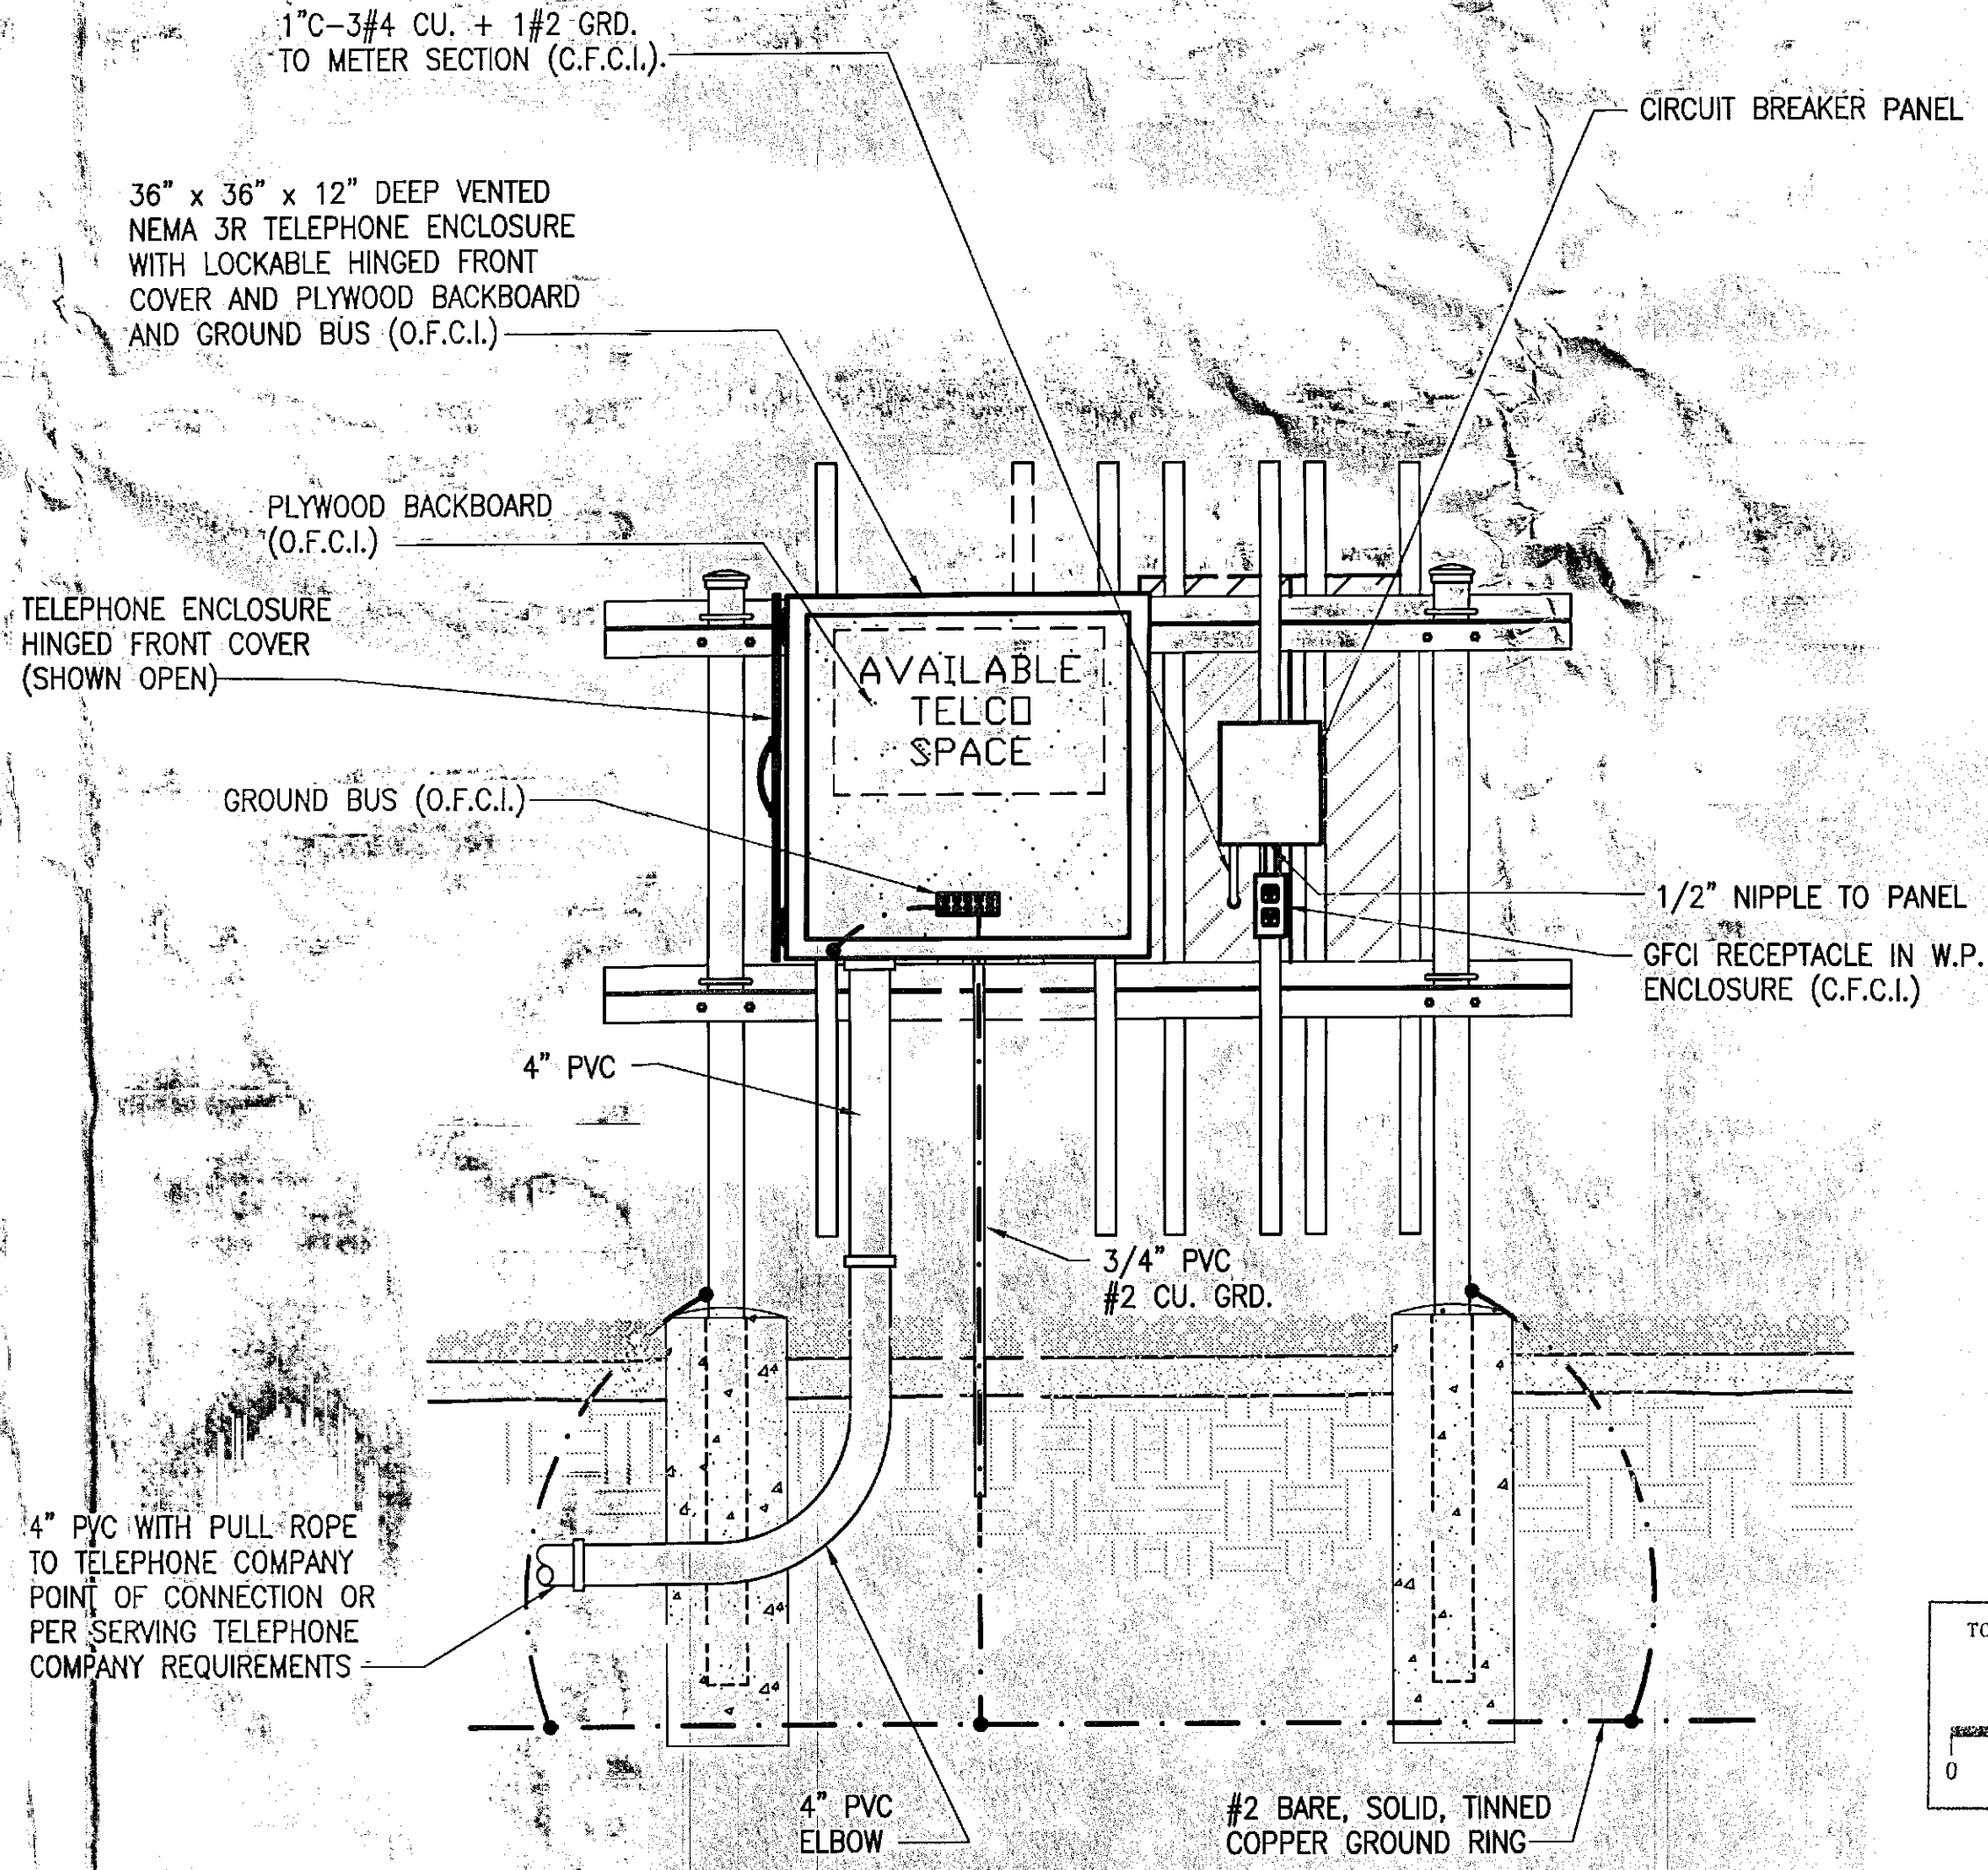

TELCO SIDE OF UTILITY RACK

TOWN OF BETHLEHEM, NEW YORK
PLANNING DEPT. ORIGINAL
- SCANNED -
0 1 2 INCHES

PLANNING BOARD
TOWN OF BETHLEHEM
ALBANY COUNTY, NEW YORK
By direction of the Chairman.
These drawings are hereby approved.
See sheet(s) 2 of 21
for date and signature.

Design. build. Deliver.
INFINIGY
1033 Watervliet Shaker Rd
Albany, NY 12205
Office # (518) 890-0780
Fax # (518) 890-0783



1	REVISED PER COMMENTS	SKB	6/30/15
0	ISSUED FOR BP	SKB	4/22/15
No.	Submittal / Revision	App'd	Date
Drawn:	SKB	Date:	4/22/15
Designed:	AJD	Date:	4/22/15
Checked:	AJD	Date:	4/22/15

Project Number
168-117

Project Title
CELL TOWER
457 NYS ROUTE 85
SLINGERLANDS, NY 12159

Prepared For
Phoenix Towers LLC
110 WASHINGTON AVE.
NORTH HAVEN, CT 06473
C: 203-623-9287

Drawing Title
UTILITY RACK DETAIL

Drawing Scale:
Date:
6/30/15
CD

UNAUTHORIZED ALTERATION OR ADDITION TO THIS DOCUMENT IS A VIOLATION OF APPLICABLE STATE AND/OR LOCAL LAWS
Sheet Number: