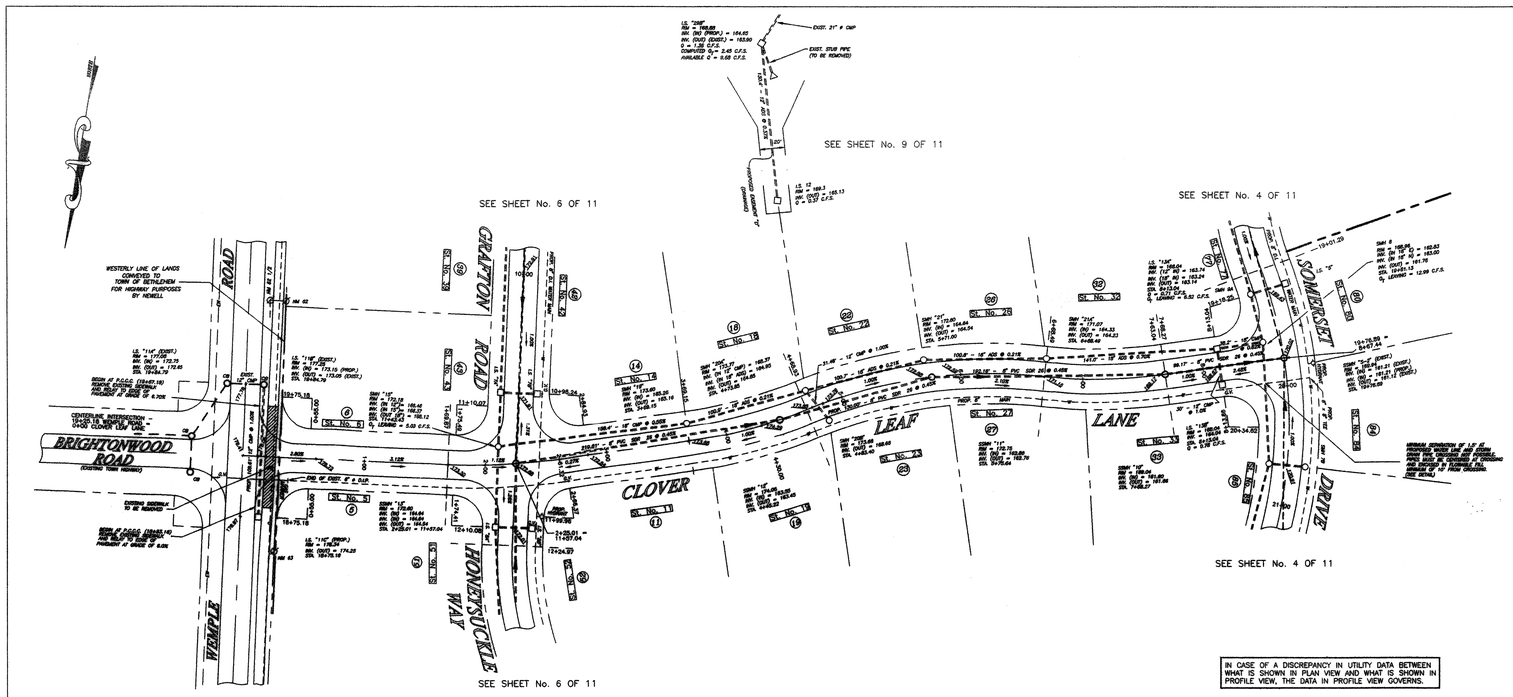


IN CASE OF A DISCREPANCY IN UTILITY DATA BETWEEN WHAT IS SHOWN IN PLAN VIEW AND WHAT IS SHOWN IN PROFILE VIEW, THE DATA IN PROFILE VIEW GOVERNS.




WATER MAIN FILL DETAIL
(NOT TO SCALE)

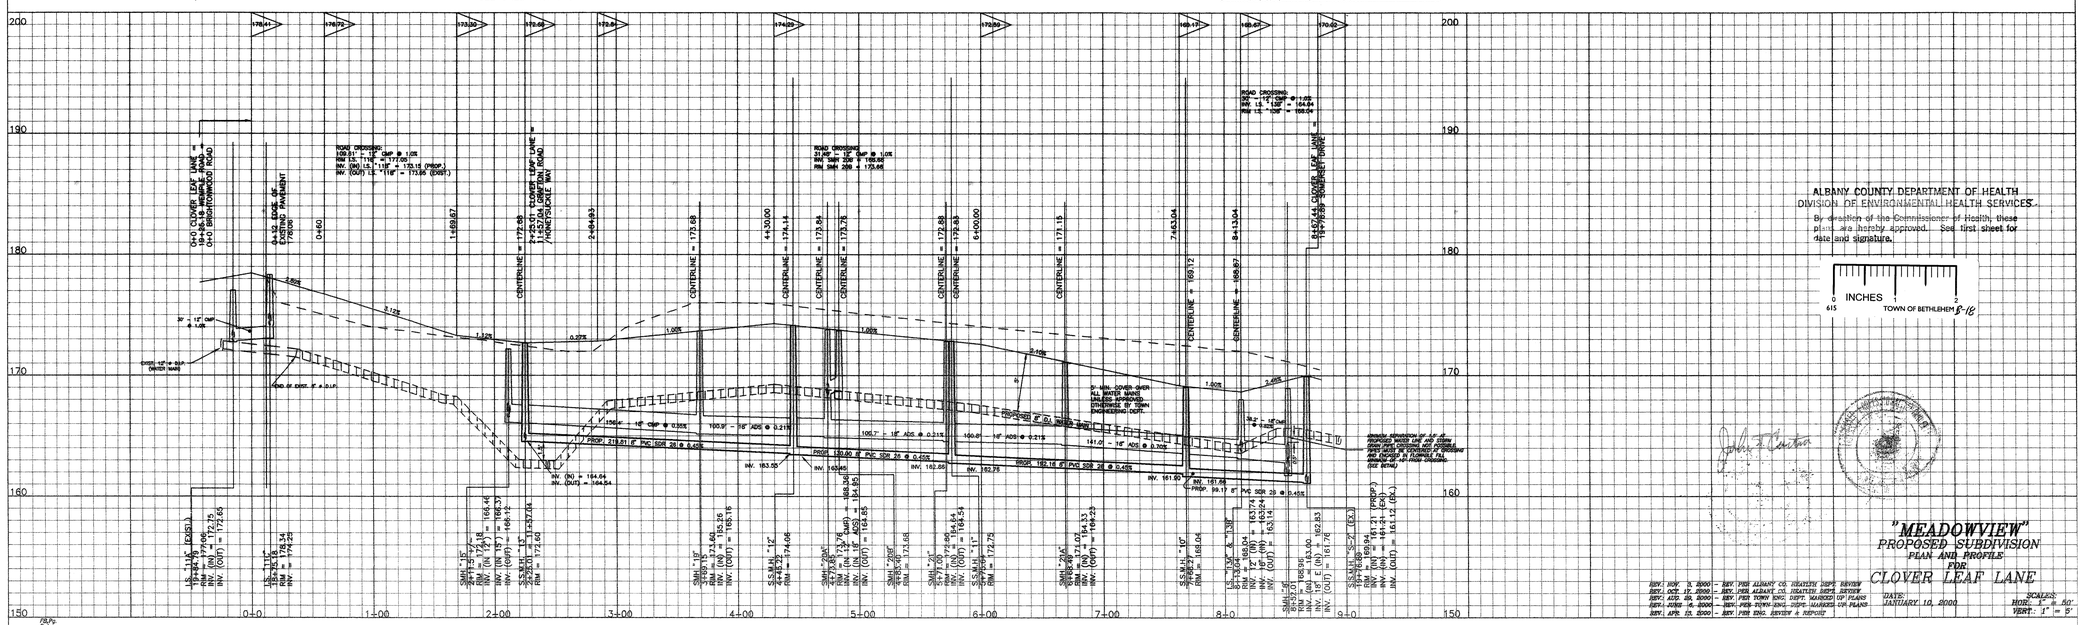


ALBANY COUNTY DEPARTMENT OF HEALTH
DIVISION OF ENVIRONMENTAL HEALTH SERVICES
By direction of the Commissioner of Health, these plans are hereby approved. See first sheet for date and signature.

INCHES 0 1 2
0.5 1.5
TOWN OF BETHLEHEM 8-16

"MEADOWVIEW"
PROPOSED SUBDIVISION
PLAN AND PROFILE
FOR
CLOVER LEAF LANE

REV. NOV. 15, 2000 - REV. PER ALBANY CO. HEALTH DEPT. REVIEW
REV. OCT. 12, 2000 - REV. PER ALBANY CO. HEALTH DEPT. REVIEW
REV. AUG. 24, 2000 - REV. PER TOWN ENG. DEPT. MARKED UP PLANS
REV. JUNE 16, 2000 - REV. PER TOWN ENG. DEPT. MARKED UP PLANS
REV. APR. 25, 2000 - REV. PER ENG. REVIEW & DEPOSIT

DATE: JANUARY 10, 2000

SCALES:
HORZ. 1" = 50'
VERT. 1" = 5'