


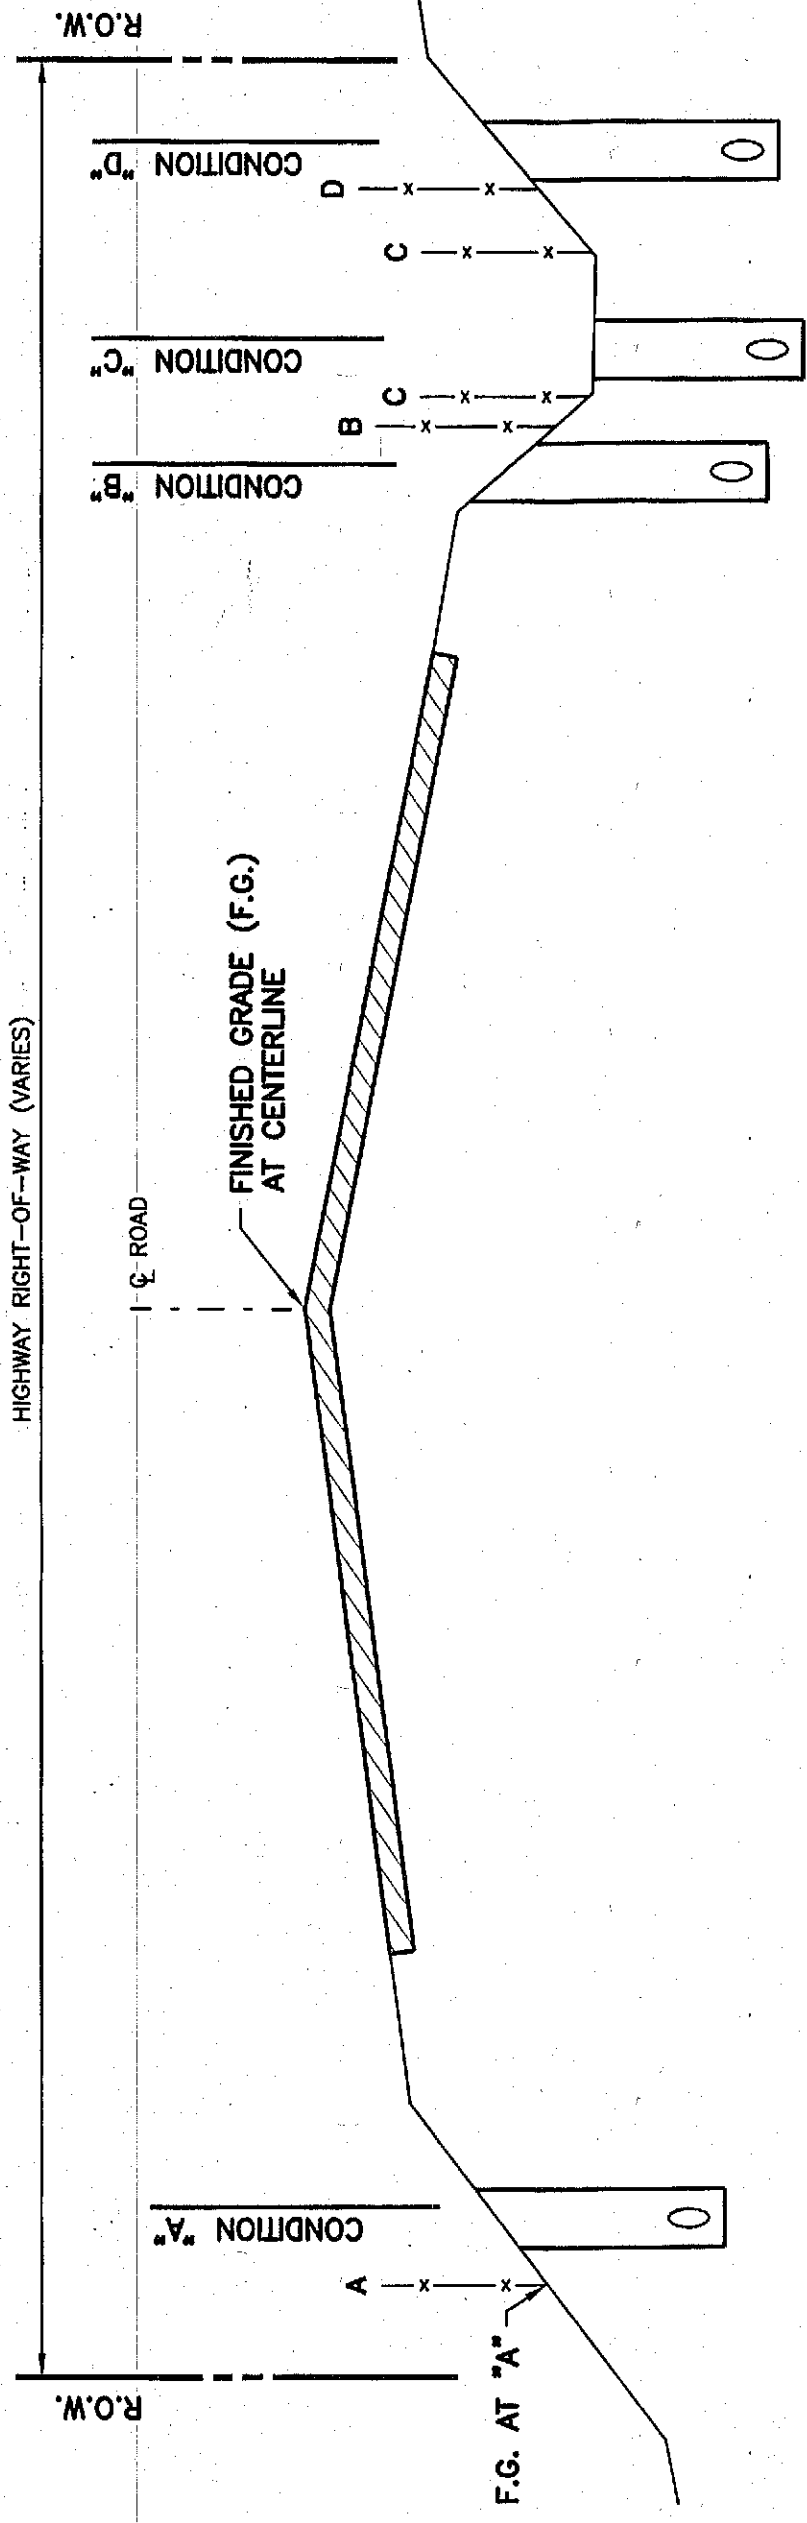



CONDITION	SUGGESTED EROSION PROTECTION	REMARKS
A	PROMPTLY BACKFILL TOPSOIL, SEED AND MULCH. INSTALL SILT FENCE ON DOWNHILL SLOPE.	BACKFILL TO TOPSOIL SURFACE AT END OF EACH DAY. TOPSOIL, SEED AND MULCH WITHIN 12 DAYS OF INITIAL DISTURBANCE FOR RESPECTIVE AREAS.
B	SAME AS ABOVE	BACKFILL TO TOPSOIL SURFACE AT END OF EACH DAY. TOPSOIL, SEED, MULCH AND APPLY JUTE WREST TO ALL TOPSOIL SURFACES WITHIN 12 DAYS OF INITIAL DISTURBANCE FOR RESPECTIVE AREAS.
C	SAME AS ABOVE WITH SILT FENCING AT TOE OF SLOPE(S)/DRAINAGE CHANNEL INTERFERENCE ON BOTH SIDES.	BACKFILL TO TOPSOIL SURFACE AT END OF EACH DAY. TOPSOIL, SEED, MULCH AND APPLY JUTE WREST TO ALL TOPSOIL SURFACES WITHIN 12 DAYS OF INITIAL DISTURBANCE FOR RESPECTIVE AREAS.
D	SAME AS "B"	SAME AS "B"

NOTES:


- CONTRACTOR IS RESPONSIBLE FOR ALL STORMWATER RUNOFF AND NYSDEC PERMIT COMPLIANCE DURING CONSTRUCTION.
- MEASURES SHOWN ARE SUGGESTED TEMPORARY DEVICES TO ENSURE WATER QUALITY OF RUNOFF BUT ADDITIONAL MEASURES ARE CONCEIVABLE.
- IF SEDIMENT PASSES THROUGH SILT FENCING AND INTO DITCH, CORRECT AS SOON AS POSSIBLE AND/OR INSTALL TRIANGULAR SILT DIKES ACROSS DRAINAGE CHANNEL.
- STAGGER SILT FENCE EVERY 50' O.C. WHEN FINISH GRADE AT "A" OR "B" IS LESS THAN 10' BELOW FINISH GRADE AT CENTERLINE TO ALLOW LARGE RUNOFF VOLUME/RATES TO ESCAPE WITHOUT PONDING ON HIGHWAY OR SHOULDER.

SUGGESTED EROSION AND SEDIMENT CONTROL FOR PIPELINE INSTALLATION ALONG HIGHWAYS

N.T.S.

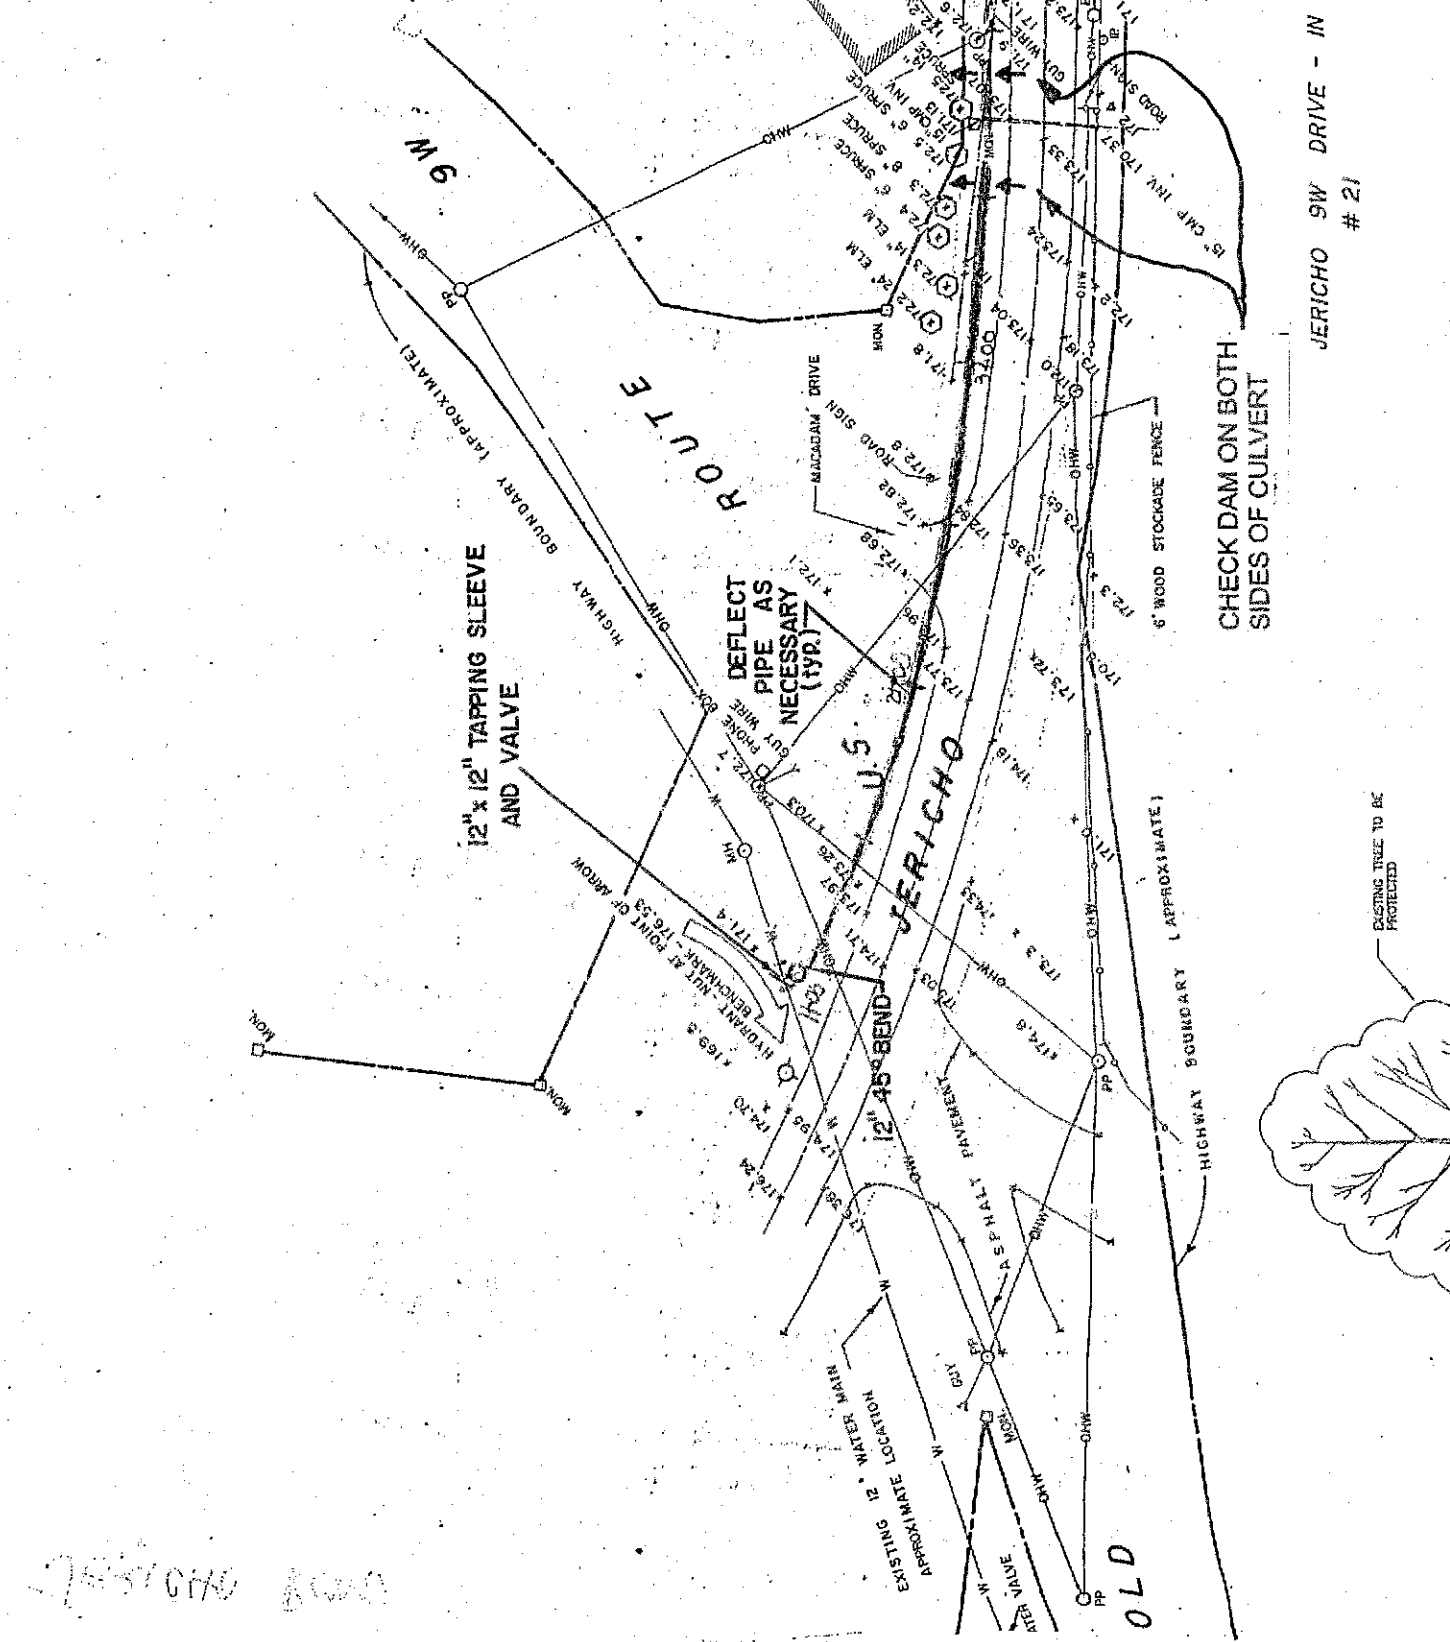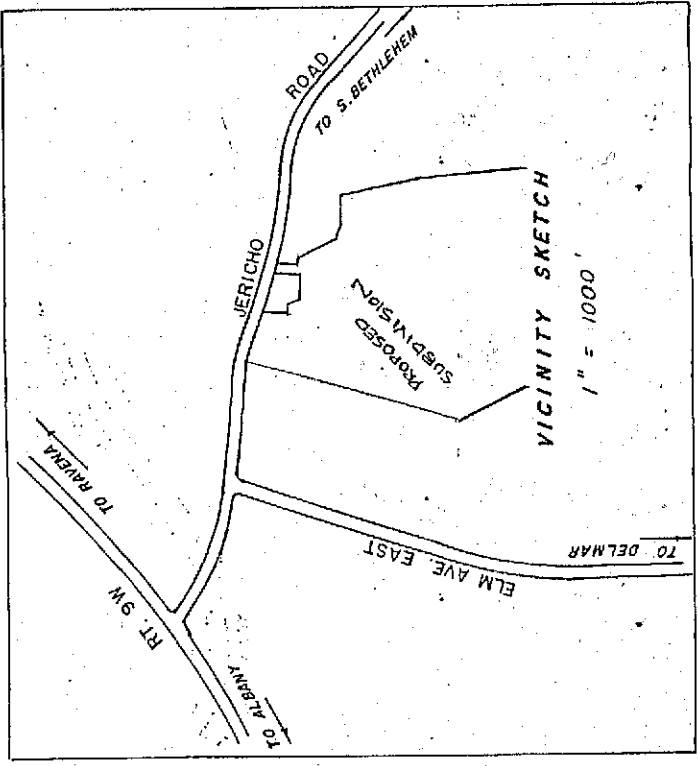

SEE SHEET 26

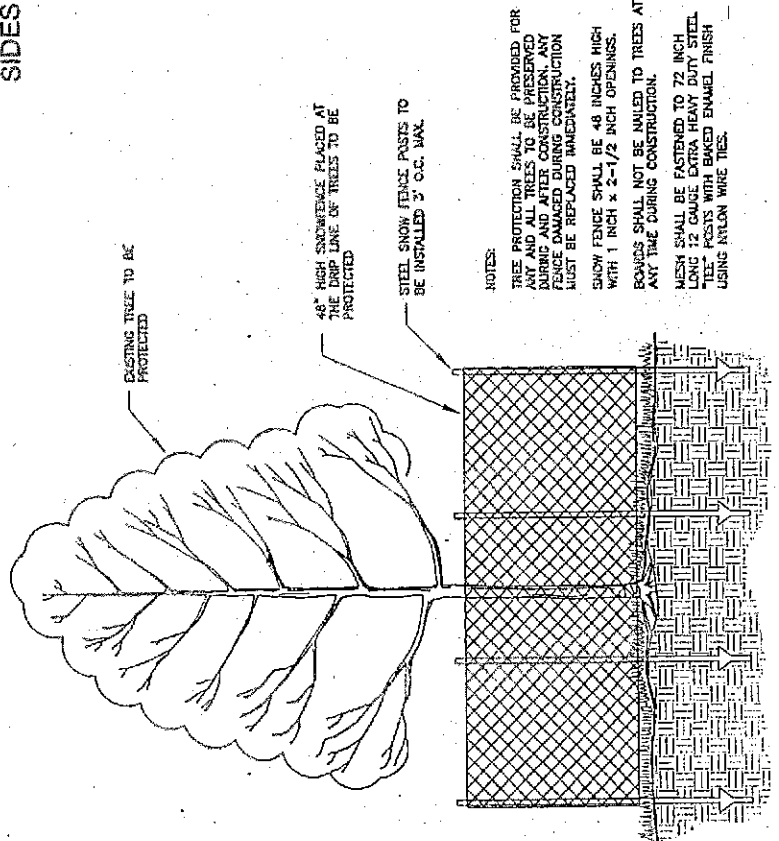

- GENERAL NOTES:
- UTILITIES SHOWN HEREIN HAVE BEEN CHECKED FROM RECORD PLANS AND FIELD SURVEY. CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE LOCATION AND DEPTH OF ALL UTILITIES PRIOR TO CONSTRUCTION.
 - CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS PRIOR TO CONSTRUCTION.
 - CONTRACTOR SHALL BE RESPONSIBLE FOR MAINTAINING ACCESS TO ALL ADJACENT PROPERTIES AND PUBLIC ROADS DURING CONSTRUCTION.

SCALE: 1" = 50'


SEE SHEET 10

SEE SHEET 14

SEE SHEET 18

SEE SHEET 22

SEE SHEET 26

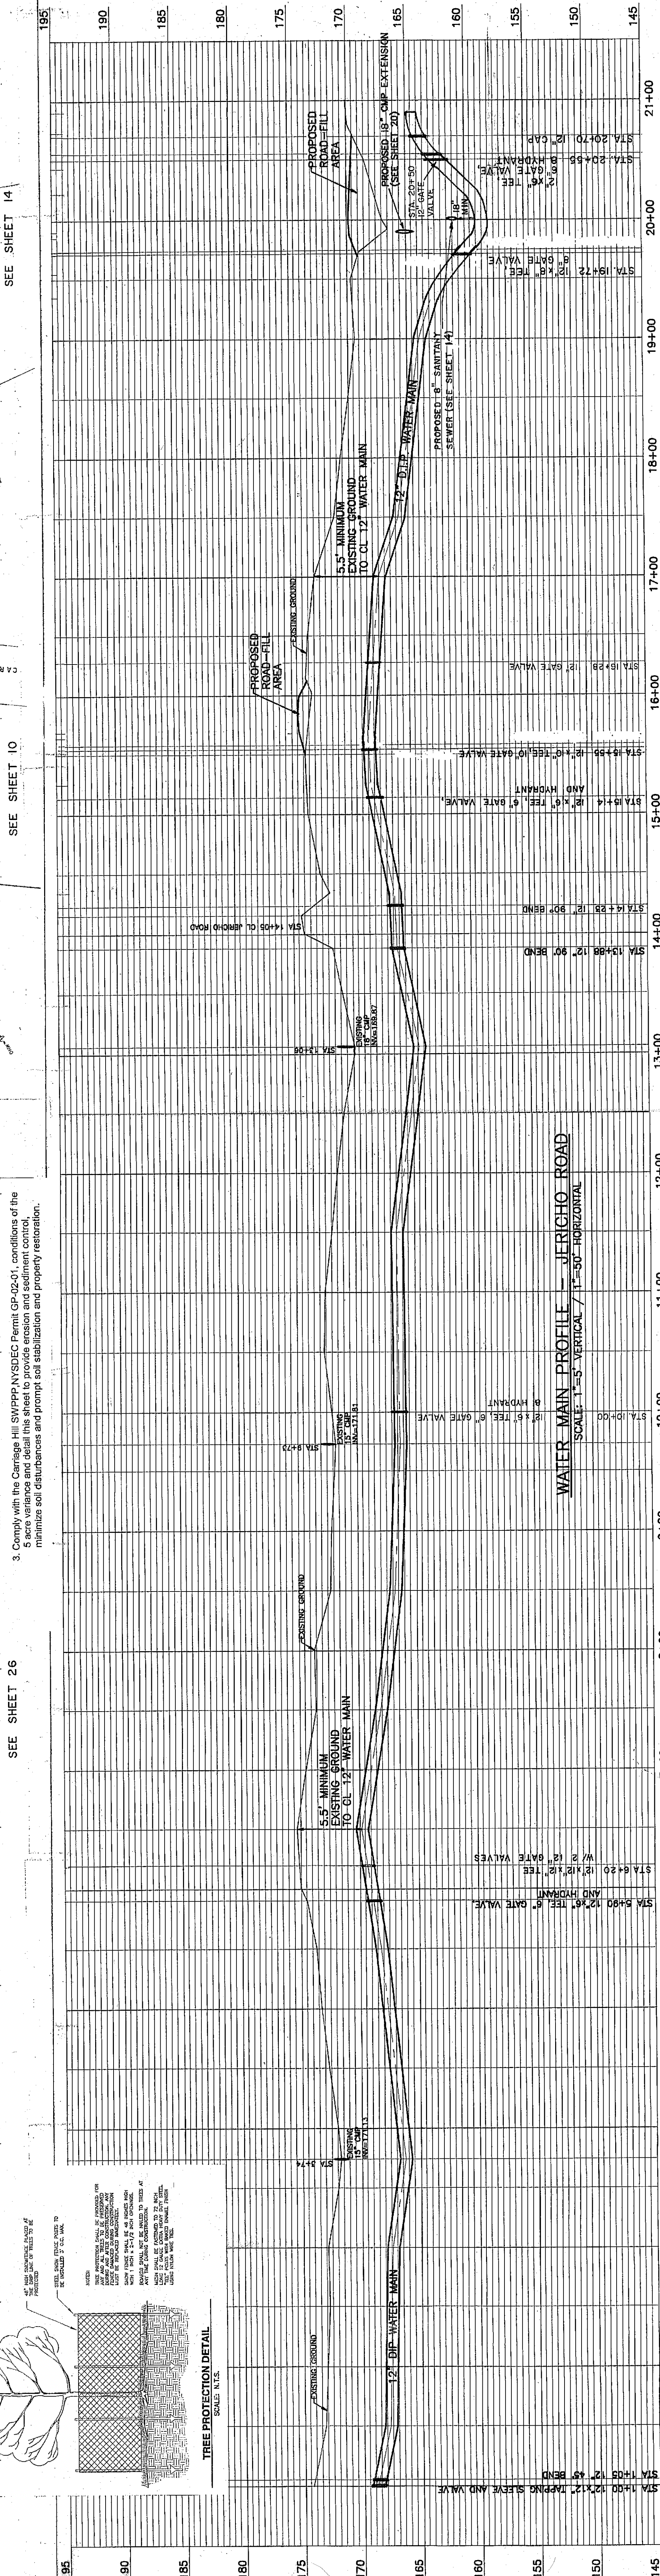


WATER MAIN PROFILE - JERICHO ROAD

SCALE: 1"=5' VERTICAL / 1"=50' HORIZONTAL

PLANNING BOARD
TOWN OF BETHLEHEM
ALBANY COUNTY, NEW YORK
FINAL PLAN APPROVAL

WHEN SIGNED BY THE PLANNING BOARD, THIS PLAN SHALL BE CONSIDERED AS THE FINAL PLAN FOR THE PROJECT.

SIGNED: [Signature]
DATE: 10/15/11

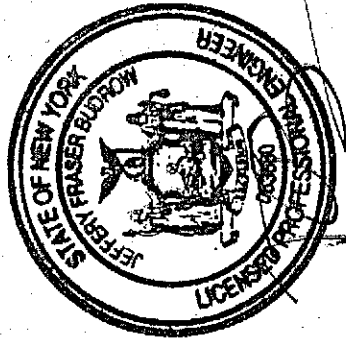

PLAN AND PROFILE OF
PROPOSED WATER MAIN
EXTENSION FOR
"CARRIAGE HILL"
RESIDENTIAL SUBDIVISION

TOWN OF BETHLEHEM
COUNTY OF ALBANY

EDWARD W. BOUWELLE & SON
CIVIL ENGINEERS AND SURVEYORS
A DIVISION OF E. BOUWELLE & ASSOCIATES, P.E., L.L.C.
1000 WEST 10TH STREET
ALBANY, NEW YORK 12206-4201
PHONE: 518-865-1234
FAX: 518-865-1235
WWW.EBOUWELLE.COM

DATE: OCTOBER 24, 1992

REVISION: [Blank]

SCALE: AS SHOWN

SHEET 25 OF 31