

MAP OF PORTION of **HAMAGRAEL** SECTION #2 PROPERTY OF HOME CONSTRUCTION CORP. **SEPTIC TANK DETAILS AND LAYOUT** DELMAR ALBANY COUNTY Scales as shown NEW YORK JULY 17, 1953 Revised Oct. 29, 1953









NOTES

Design of Septic Tank is based upon 3 living units. Liquid capacity of Septic Tank shall be at least 500 gals. Commercial Tanks of an approved design may be substituted for the concrete tank as shown. Line from house sewer and line between Septic Tank and Distribution Box shall be bell and spigot type vitrified or concrete pipe, with water-tight joints. Disposal Field shall not be located within 10 feet of dwellings, lot lines, and large trees. Soil tests were taken at present grade - Extensive grading would require new percolation tests. Grades of all tile lines should be strictly adhered to. It is suggested that for most efficient operation of Sewage Disposal system, any surface drainage be diverted from the disposal area. Lot numbers to be used as house numbers. Length of tile field based on 15 minute test.

- #1 - Denotes boring - taken July, 1953
- #1 - All sand - ground water at 4.0'±
- #2 - " " " " " 4.0'±
- #3 - " " " " " 4.5'±
- #4 - Sand to 4'± - sandy clay to ground water at 4.3'±

OT - Percolation Test - 5 minutes

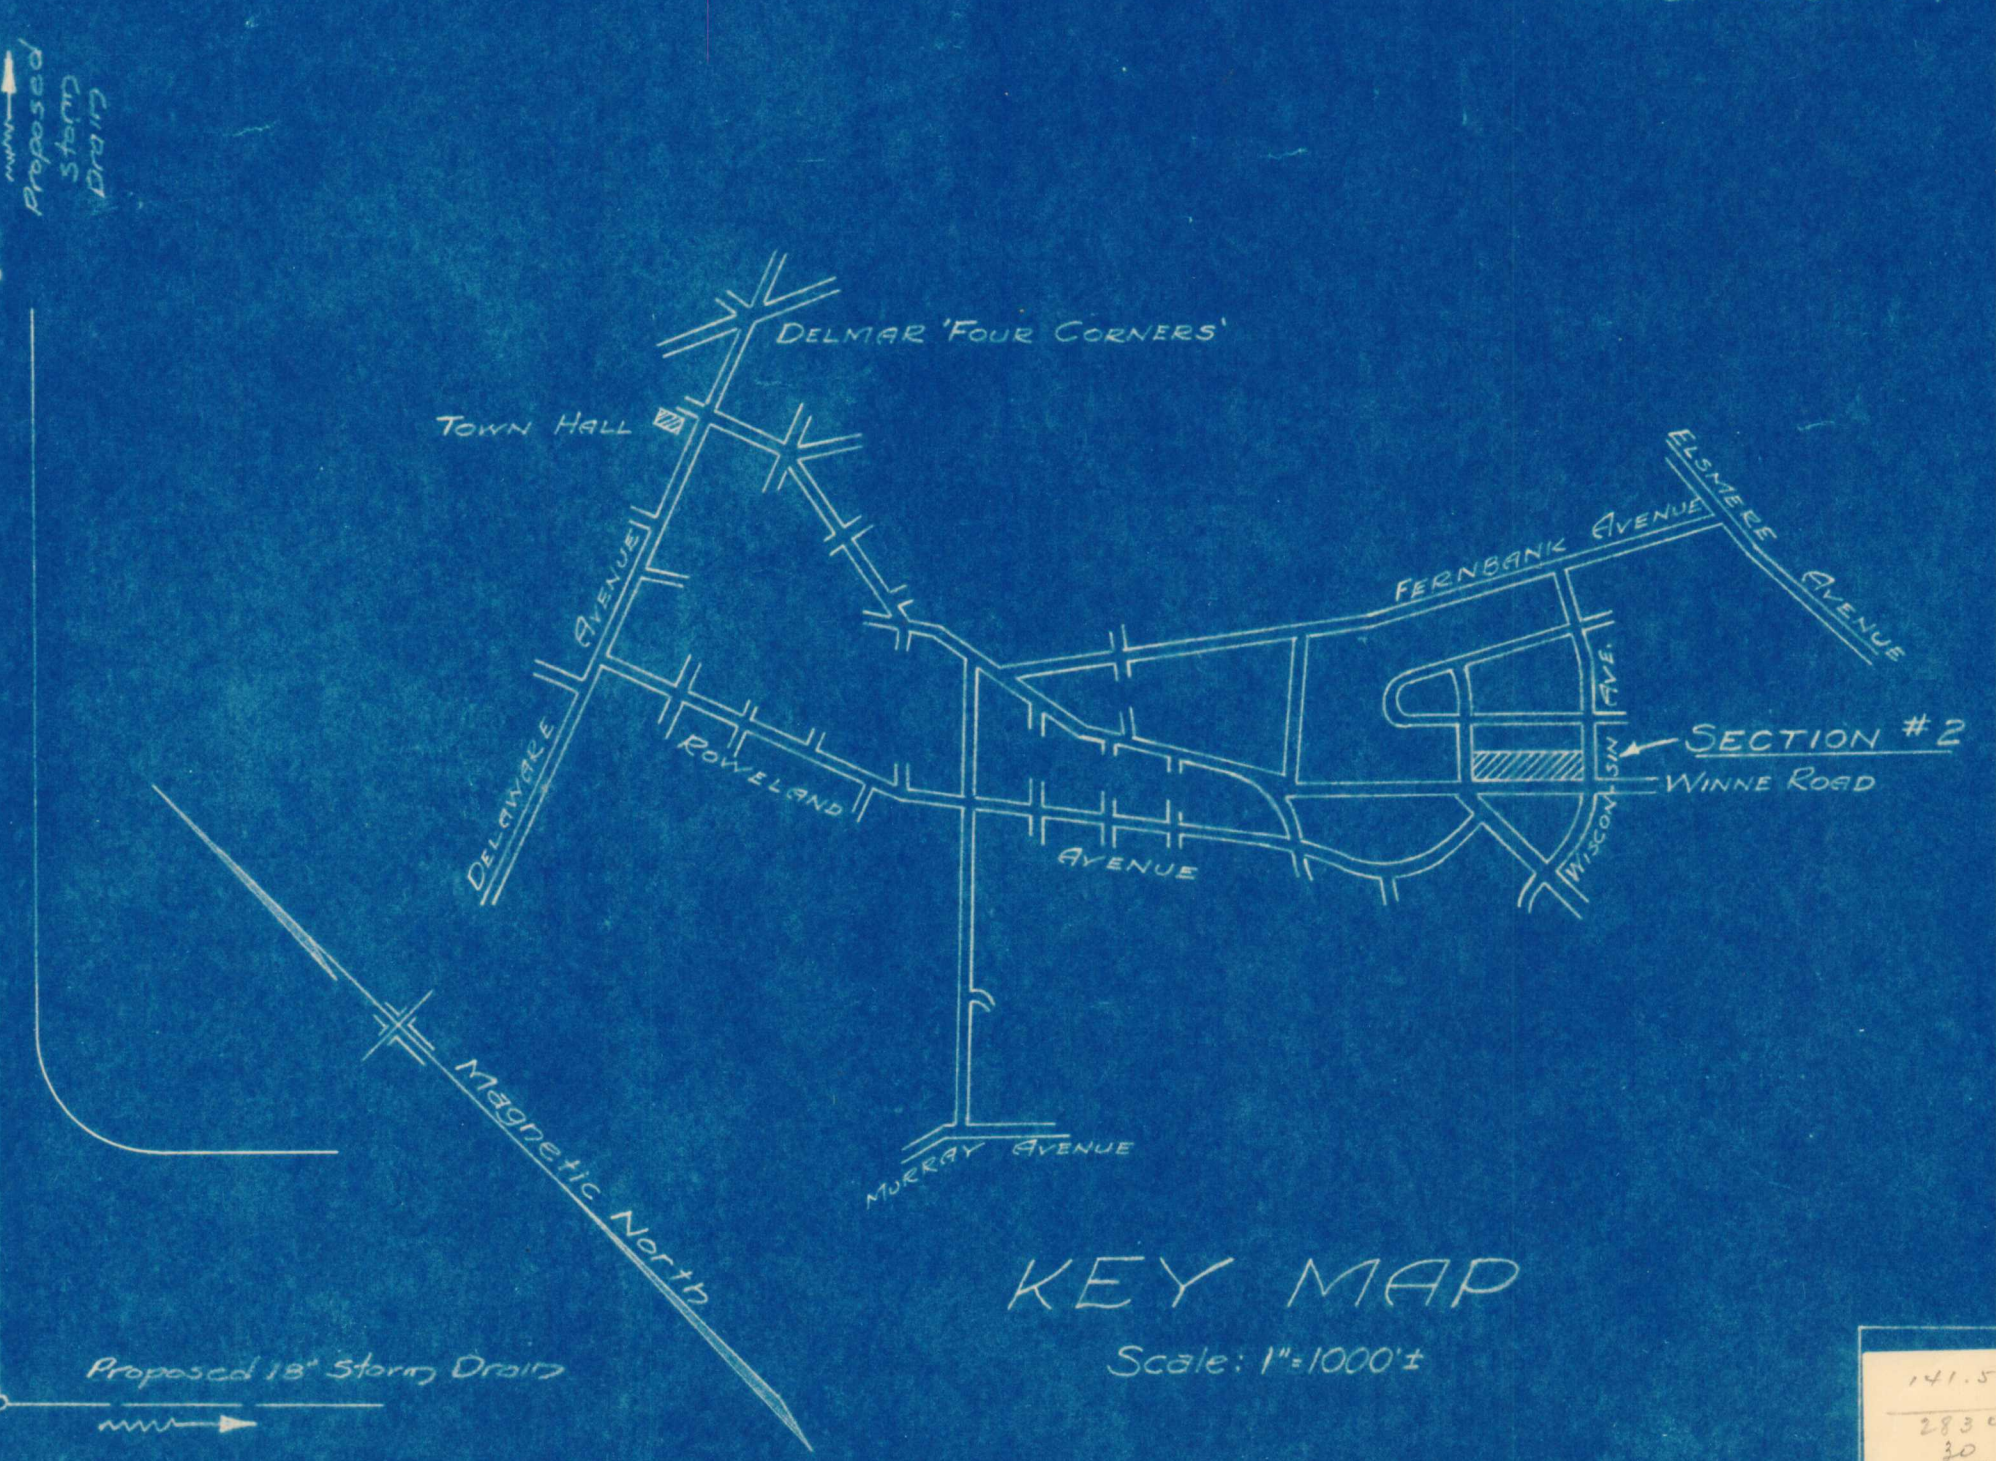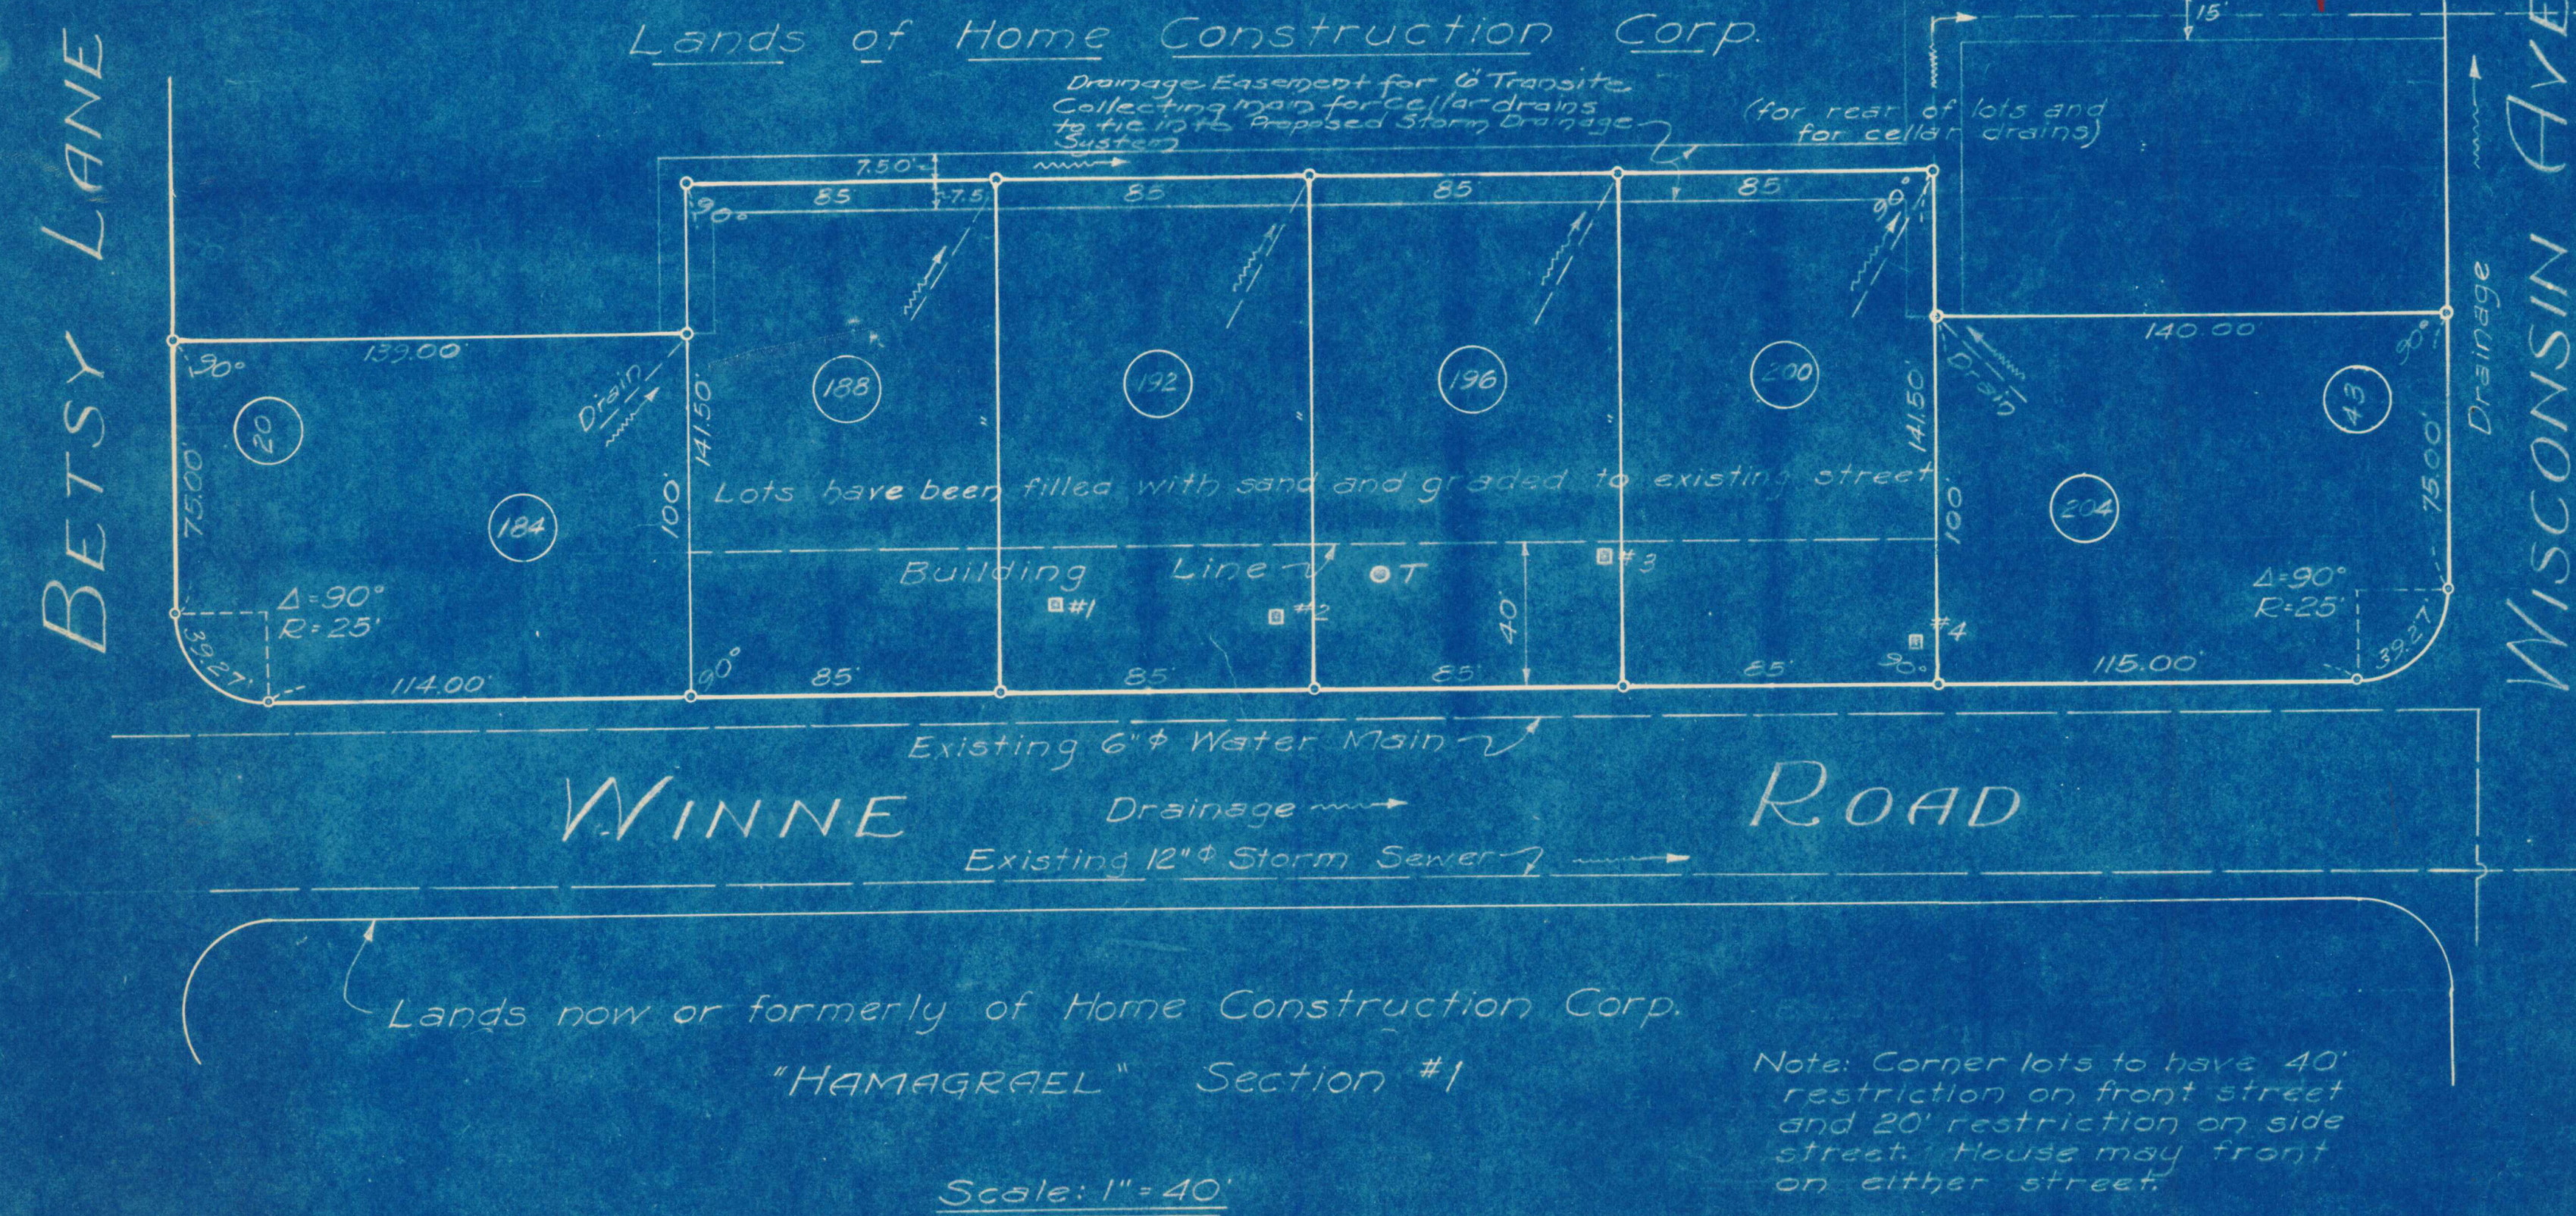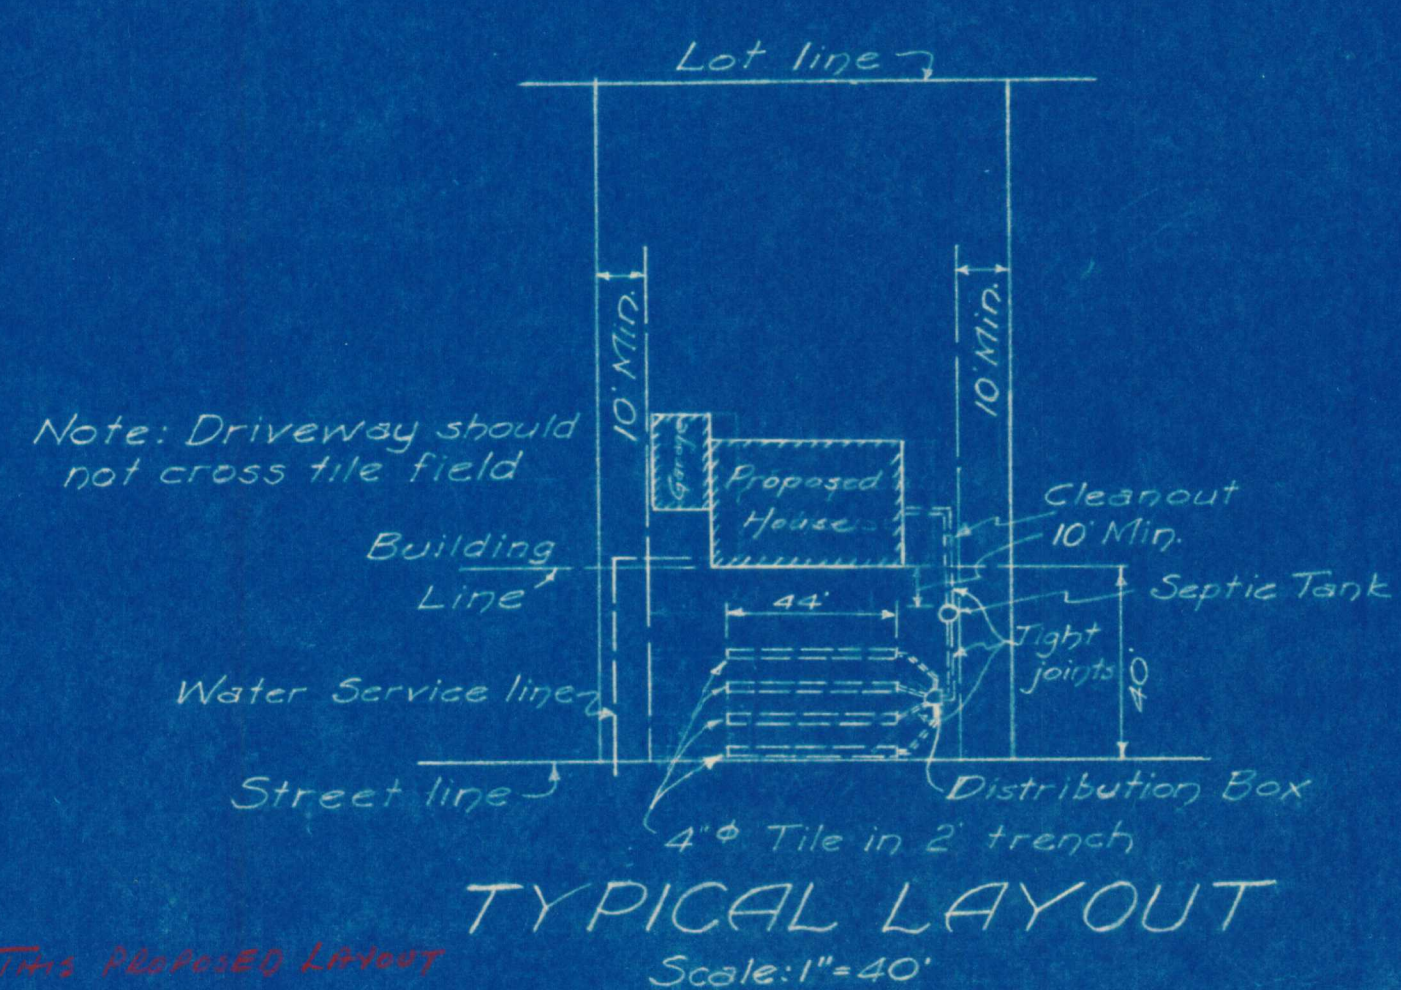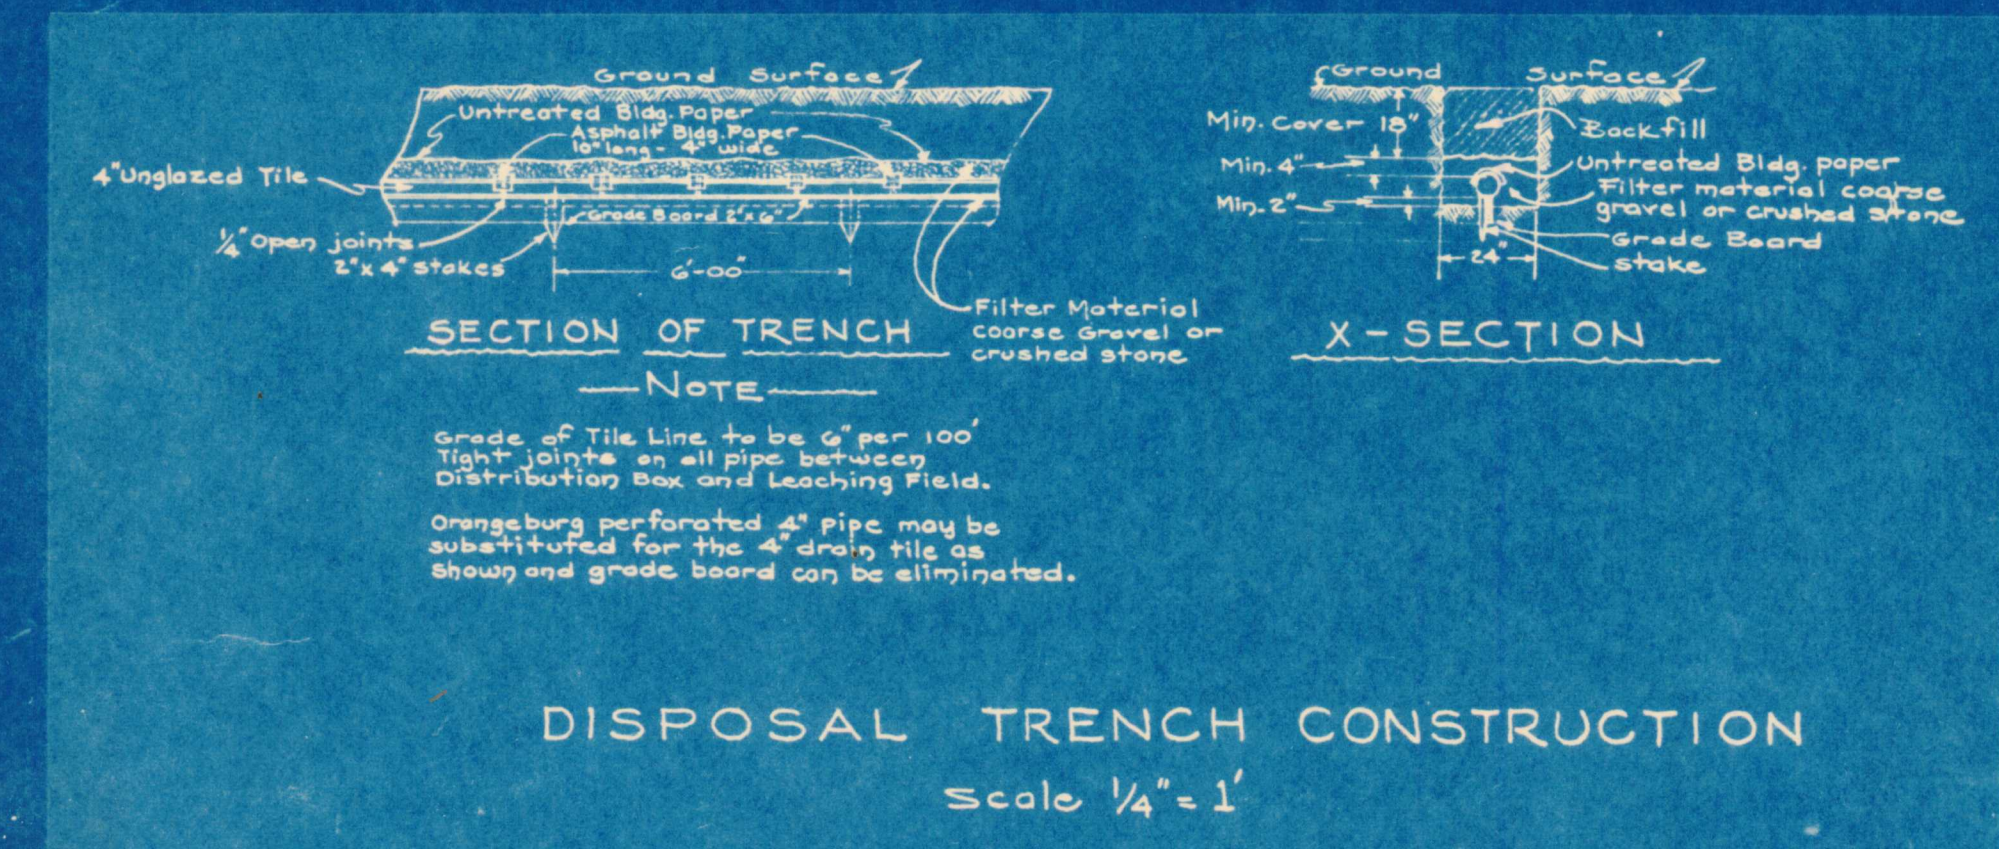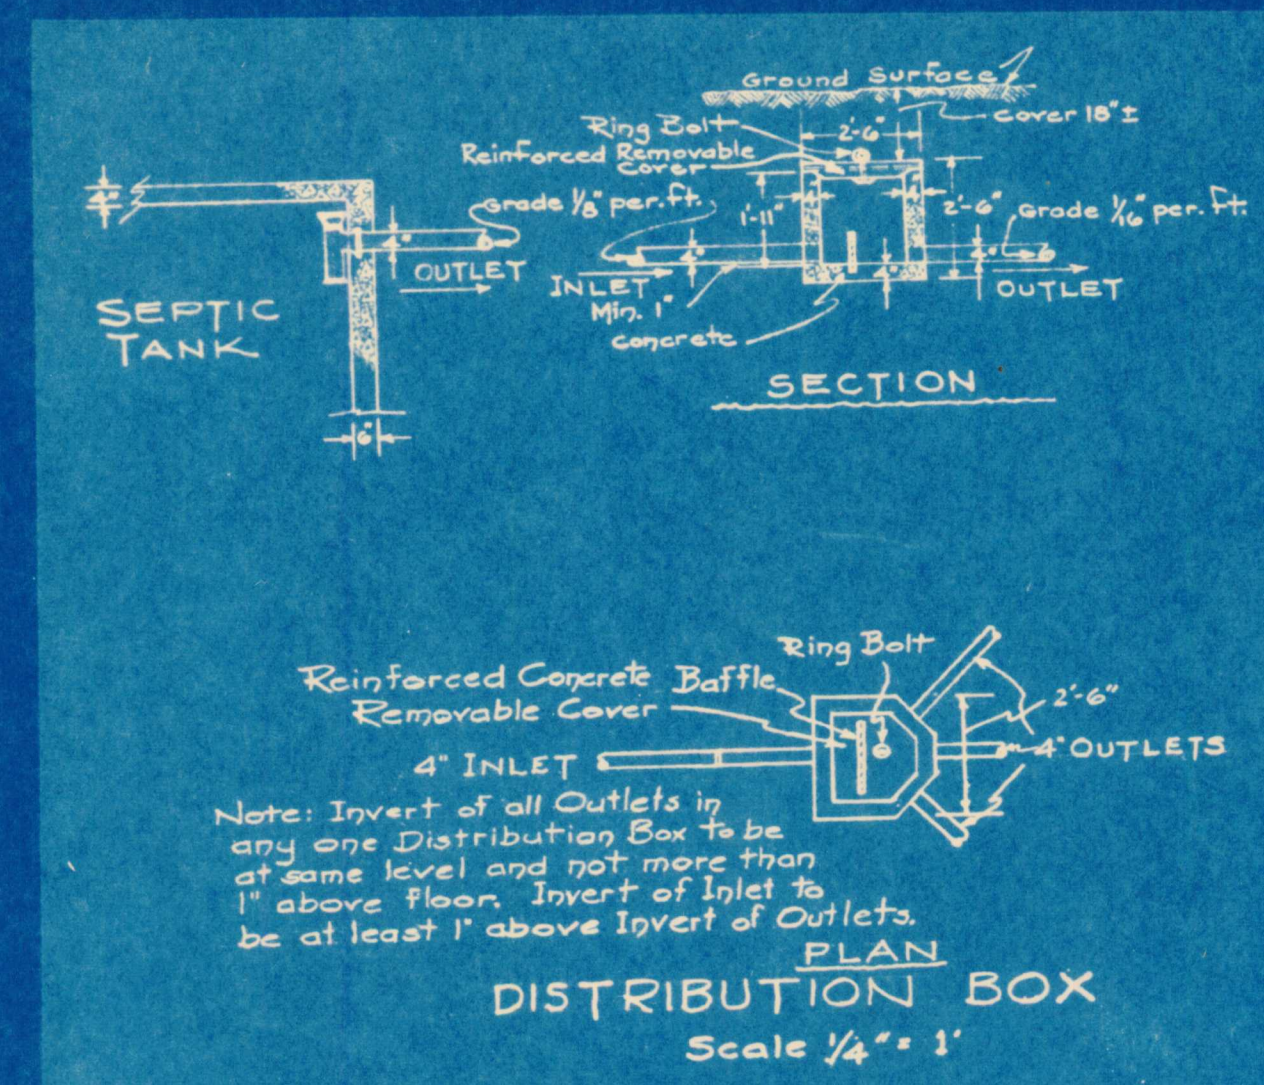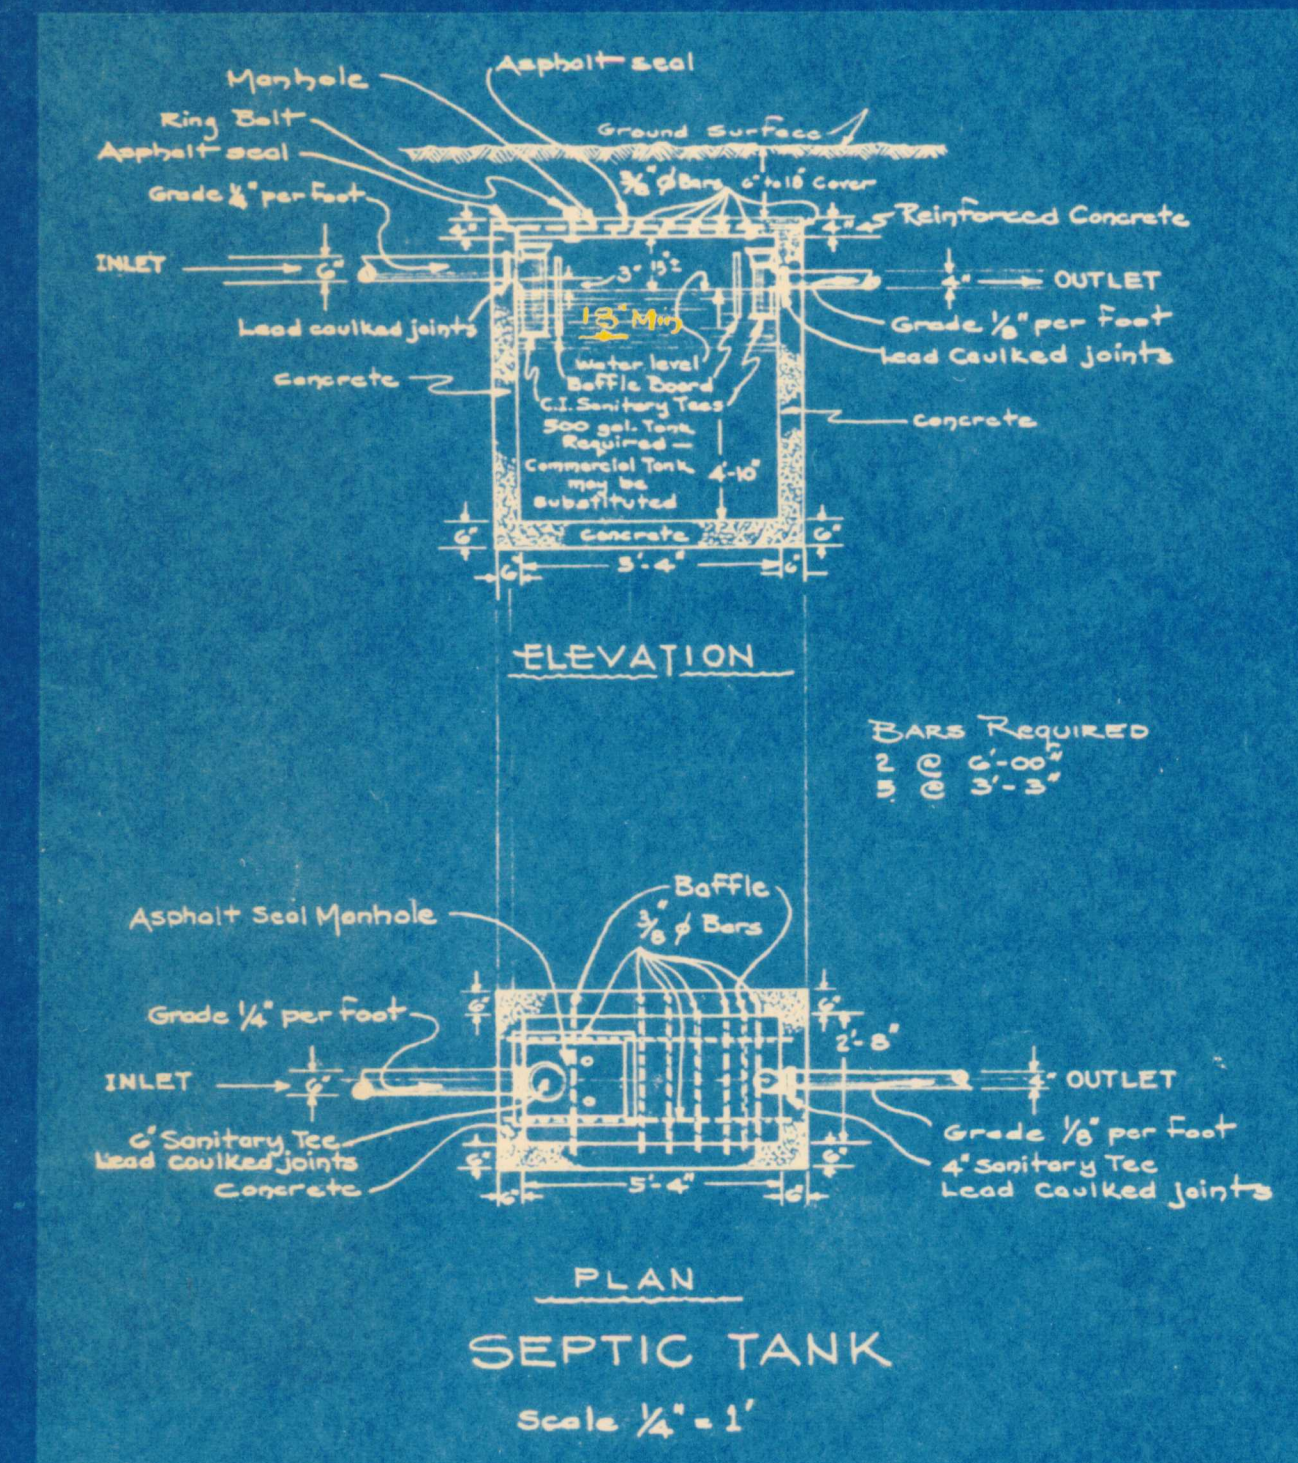

Survey and Map by:
Edward W. Boutelle & Son
Civil Engineers & Surveyors
Delmar, N.Y.
N.Y. State License

141.00	
213.00	
30	
28	
338.00	Area - 4.11
529	
3.00	
11.5	
11.5	
6.7	