


# MAP OF PROPERTY of **WEBER BROS., INC.**

DELMAR  
ALBANY COUNTY NEW YORK  
SCALES AS SHOWN NOV. 1958





## NOTES

Design of Septic Tank is based upon 3 or 4 living units. Liquid capacity of Septic Tank shall be 600 gals. or 750 gals. respectively. A metal tank - Commercial Standard 177-51 - may be substituted for the concrete tank as shown. Sewer line from house and line between Septic Tank and tile Disposal Field shall be bell and spigot type vitrified or concrete pipe with water-tight joints. Disposal Field and Septic Tank design basis - minute soil percolation test. Disposal Field shall not be located within 10 feet of dwellings, lot lines, or large trees. Grades of all tile lines shall be strictly adhered to. It is suggested that for most efficient operation of Sewage Disposal system, any surface drainage be diverted from the disposal area. Elevations refer to U.S.G.S. datum. Bench Mark is nut at point of arrow on hydrant, north side of Jordan Blvd. east of Louise St. - Elev. 209.55. If a Garbage Disposal unit is installed, capacity of the Septic Tank must be increased by 50%. Elevations shown thus - 203.9 - are finished grade. Other elevations shown are existing.

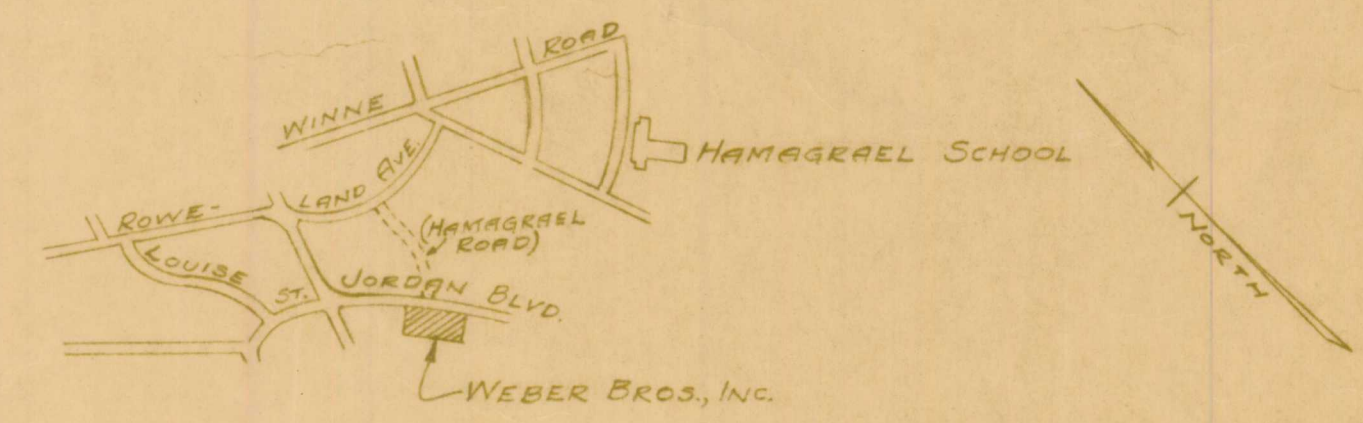

VICINITY PLAN  
Scale: 1" = 1000'

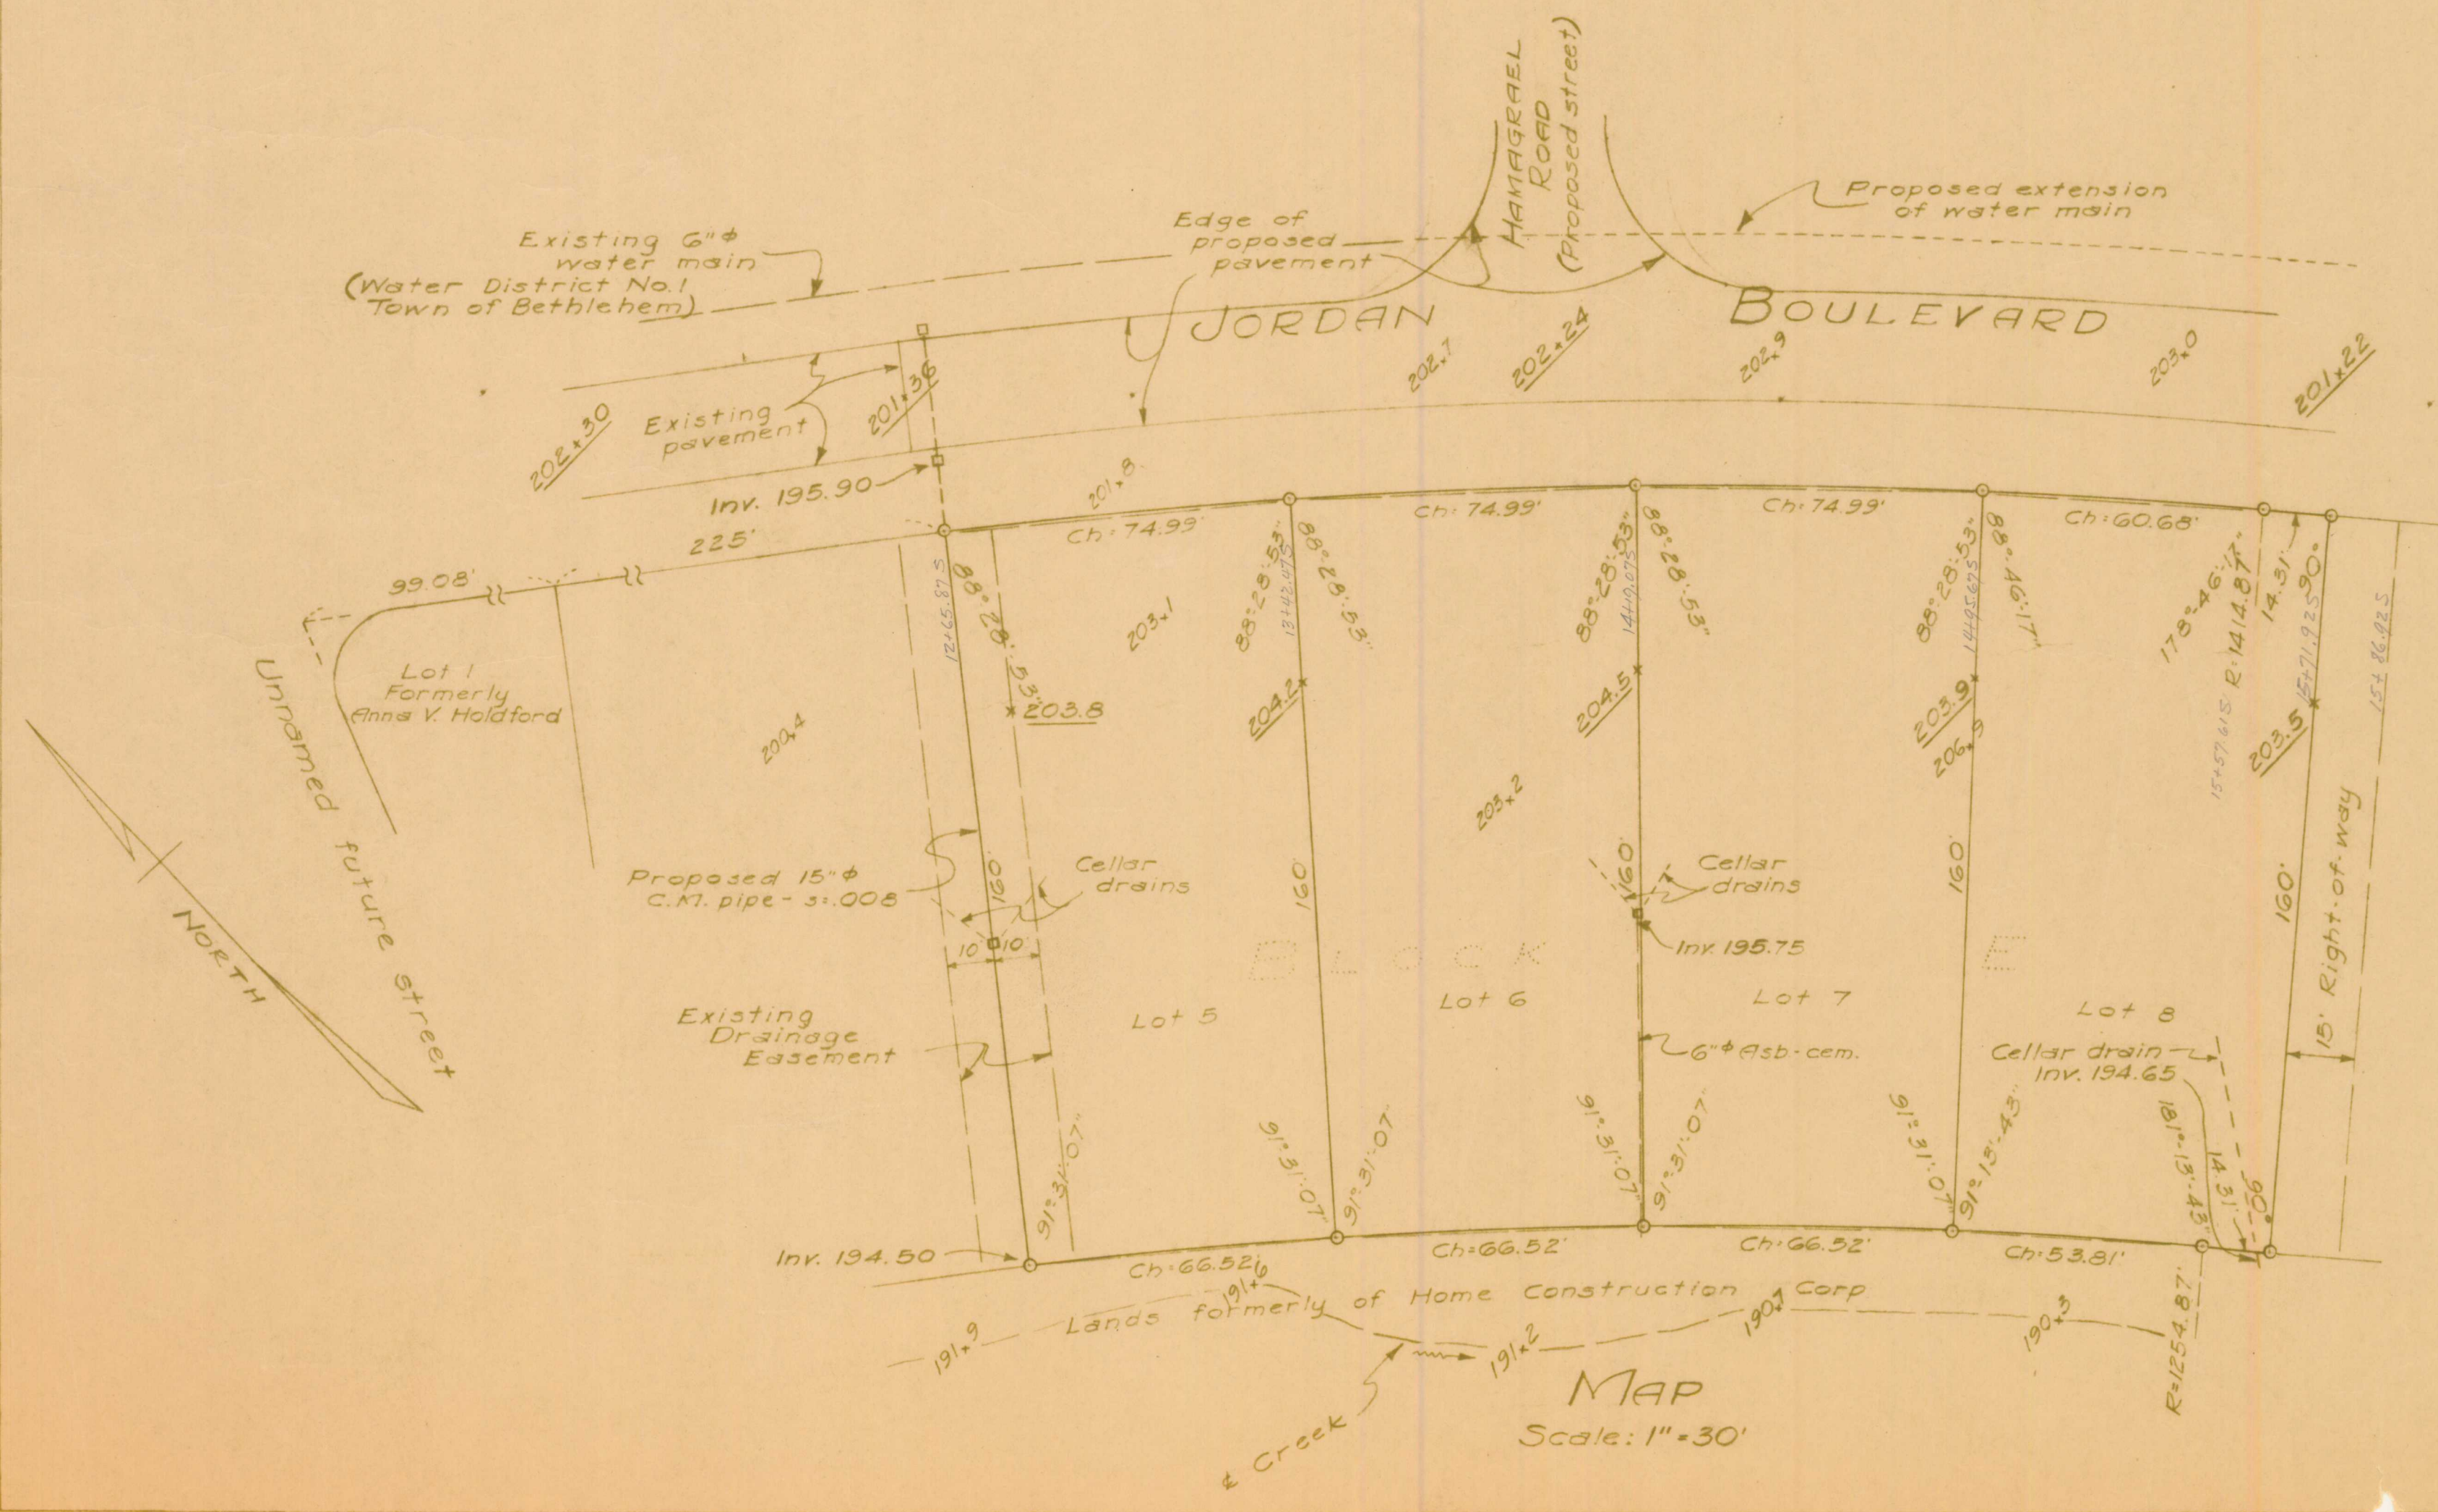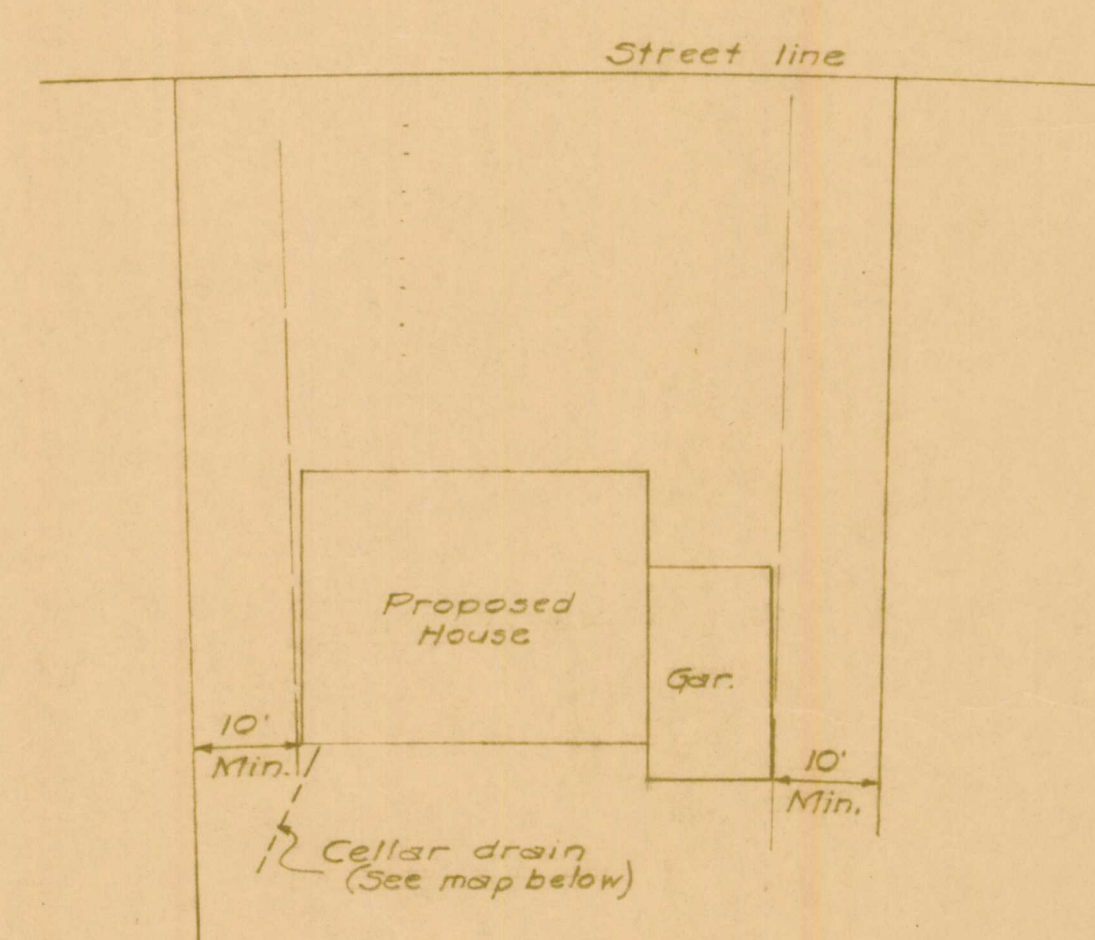

MAP  
Scale: 1" = 30'

Survey and Map by:  
Edward W. Boutelle & Son  
Civil Engineers & Surveyors  
Delmar, N.Y.  
N.Y. State License