

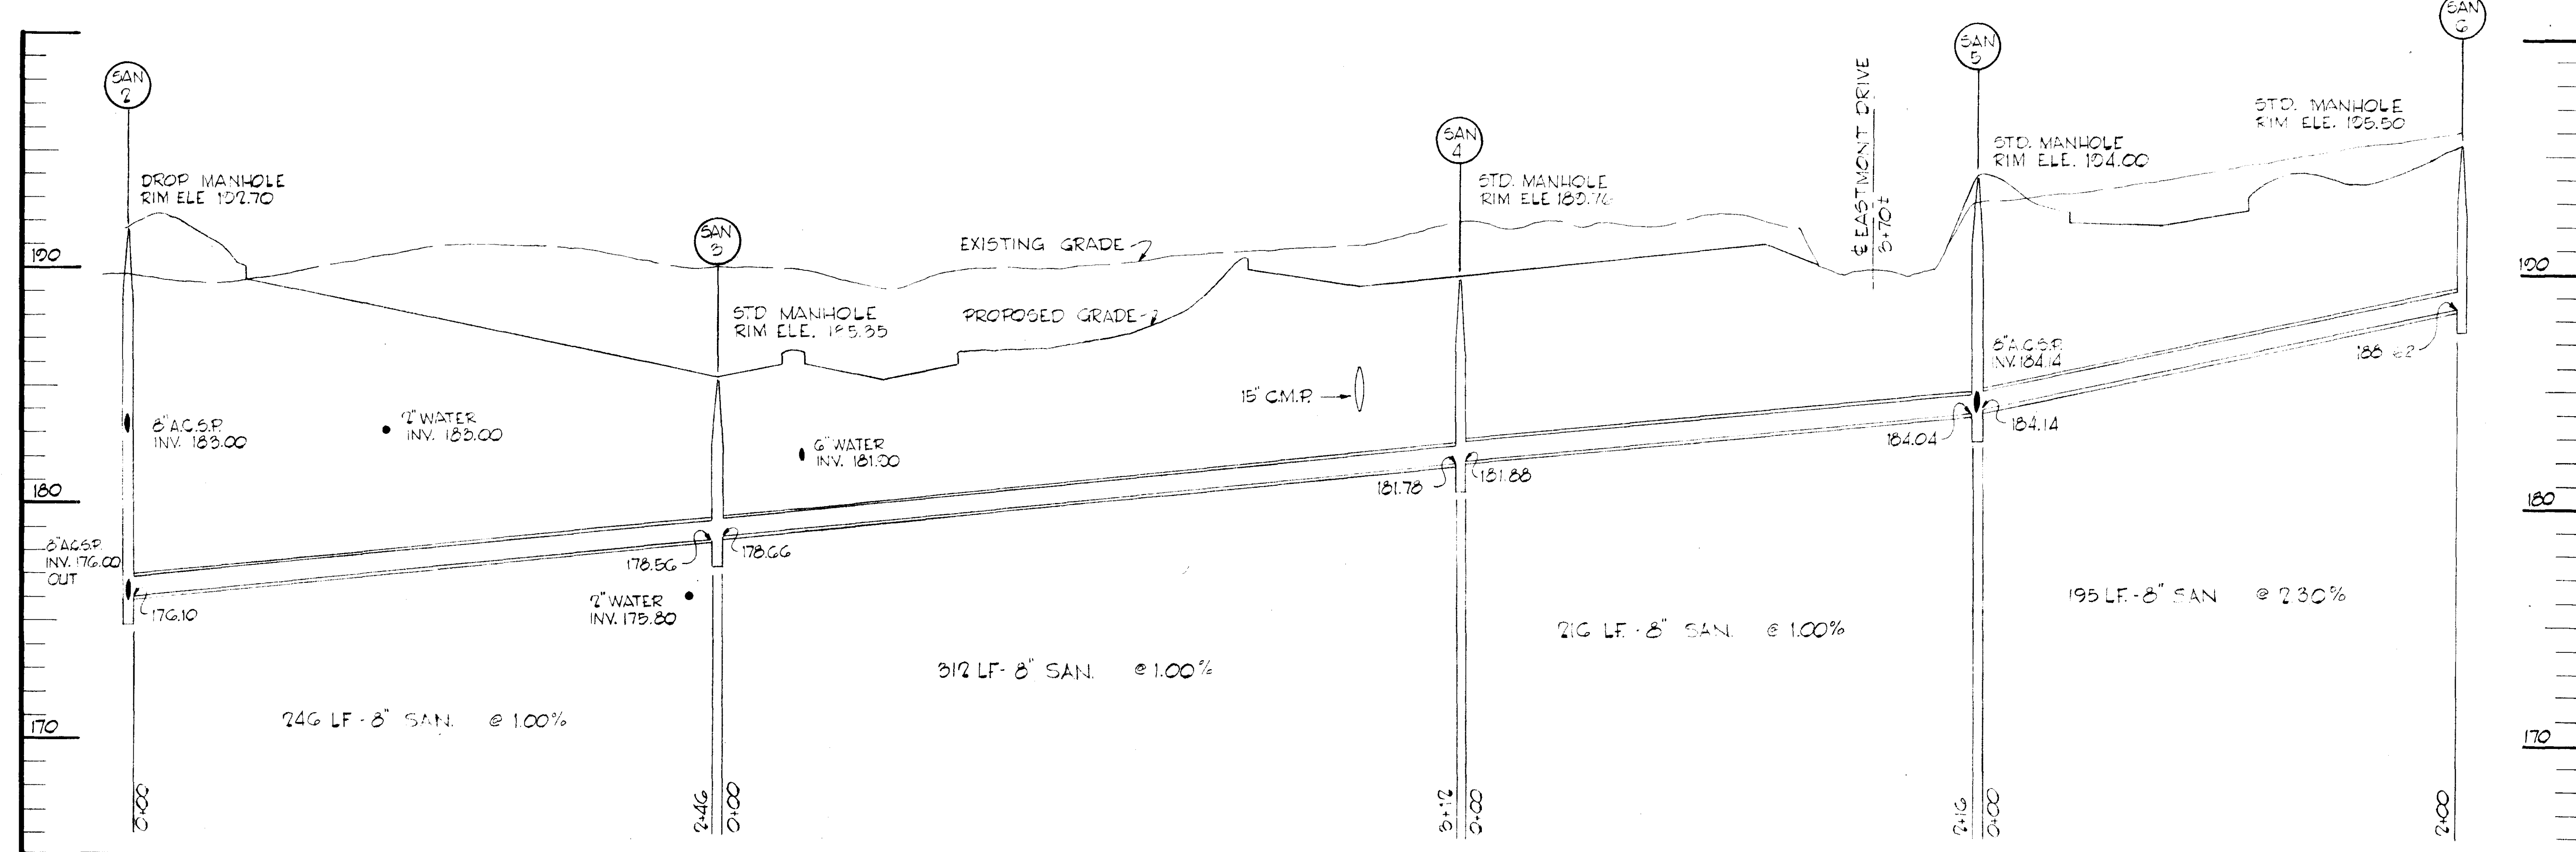
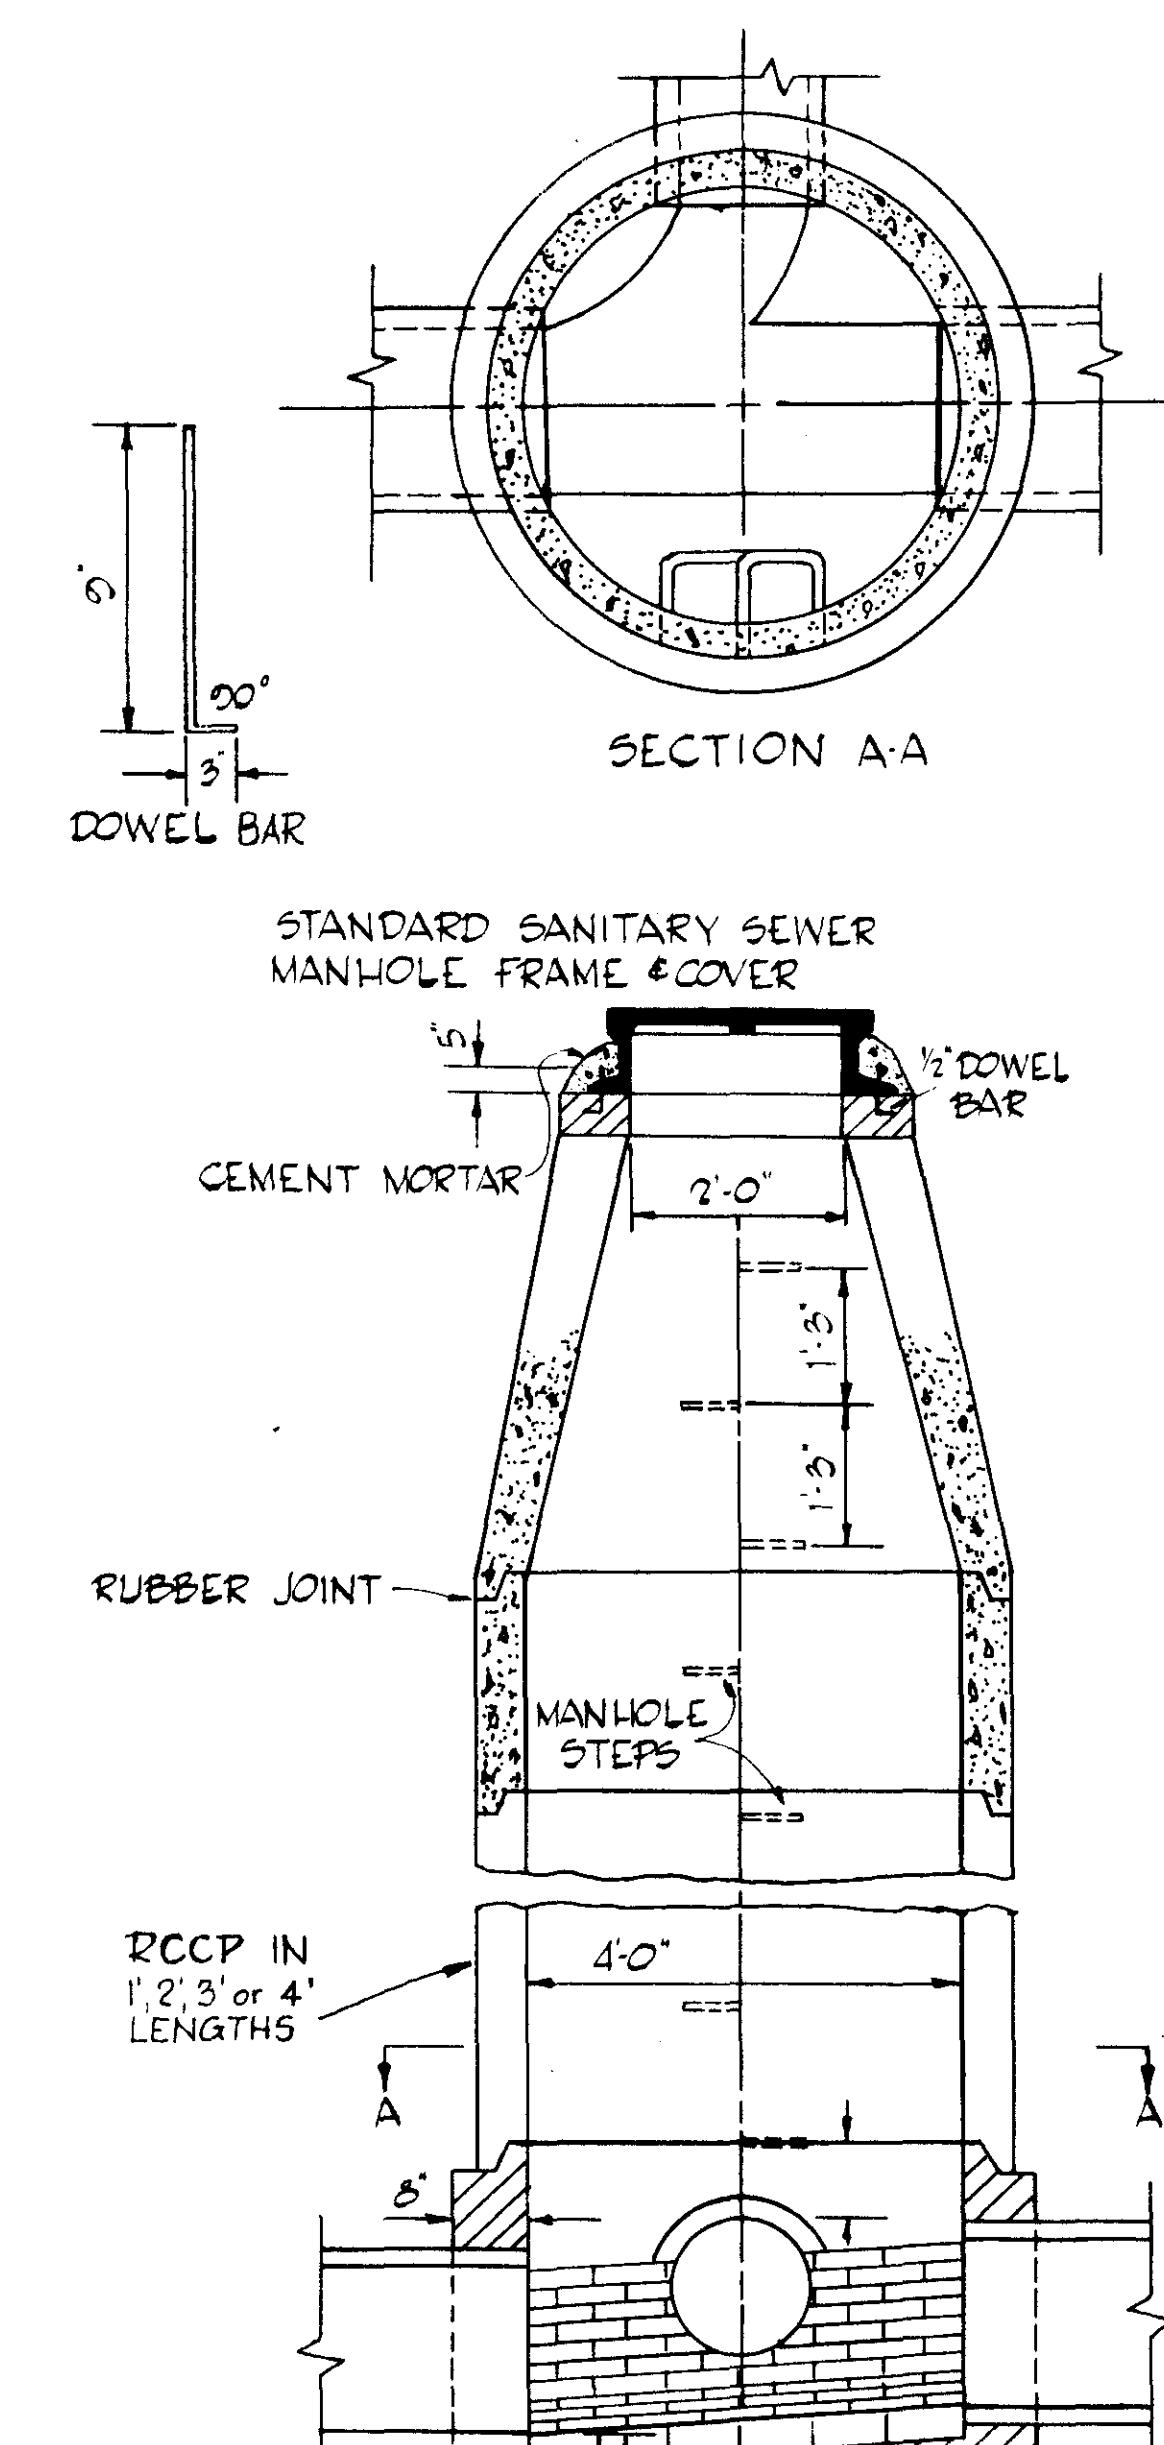
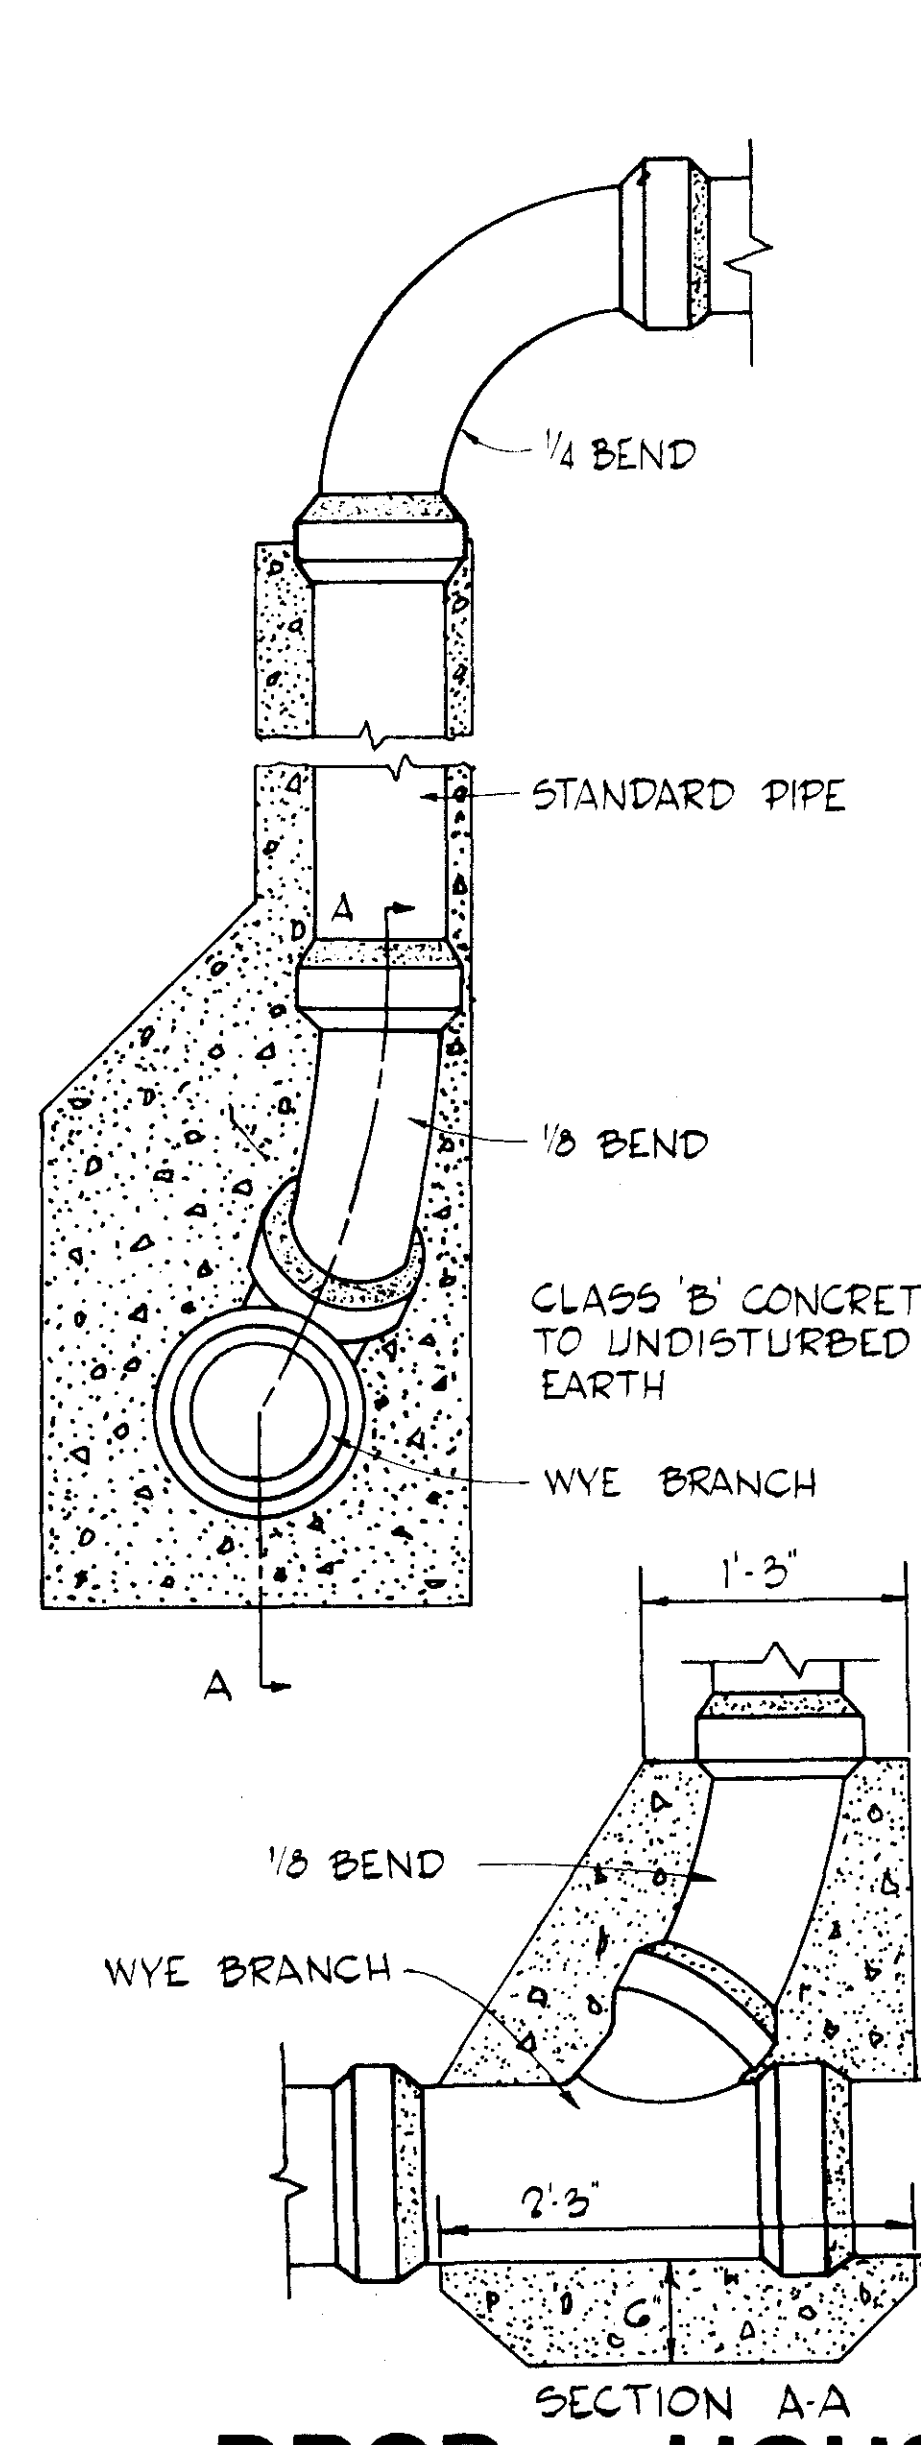
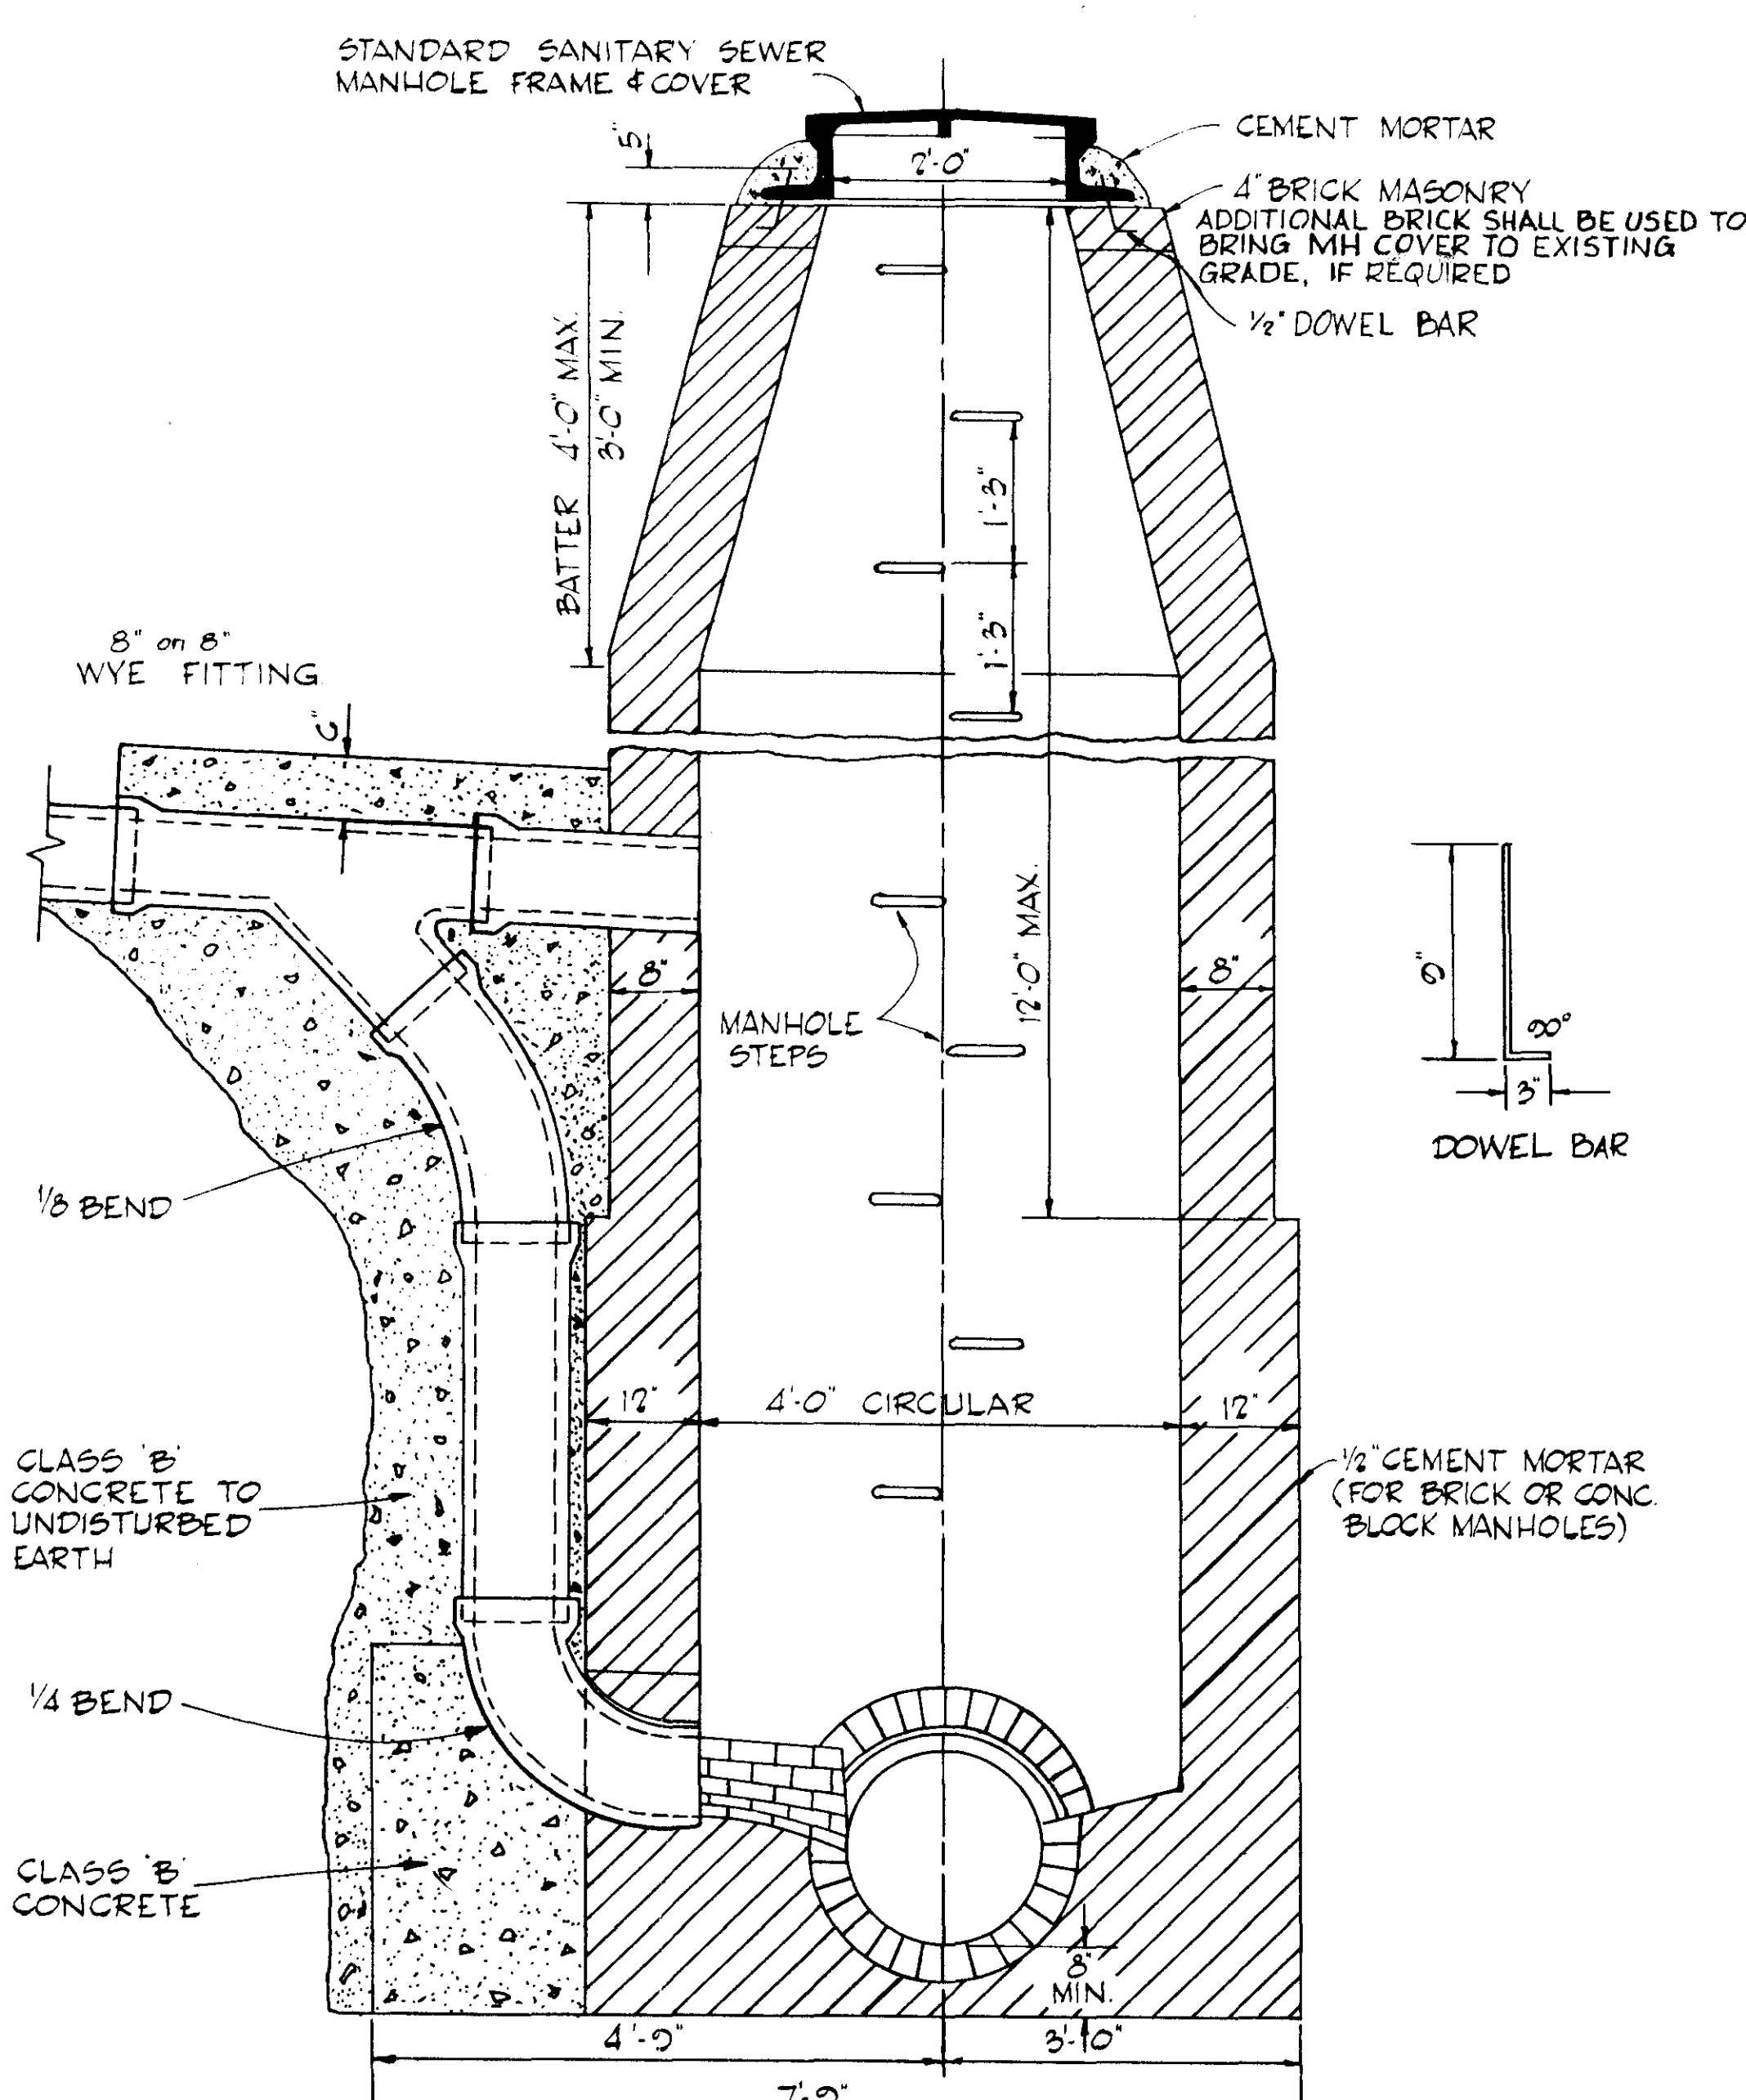
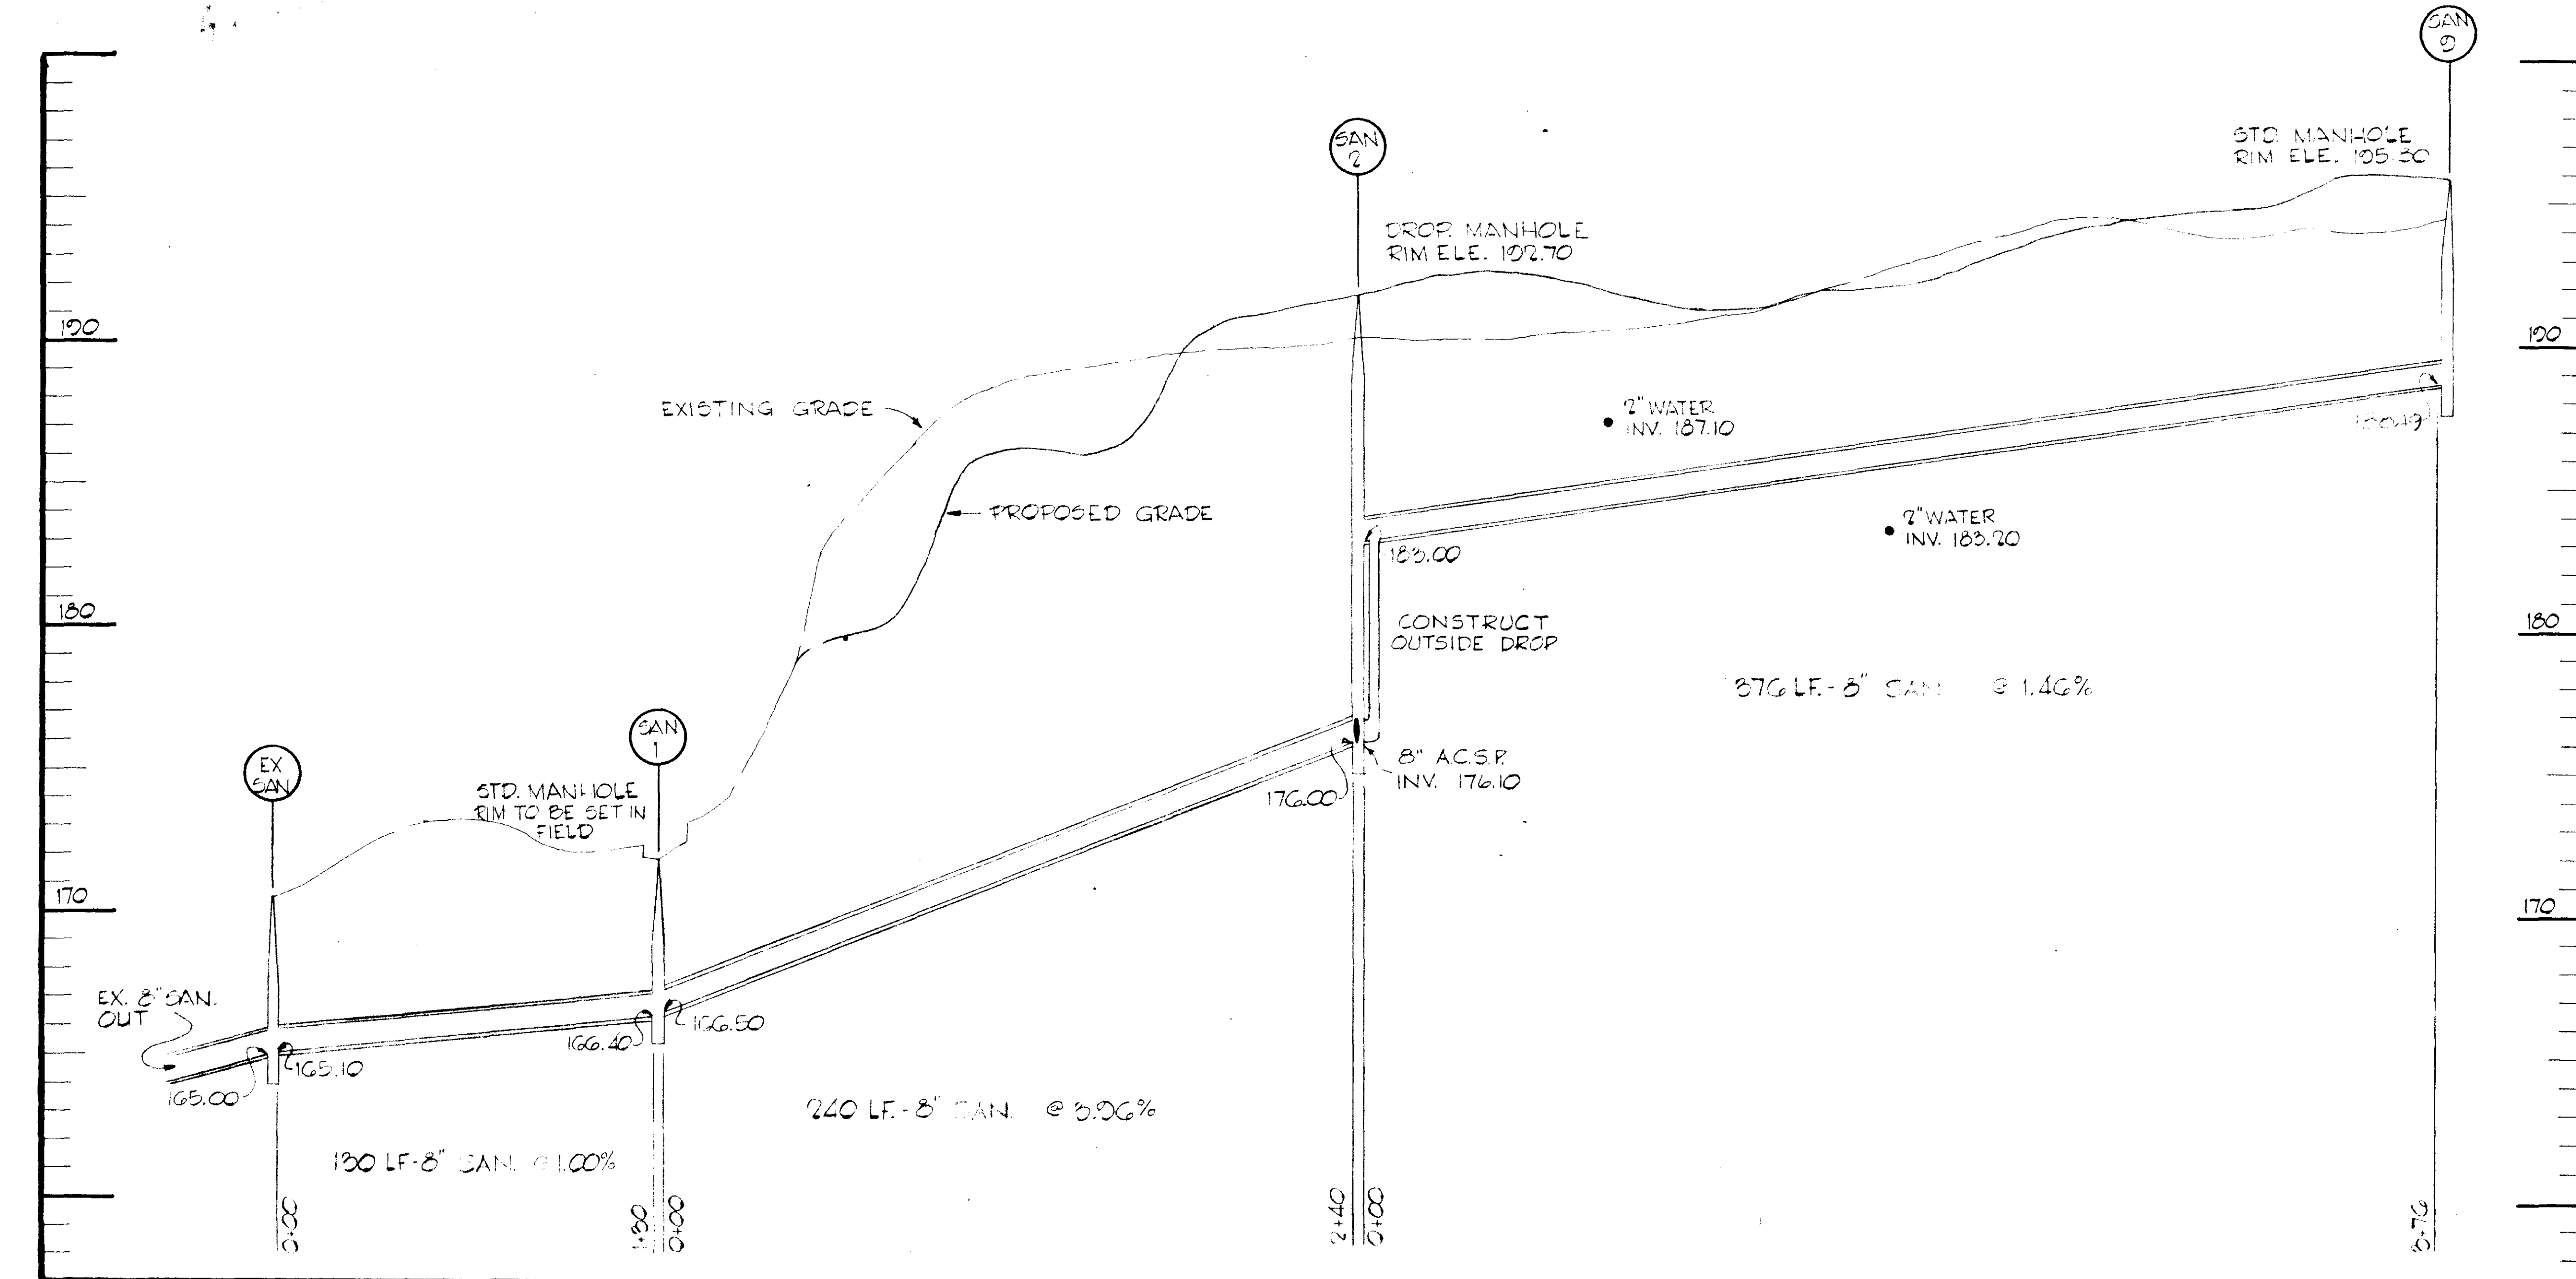
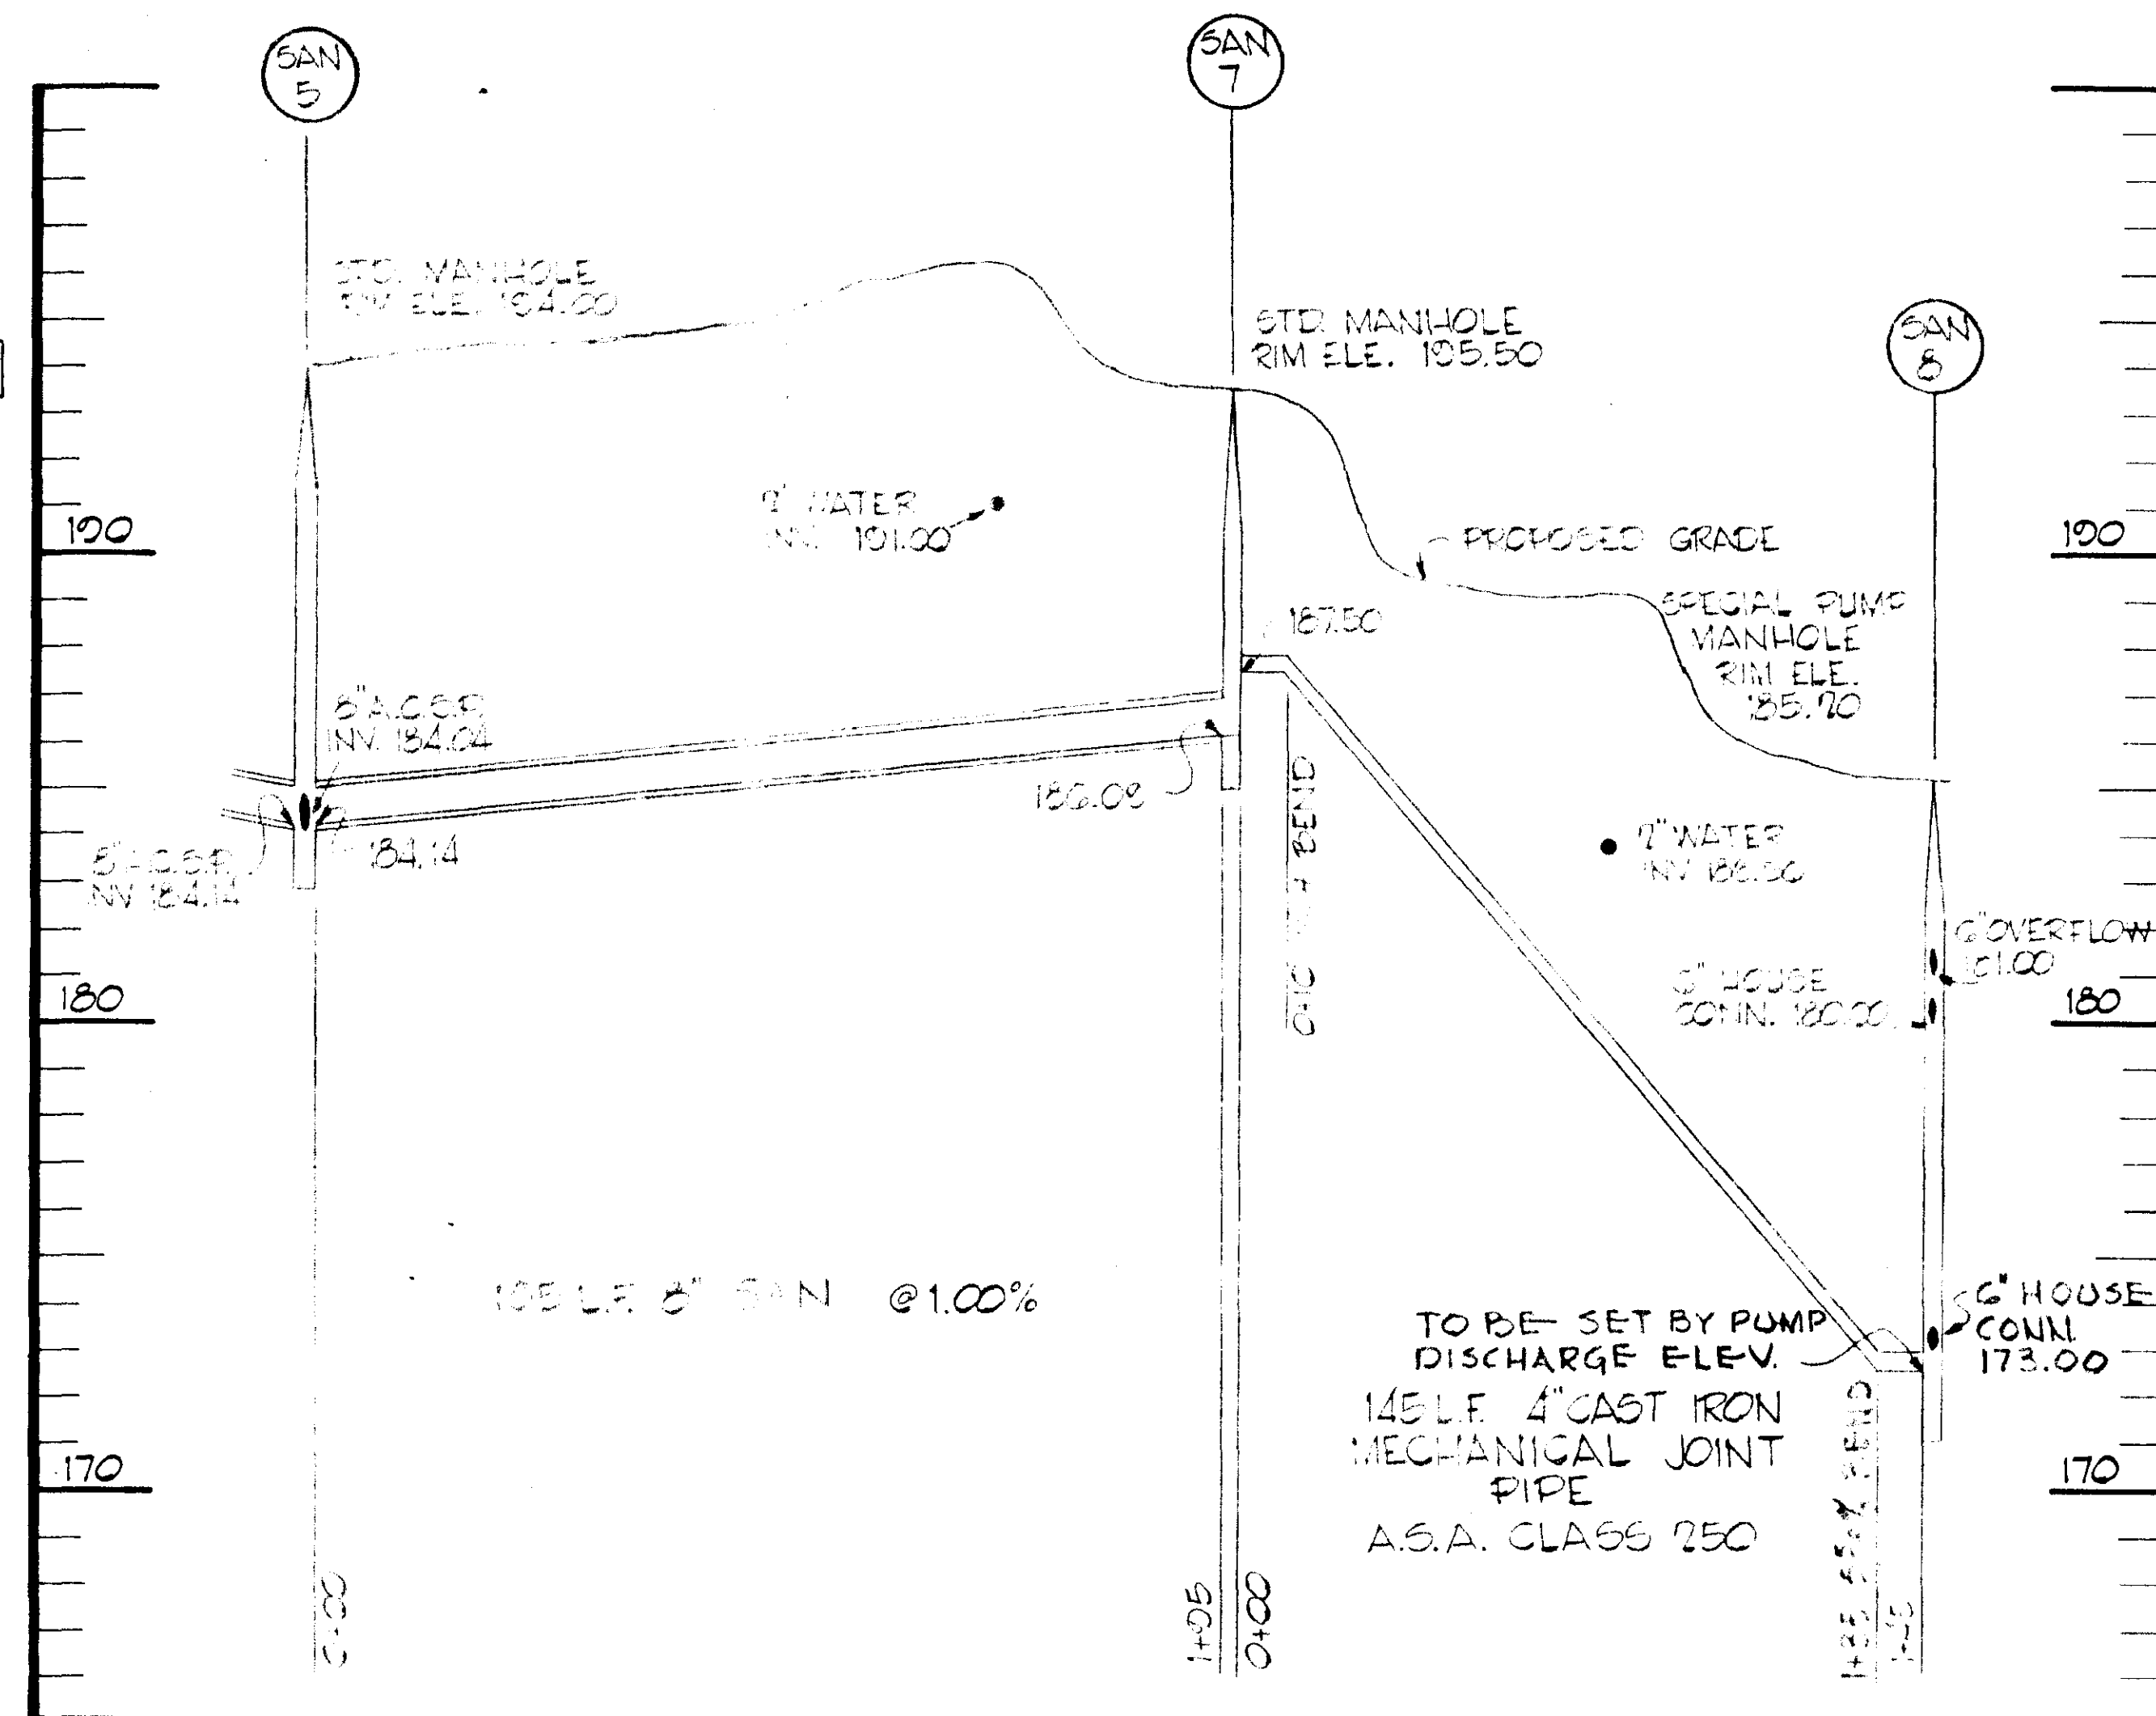


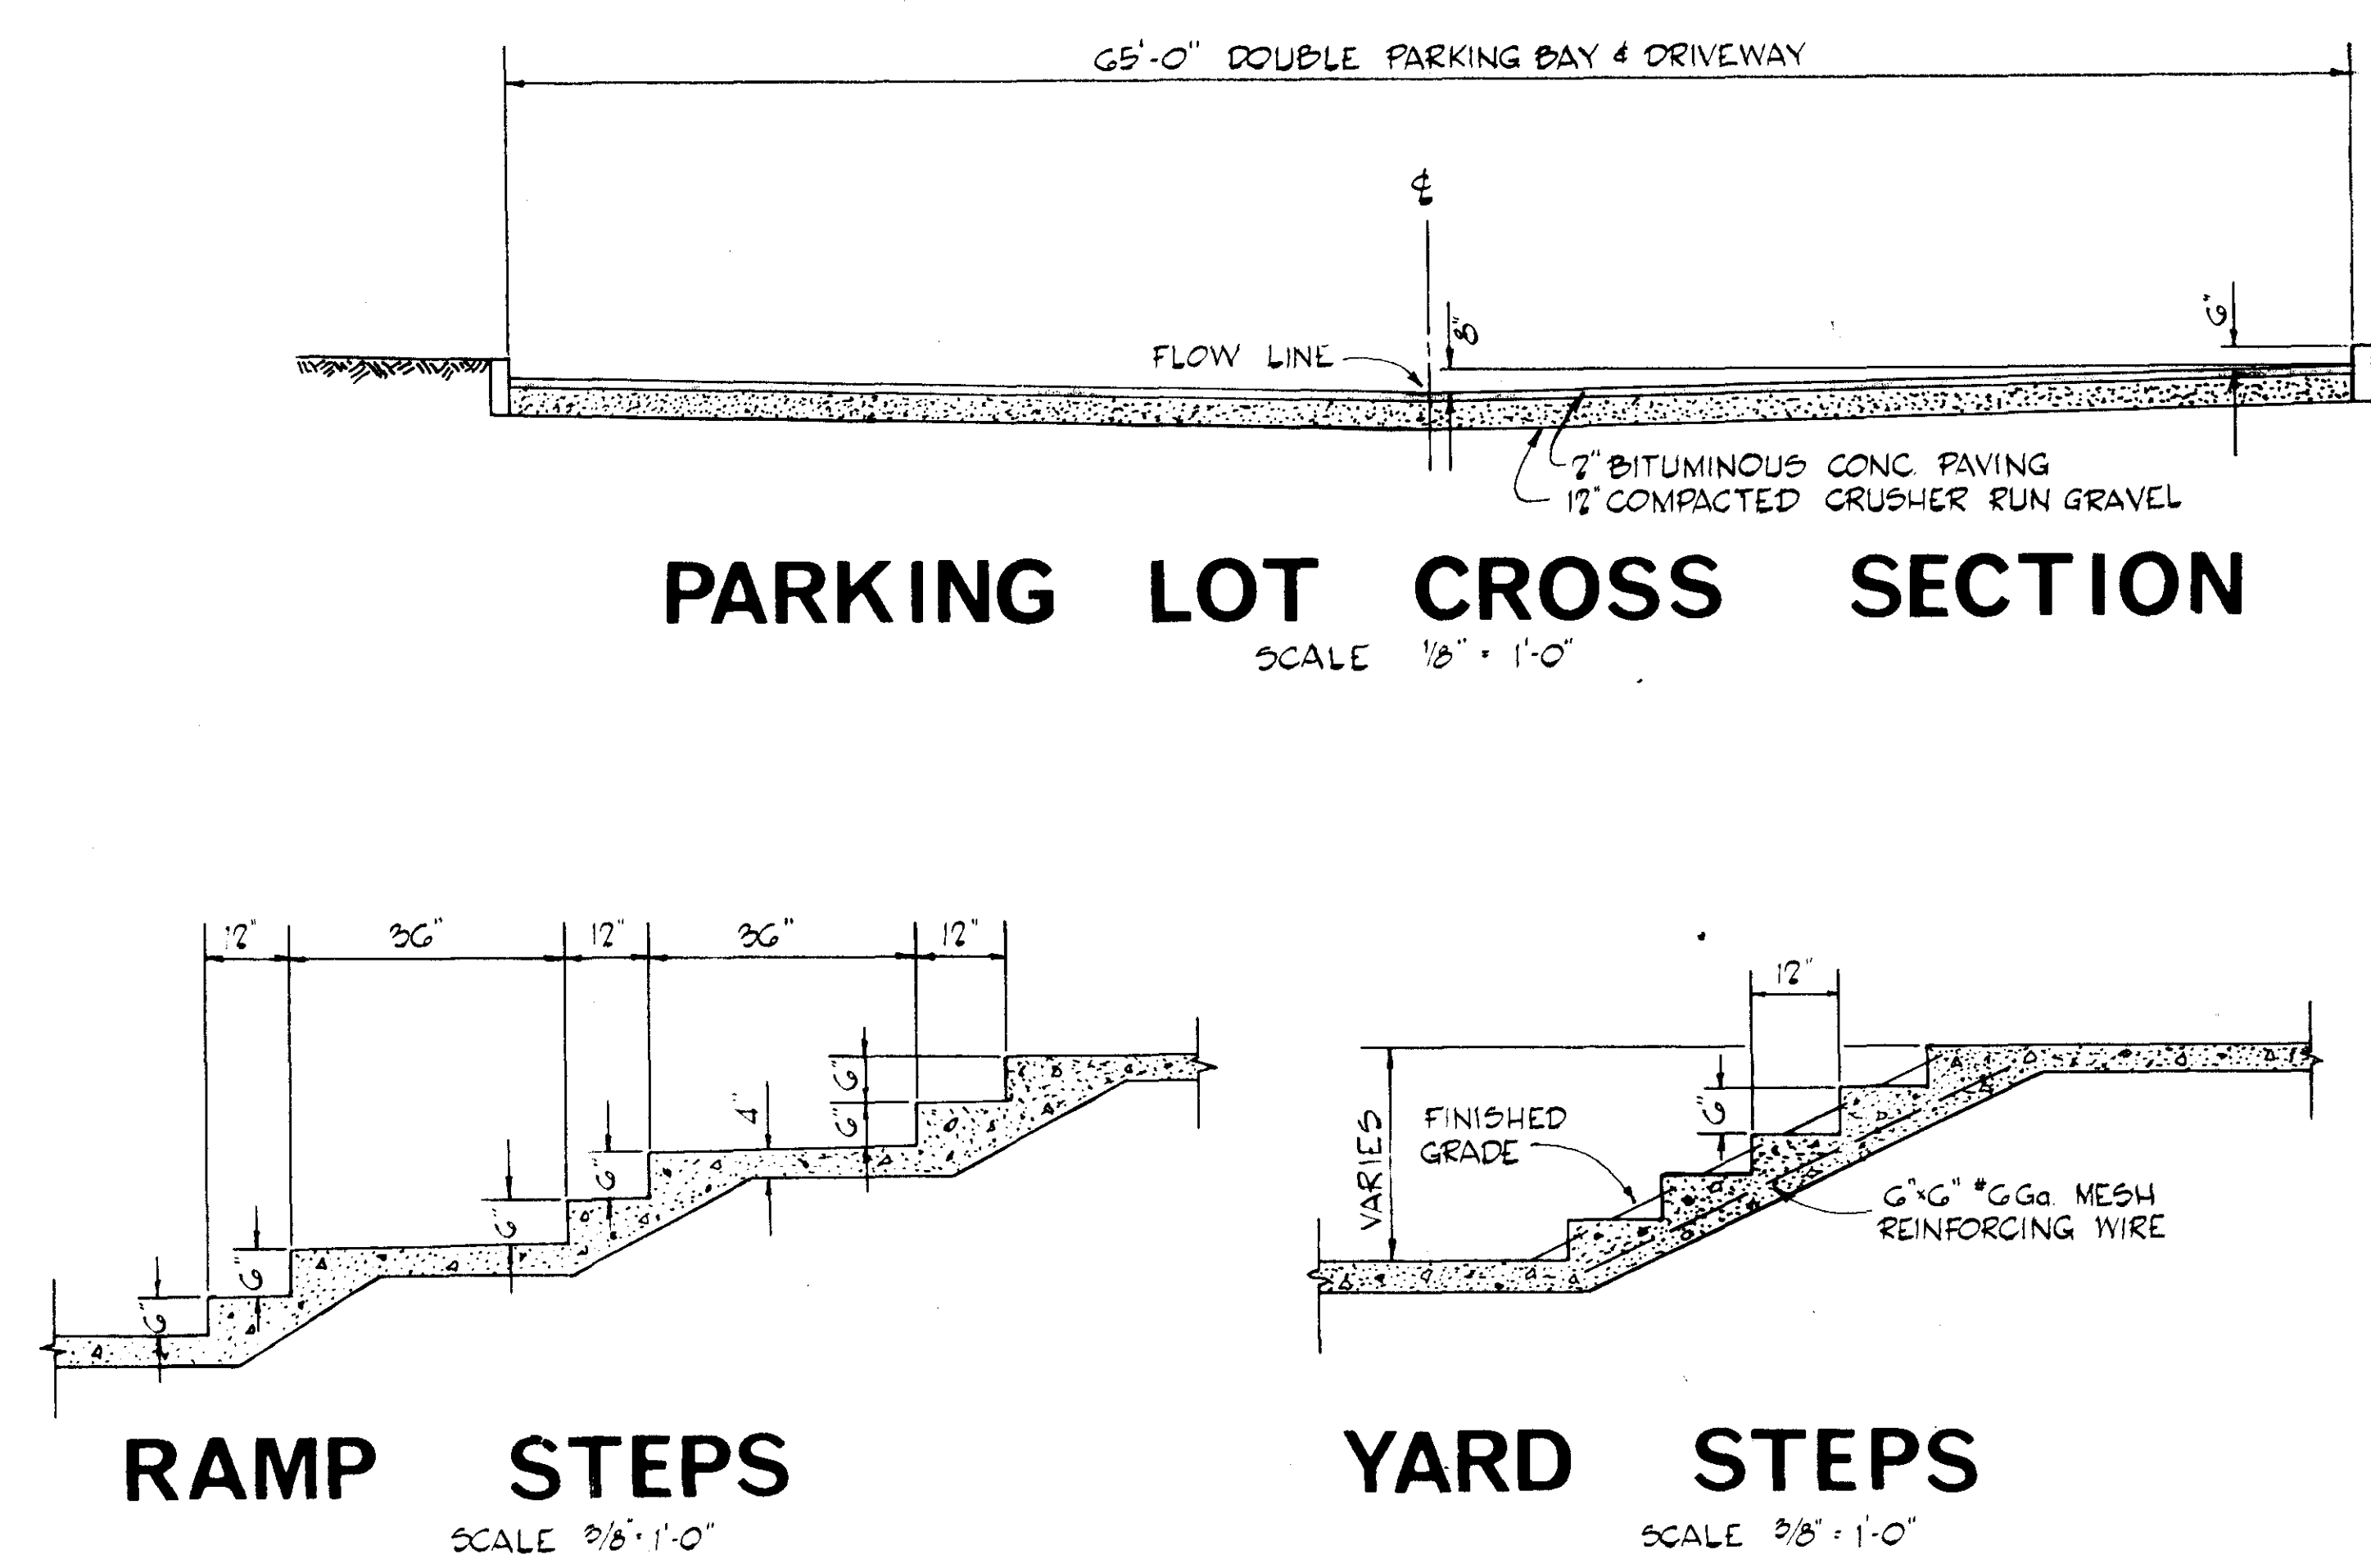





SANITARY SEWER PROFILES

SCALE: VERT. 1" = 1'-0"
HORIZ. 1" = 50'

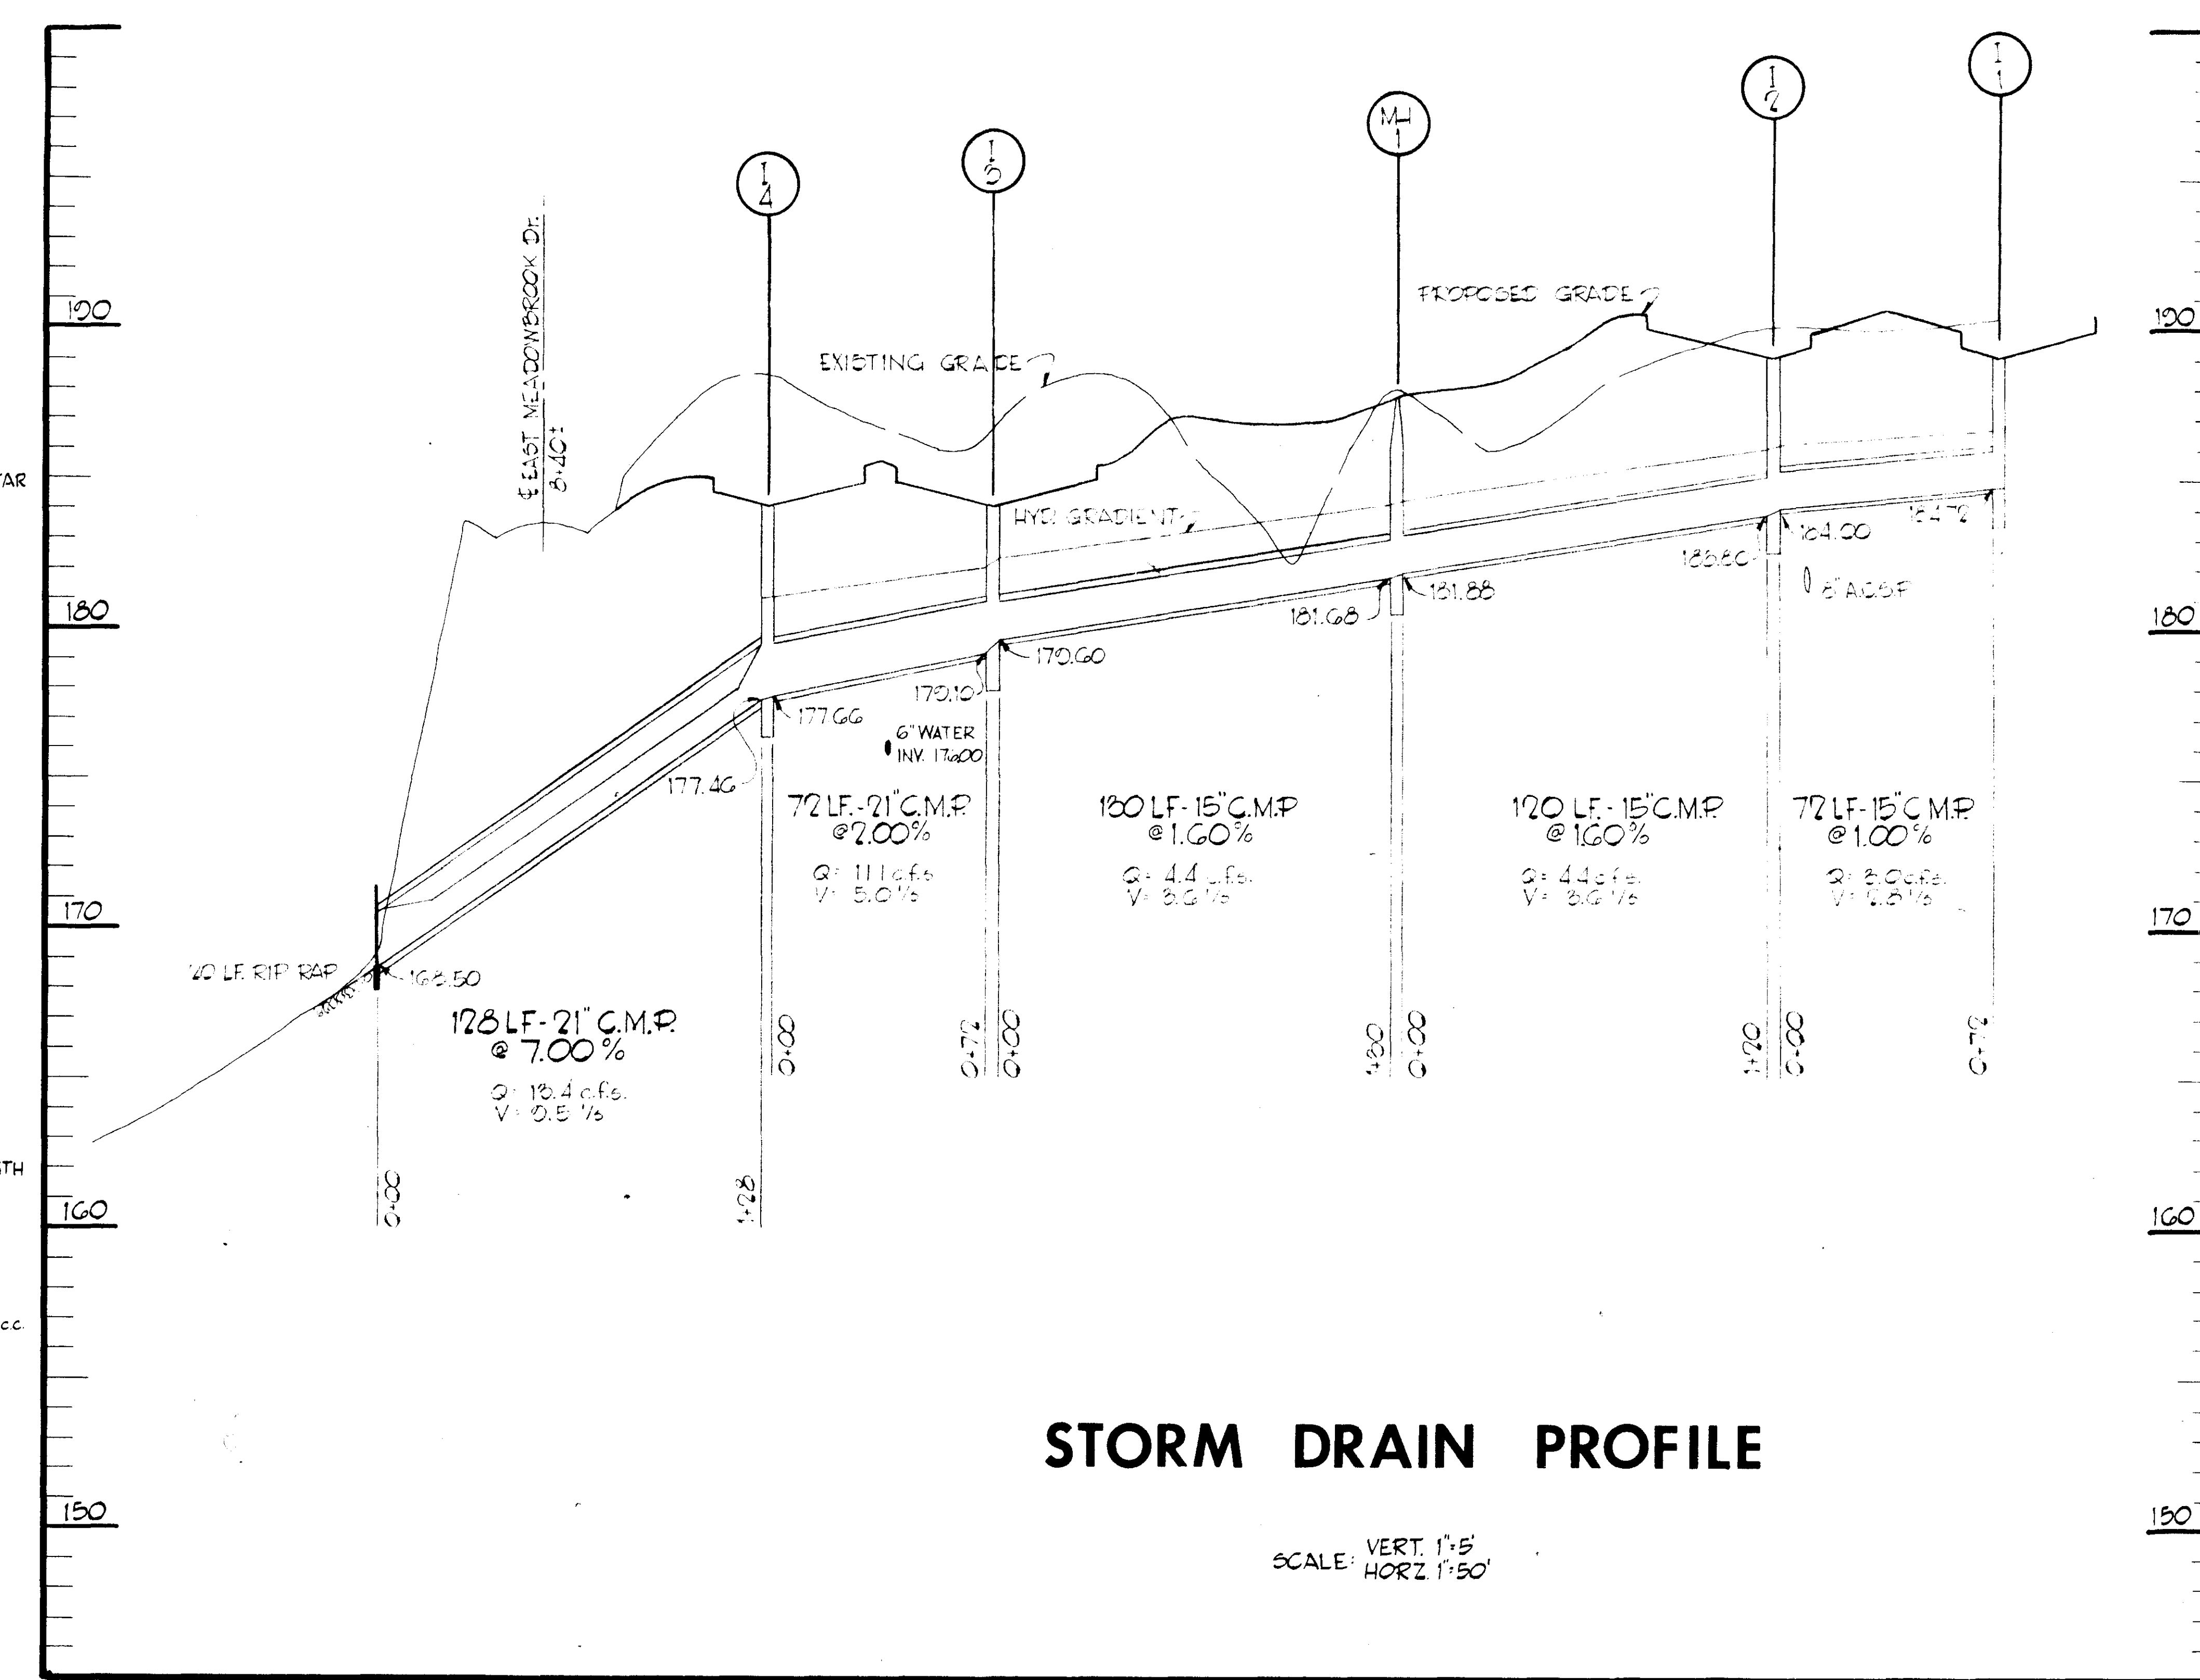

CONSTRUCTION NOTES

1. ALL MAIN LINE WATER PIPE IS TO BE CLASS 72 CAST IRON, AND HAVE A MINIMUM OF 4 1/2 FEET OF COVER.
 2. VALVES ARE TO BE ANNA STANDARD WITH ADJUSTABLE CAST IRON VALVE BOXES.
 3. ALL BENDS, TEES AND FITTINGS ARE TO BE BUTTRESSED AGAINST FIRM BEARING IN ACCORDANCE WITH LOCAL STANDARDS.
 4. CORPORATION COCKS OF PROPER SIZE ARE TO BE INSTALLED FOR EACH BUILDING CONNECTION.
- SANITARY SEWER**
1. ALL SANITARY SEWER IS TO BE ASPHALT CEMENT CLASS 7200 OR EXTRA STRENGTH CONCRETE SEWER PIPE, UNLESS OTHERWISE SPECIFIED.
 2. ALL SANITARY SEWER MANHOLES ARE TO BE LABELED SANITARY SEWER.
 3. ALL SANITARY SEWER HOUSE CONNECTIONS ARE TO BE EQUIPPED WITH A FITTING FOR CLEAN OUT.
- STORM SEWER**
1. ALL STORM SEWER PIPE IS TO BE 16 GA. ASPHALT COATED CORRUGATED METAL PIPE WITH A PAVED INVERT.

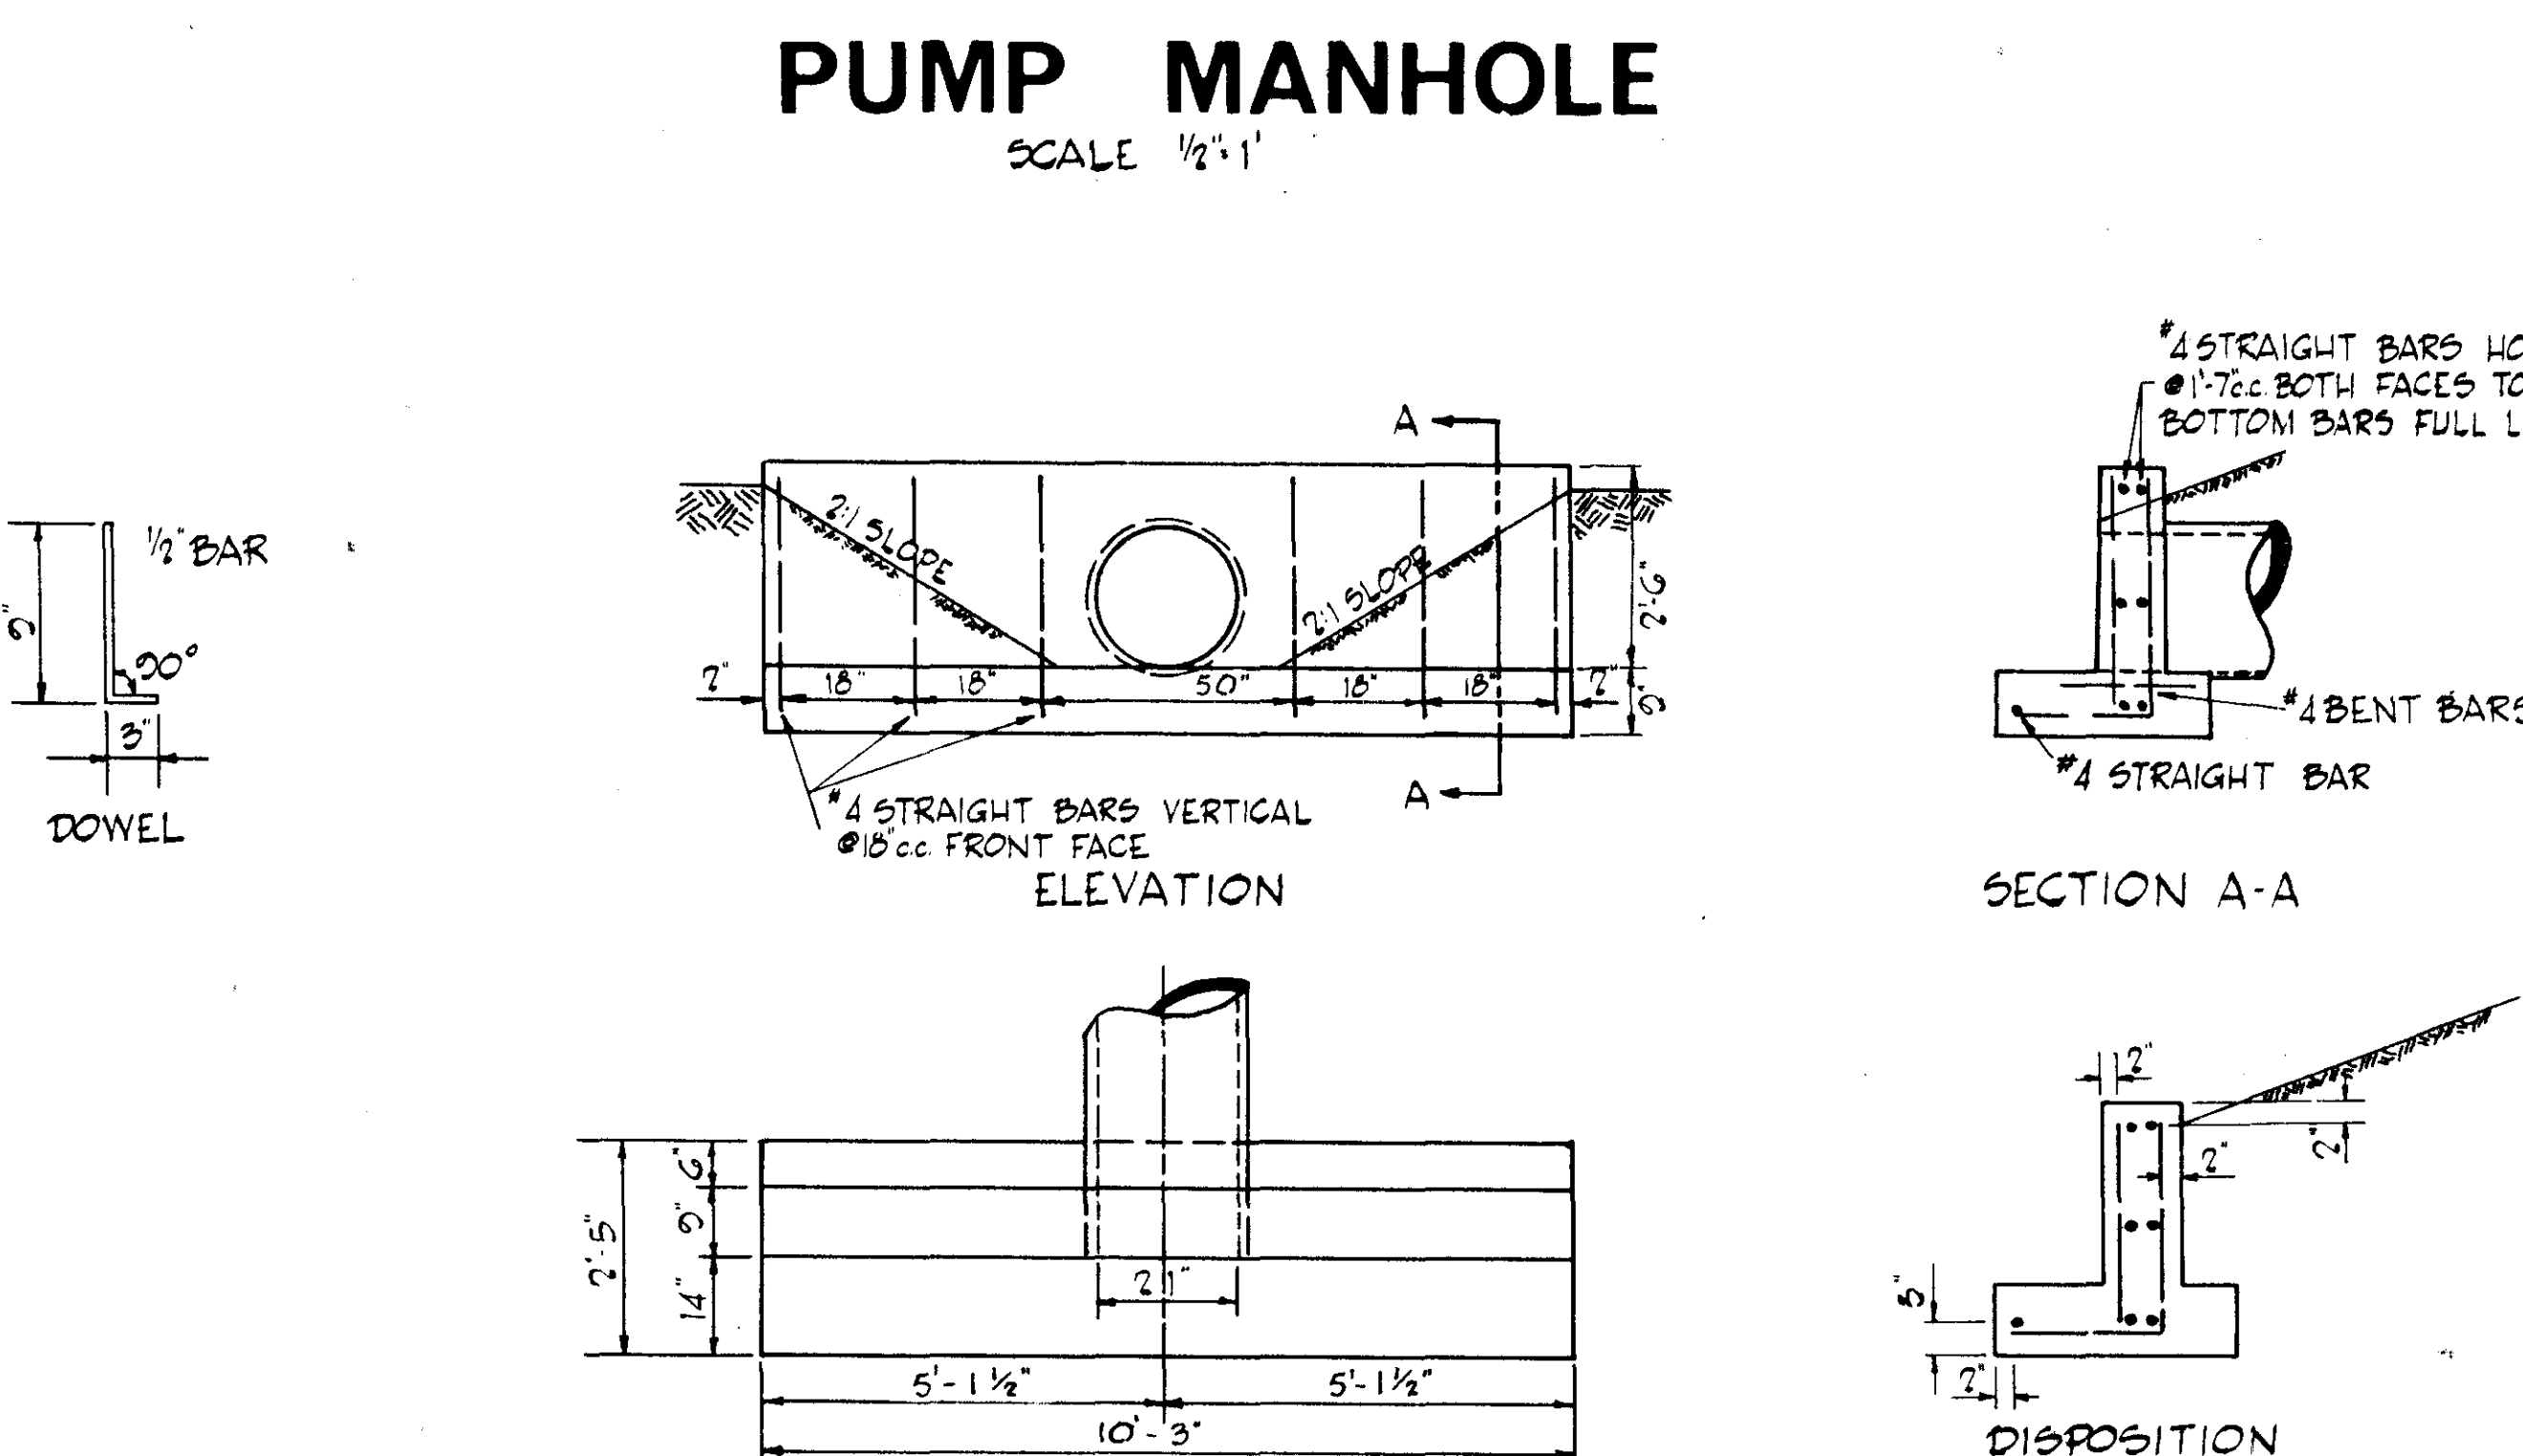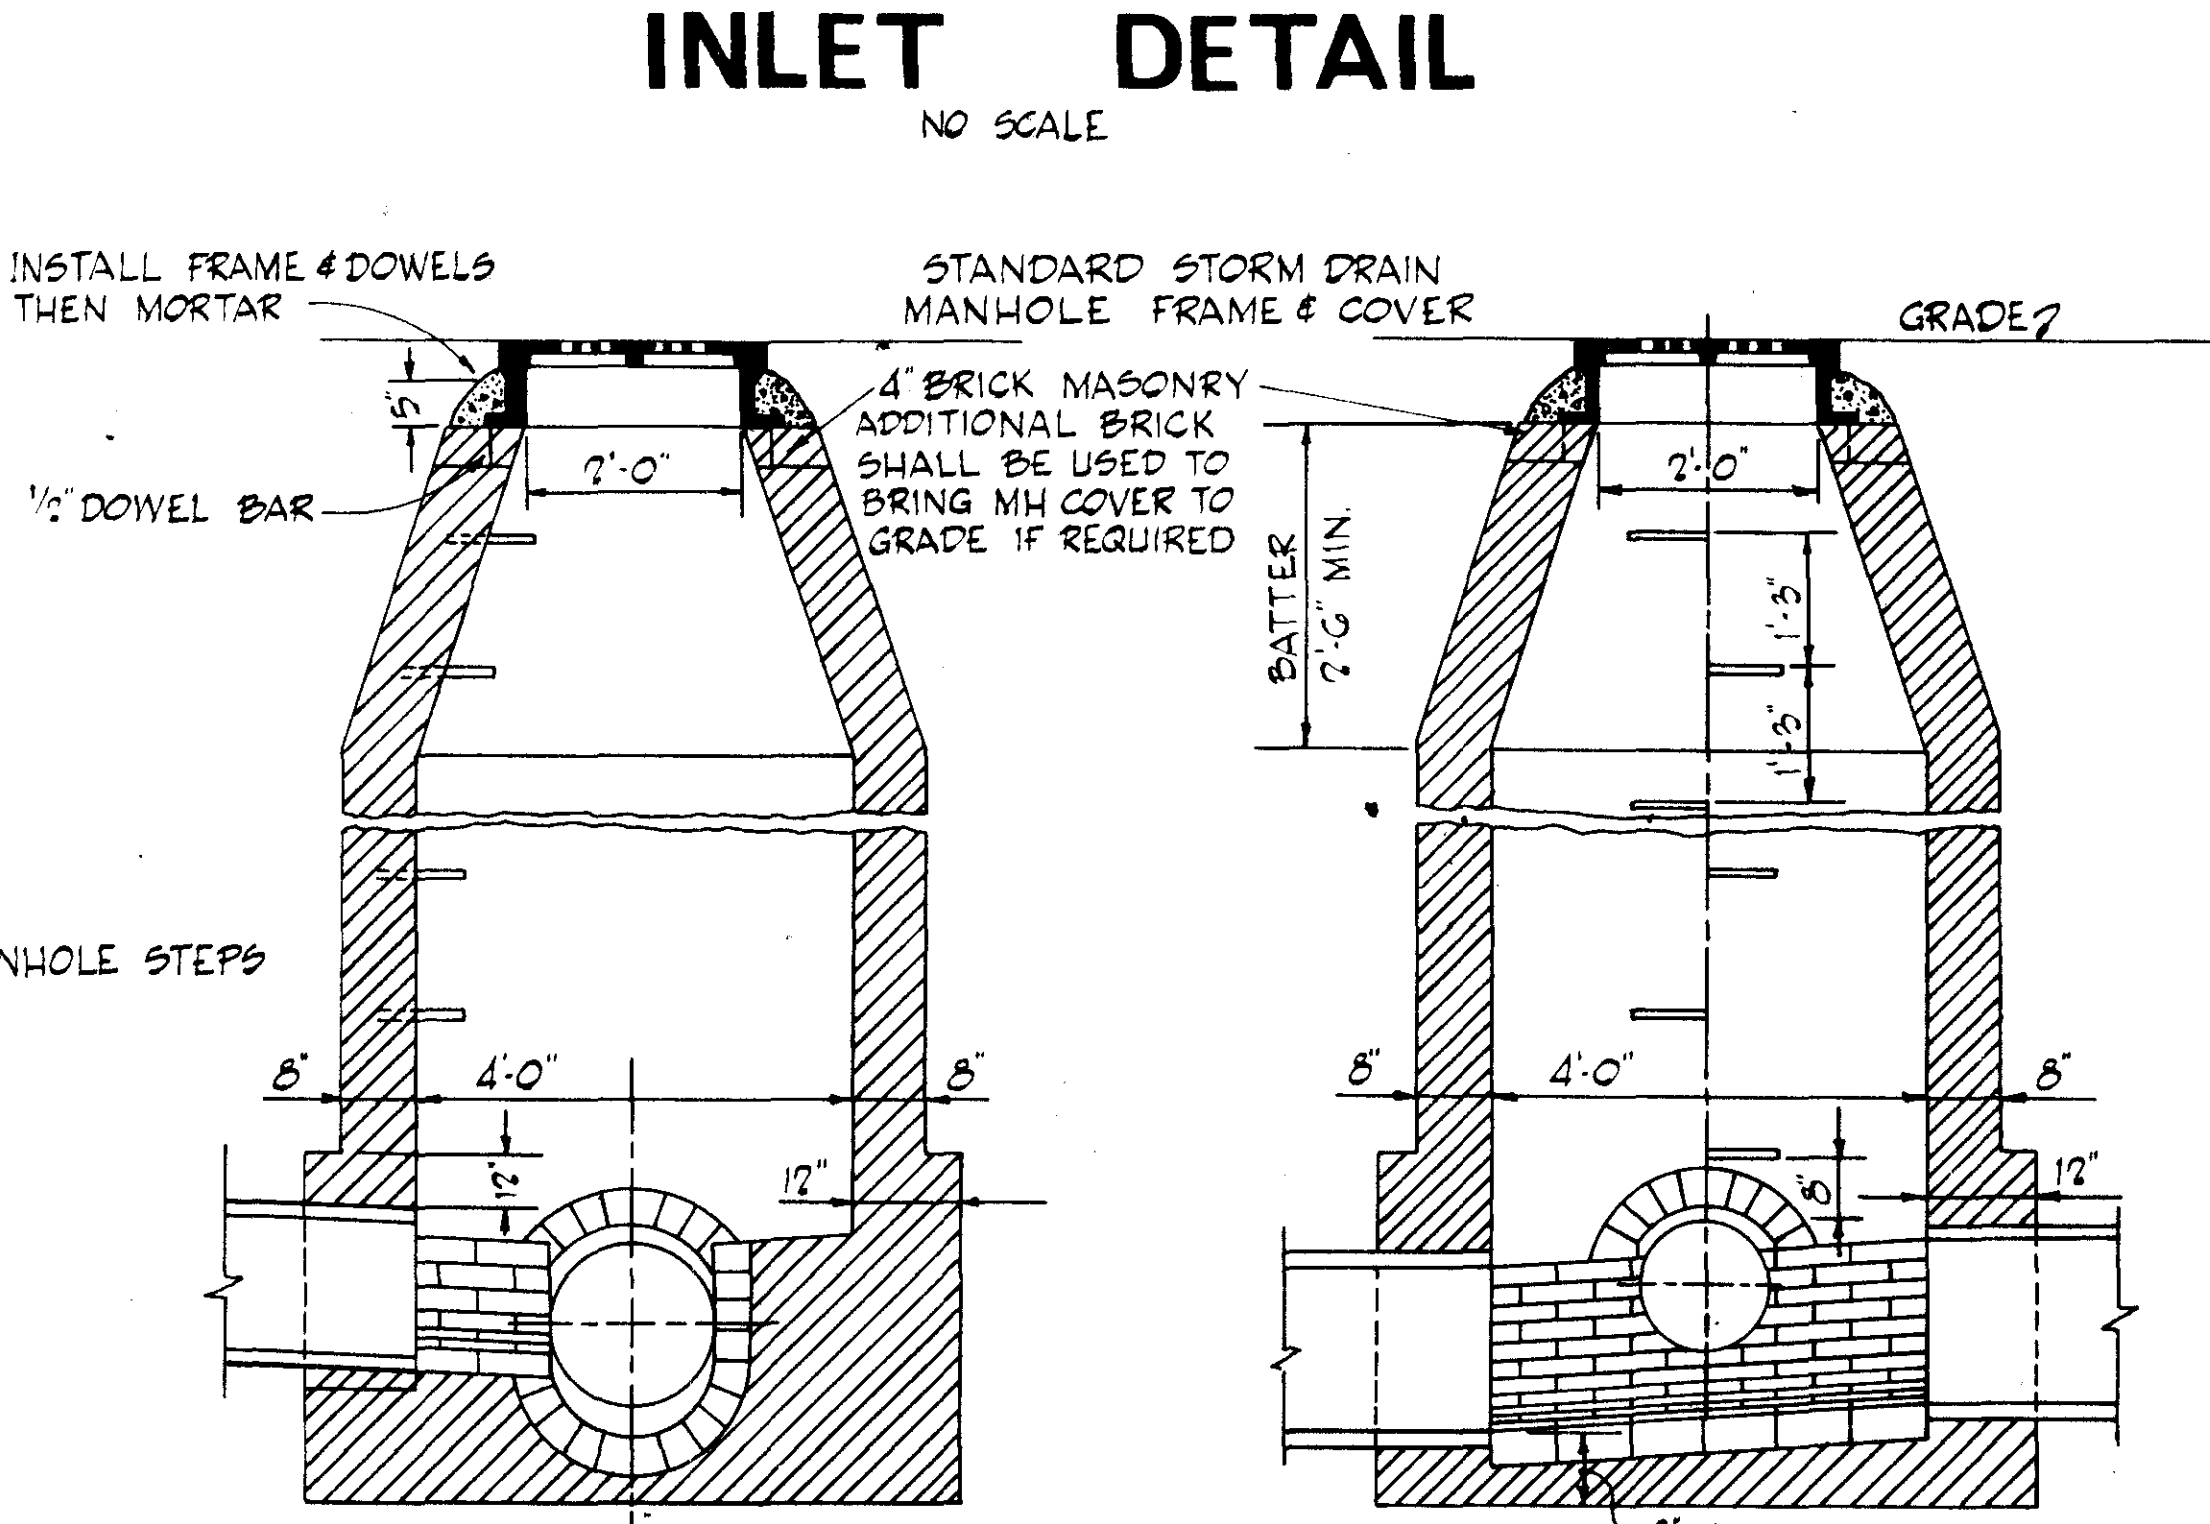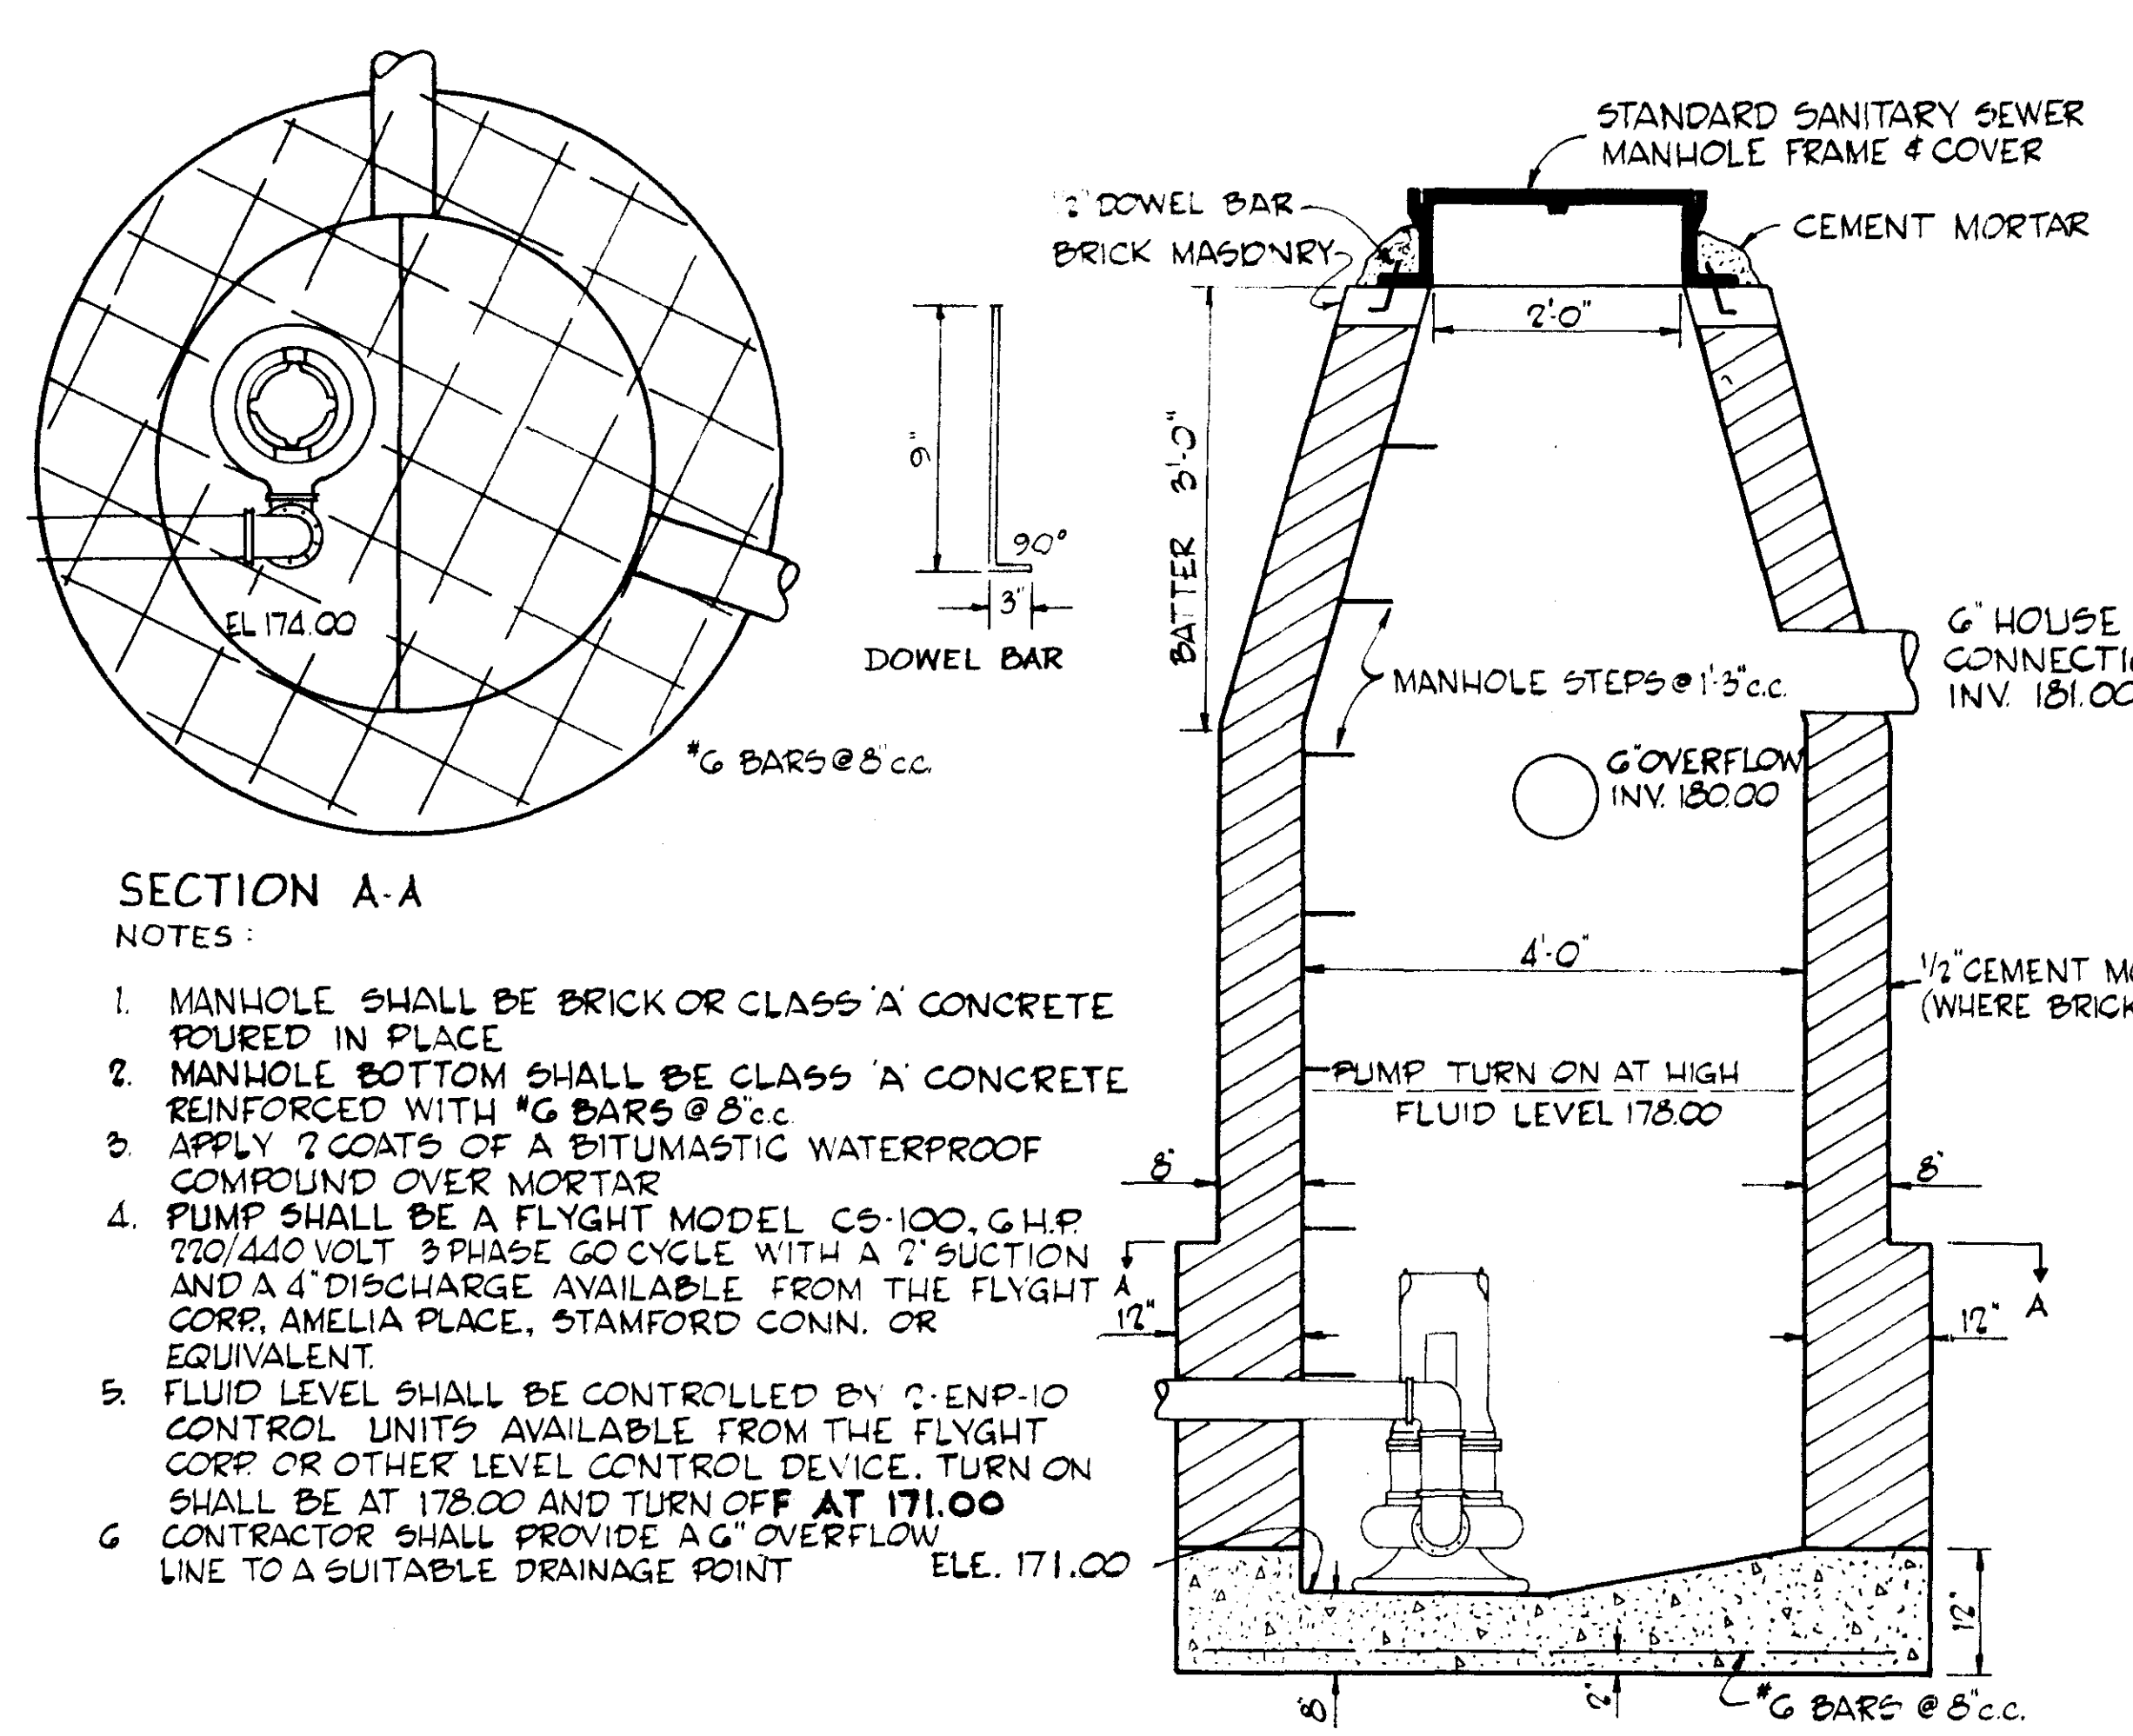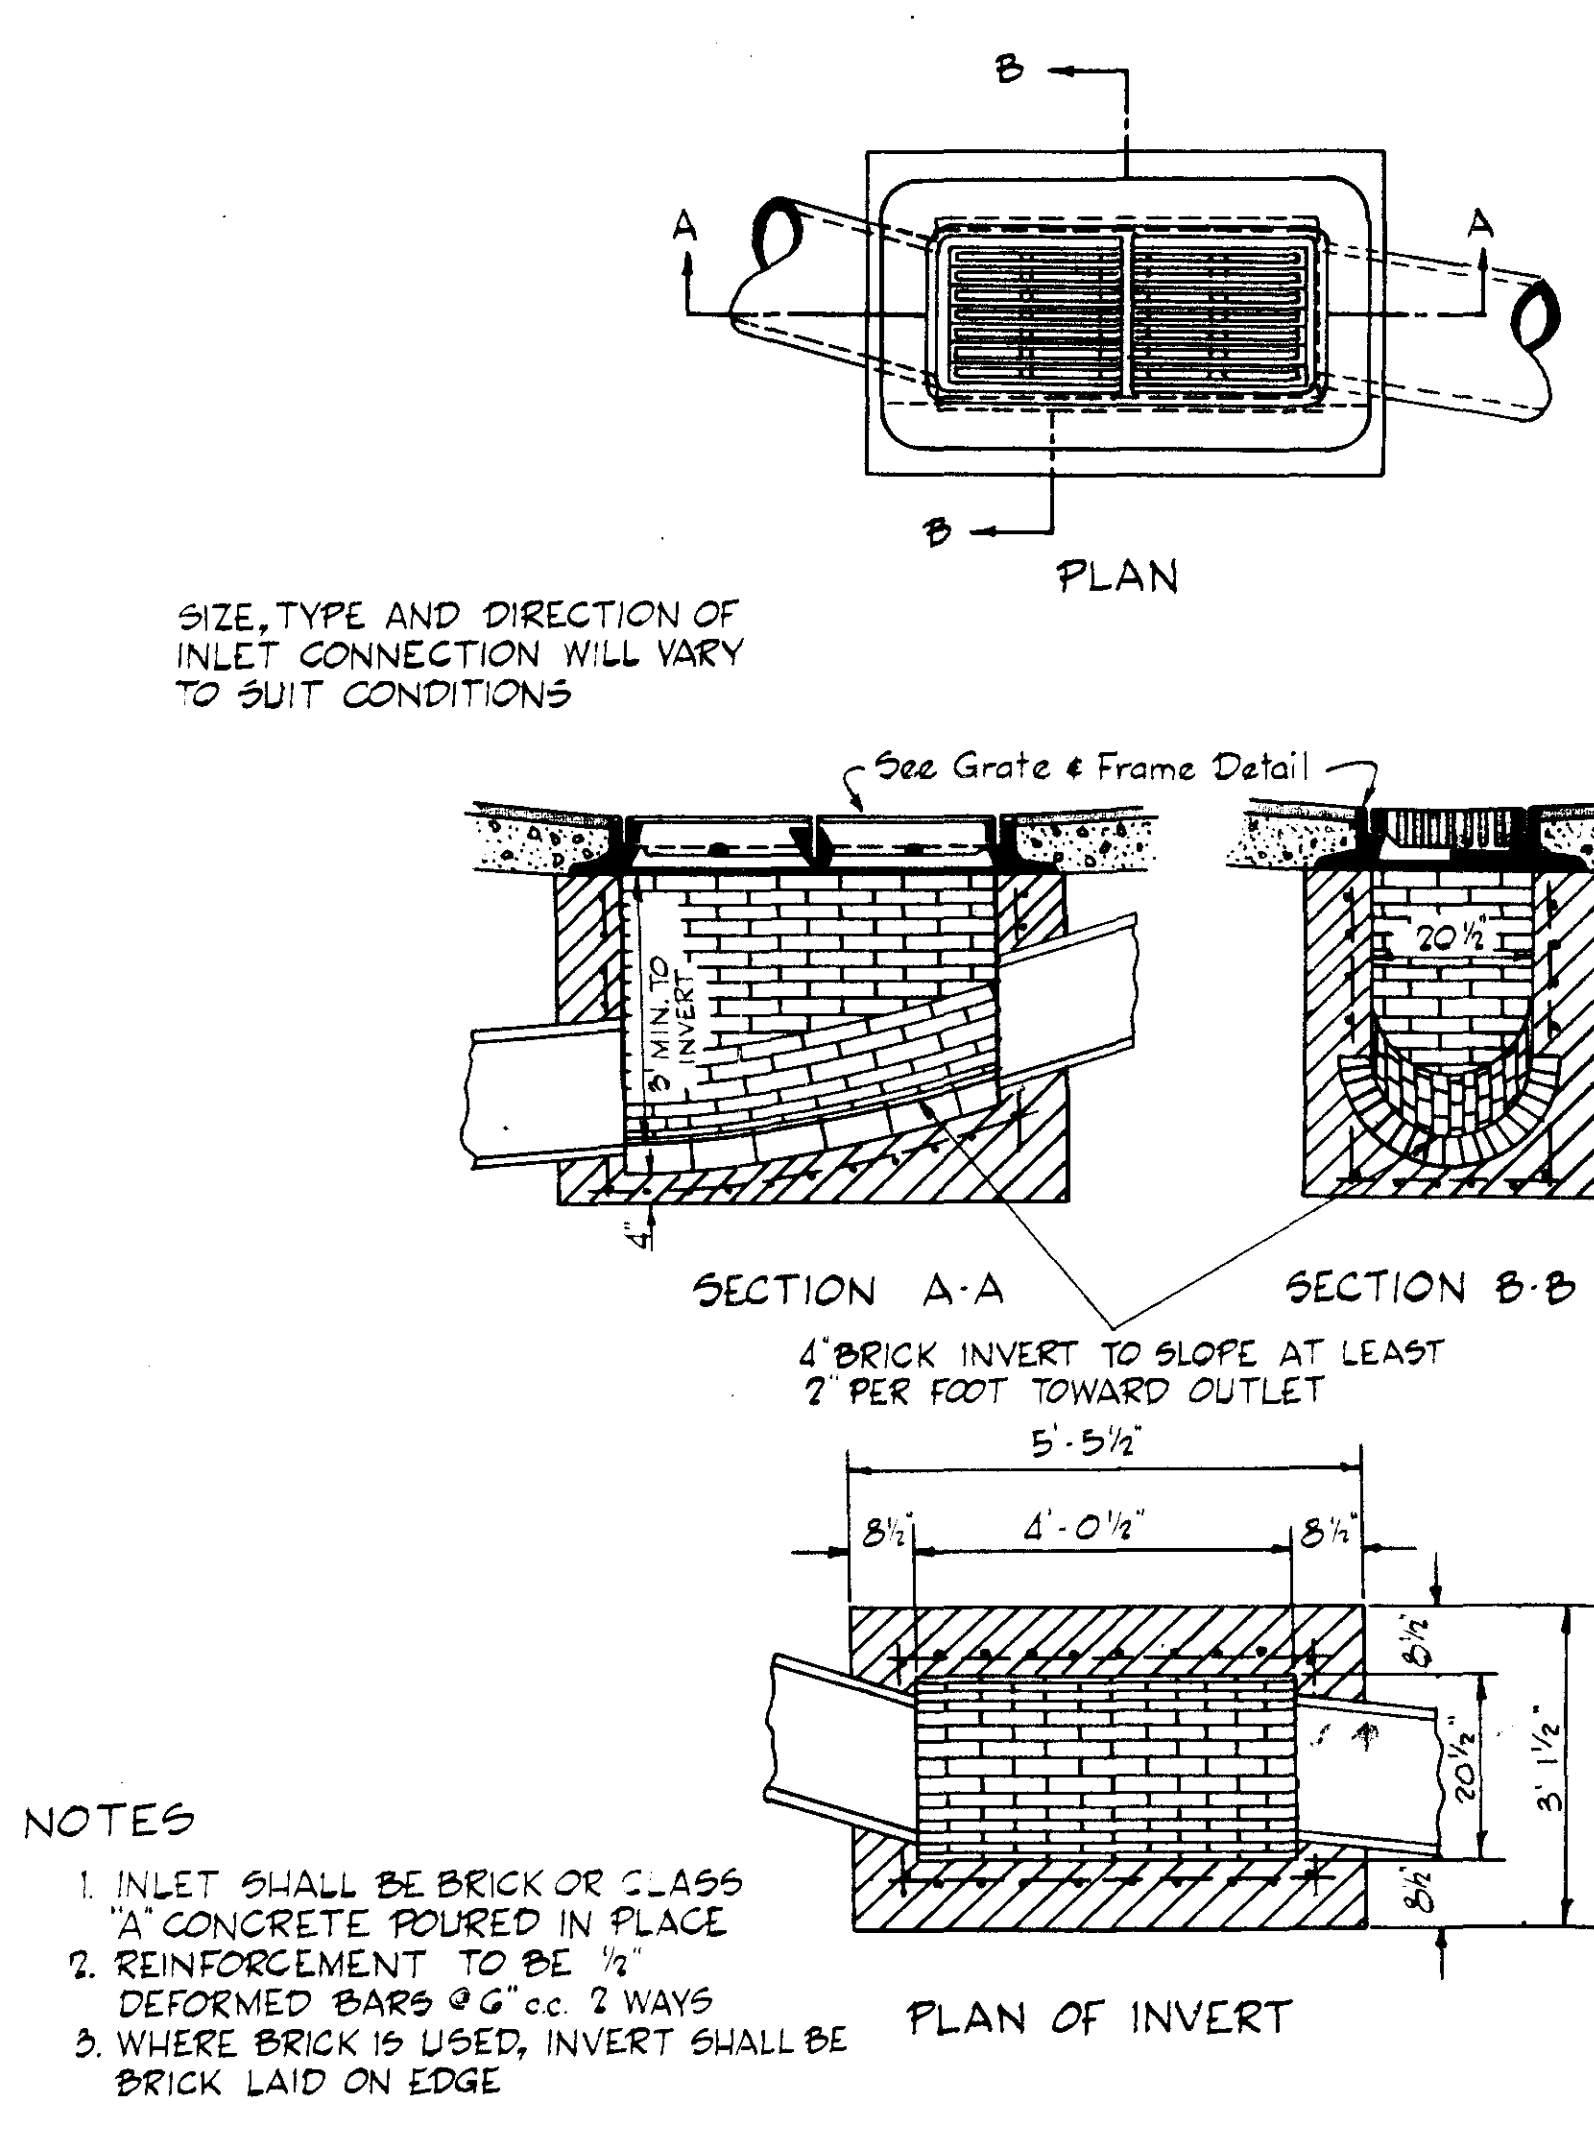

HARVEY L. GORDON A.I.A.

ARCHITECT

Alexandria, Virginia

9-17-70

Revisions as per final check

Rev Date Rev No Revision Description

RICHARD P. BROWNE ASSOCIATES

Columbia, Maryland

ENGINEERS PLANNERS ARCHITECTS

Wayne, New Jersey

BETHLEHEM TERRACE

TOWN OF BETHLEHEM

ALBANY COUNTY, NEW YORK

JASON MINICK INC.

Des By FT Scale AS SHOWN Dwg No 0372

Dim By RS 4 FT Date APRIL 17, 1970 Job No

Chk By KJC Approved