


CONSTRUCTION SPECIFICATIONS

- BALES SHALL BE PLACED AT THE TOE OF A SLOPE OR ON THE CONTOUR AND IN A ROW WITH ENDS TIGHTLY BUTTING THE ADJACENT BALES.
- EACH BALE SHALL BE EMBEDDED IN THE SOIL A MINIMUM OF (4) INCHES, AND PLACED SO THE BINDINGS ARE HORIZONTAL.
- BALES SHALL BE SECURELY ANCHORED IN PLACE BY EITHER TWO STAKES OR RE-BARS DRIVEN THROUGH THE BALE. THE FIRST STAKE IN EACH BALE SHALL BE DRIVEN TOWARD THE PREVIOUSLY LAID BALE AT AN ANGLE TO FORCE THE BALES TOGETHER. STAKES SHALL BE DRIVEN FLUSH WITH THE BALE.
- INSPECTION SHALL BE FREQUENT AND REPAIR REPLACEMENT SHALL BE MADE PROMPTLY AS NEEDED.
- BALES SHALL BE REMOVED WHEN THEY HAVE SERVED THEIR USEFULNESS SO AS NOT TO BLOCK OR IMPEDE STORM FLOW OR DRAINAGE.


U.S. DEPARTMENT OF AGRICULTURE
NATURAL RESOURCES CONSERVATION SERVICE
NEW YORK STATE DEPARTMENT OF ENVIRONMENTAL CONSERVATION
NEW YORK STATE SOIL & WATER CONSERVATION COMMITTEE

9
6 STRAW BALE DIKE

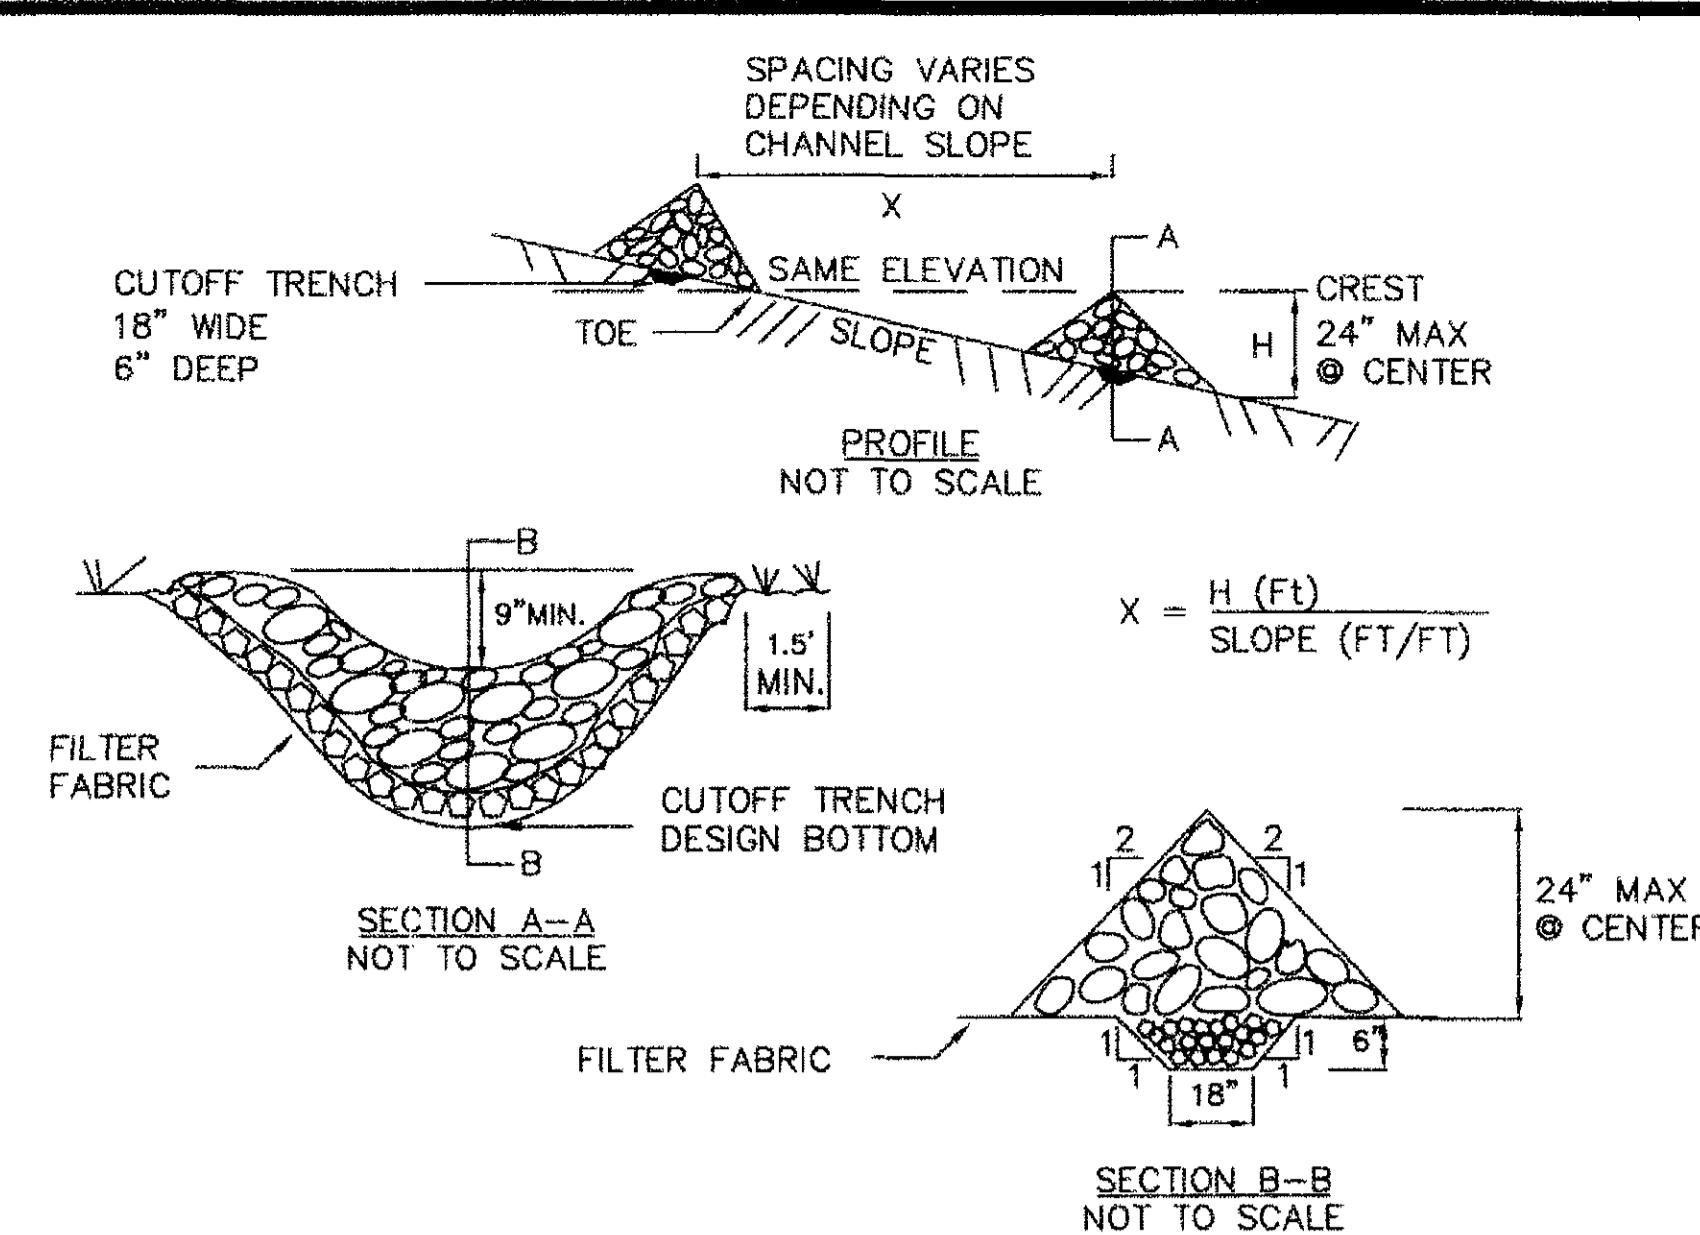


CONSTRUCTION SPECIFICATIONS

- FILTER FABRIC SHALL HAVE AN EOS OF 40-85. BURLAP MAY BE USED FOR SHORT TERM APPLICATIONS.
- CUT FABRIC FROM A CONTINUOUS ROLL TO ELIMINATE JOINTS. IF JOINTS ARE NEEDED THEY WILL BE OVERLAPPED TO THE NEXT STAKE.
- STAKE MATERIALS WILL BE STANDARD 2" x 4" WIRE OR EQUIVALENT. METAL WITH A MINIMUM LENGTH OF 3 FEET.
- SPACES STAKES EVENLY AROUND CREST 3 FEET APART AND DRIVE A MINIMUM OF 6" DEEP. STAKES LONGER THAN 3 FT MAY BE BRIDGED WITH THE USE OF WIRE MESH BEHIND THE FILTER FABRIC FOR SUPPORT.
- FABRIC SHALL BE EMBEDDED 1 FOOT MINIMUM BELOW GROUND AND BACKFILLED. IT SHALL BE SECURELY FASTENED TO THE STAKES AND FRAME.
- A 2" x 4" WOOD FRAME SHALL BE COMPLETED AROUND THE CREST OF THE FABRIC FOR OVER FLOW STABILITY.
- PREFABRICATED UNITS SHALL BE GEOFAB, ENVIROFENCE, OR APPROVED EQUIVALENT.
- Maintenance SHALL BE PERFORMED AS NEEDED AND MATERIAL REMOVED WHEN "BULGES" DEVELOP IN THE SILT FENCE.

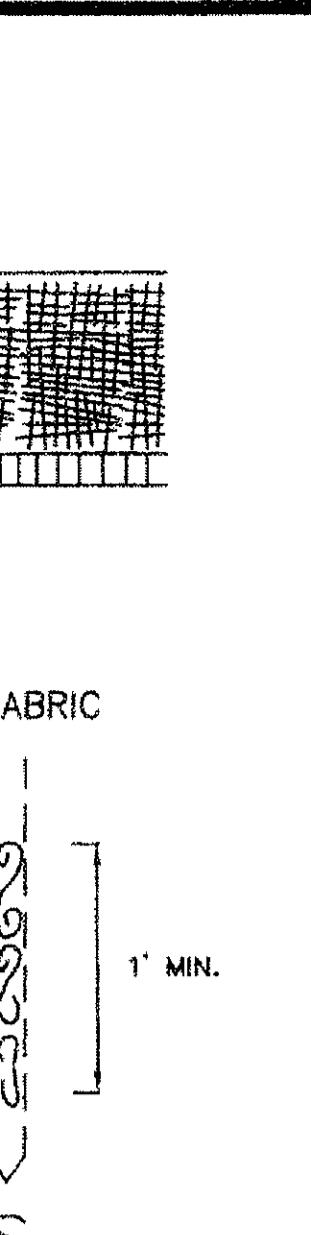


CONSTRUCTION SPECIFICATIONS

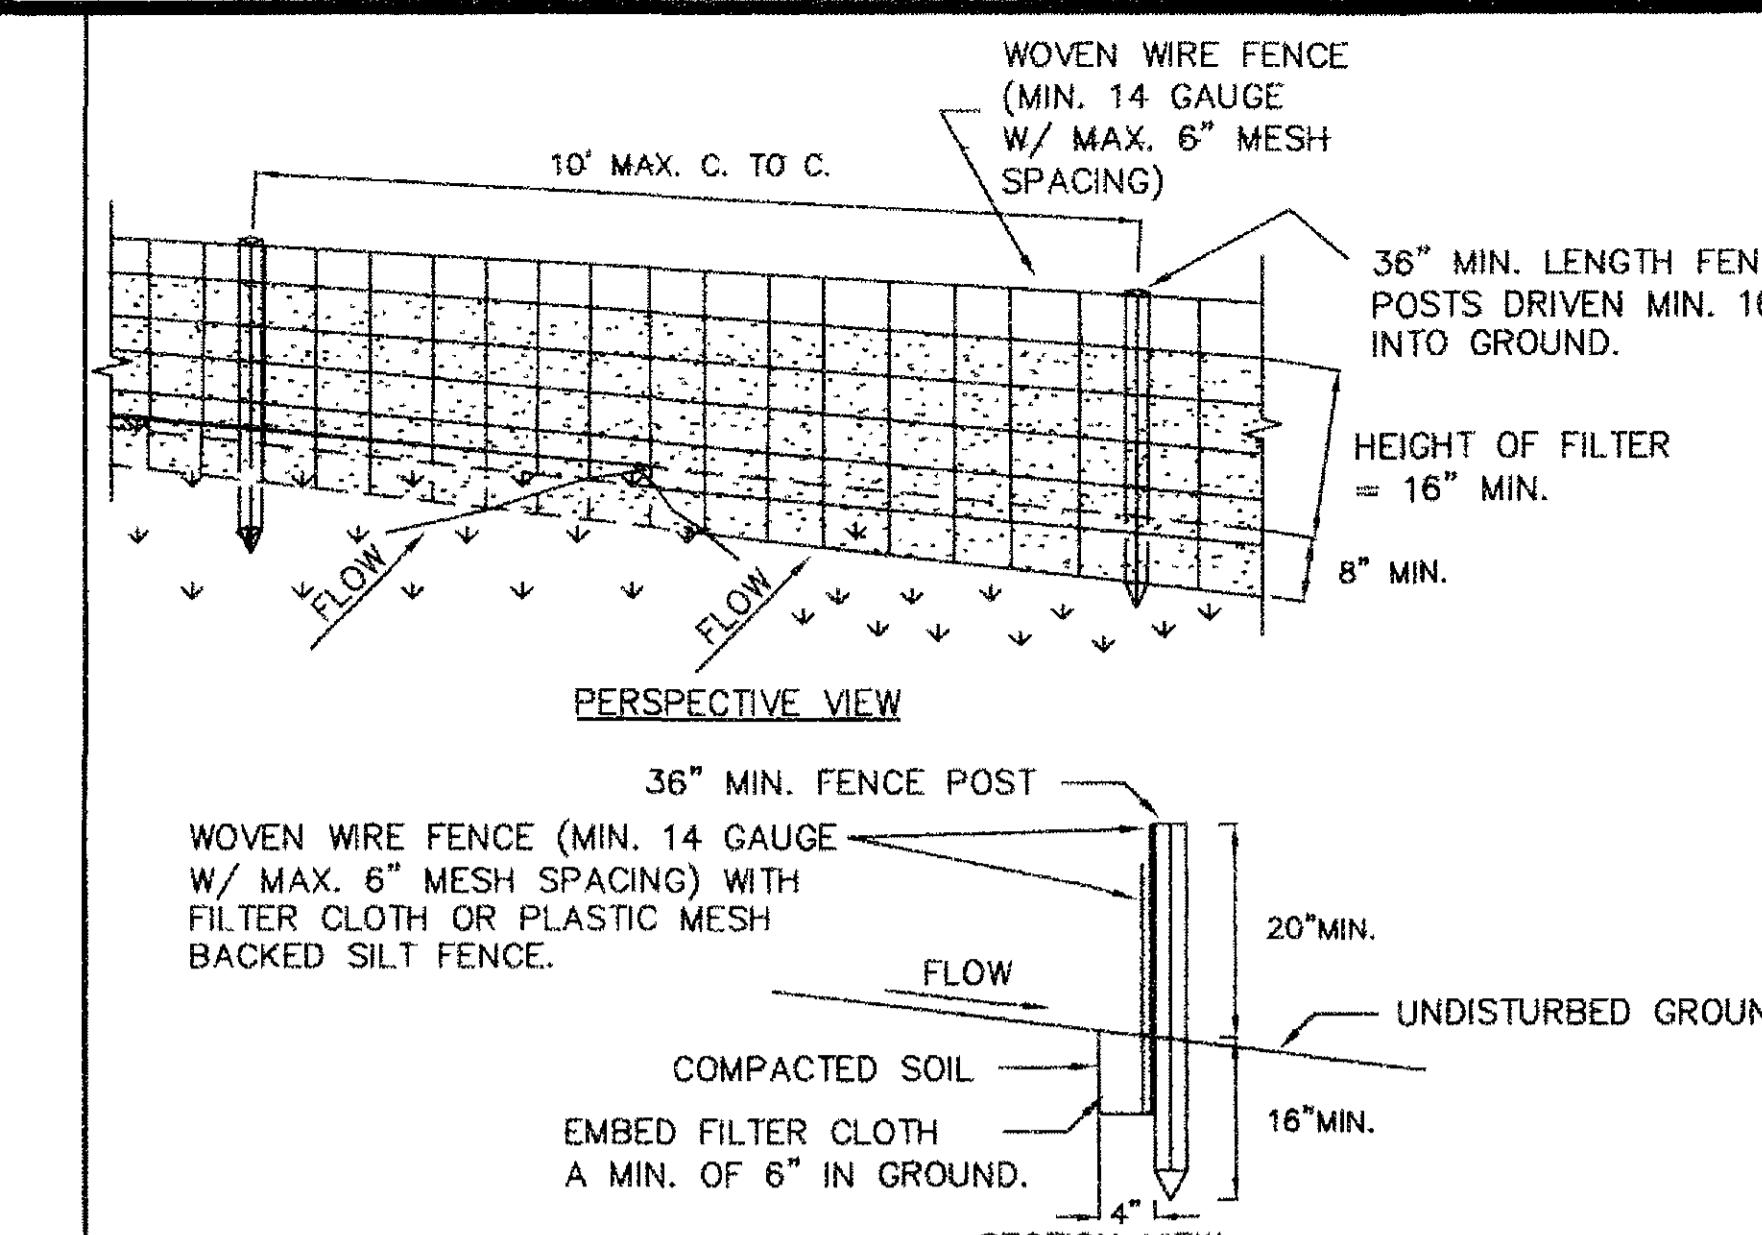

CONSTRUCTION SPECIFICATIONS

- WOVEN WIRE FENCE TO BE FASTENED SECURELY TO FENCE POSTS WITH WIRE TIES OR STAPLES. POSTS SHALL BE STEEL EITHER "T" OR "U" TYPE OR HARDWOOD.
- FILTER CLOTH TO BE FASTENED SECURELY TO WOVEN WIRE FENCE WITH TIES SPACED EVERY 24" AT TOP AND MID SECTION.
- FENCE SHALL BE WOVEN WIRE, 12 1/2 GAUGE, 6" MAX MESH OPENING.
- WHEN TWO SECTIONS OF FILTER CLOTH ADJOIN EACH OTHER THEY SHALL BE OVERLAPPED BY SIX INCHES AND FOLDED. FILTER CLOTH SHALL BE EITHER FILTER X, MIRAFI 100X, STABILINA T140N, OR APPROVED EQUIVALENT.
- PREFABRICATED UNITS SHALL BE GEOFAB, ENVIROFENCE, OR APPROVED EQUIVALENT.
- Maintenance SHALL BE PERFORMED AS NEEDED AND MATERIAL REMOVED WHEN "BULGES" DEVELOP IN THE SILT FENCE.

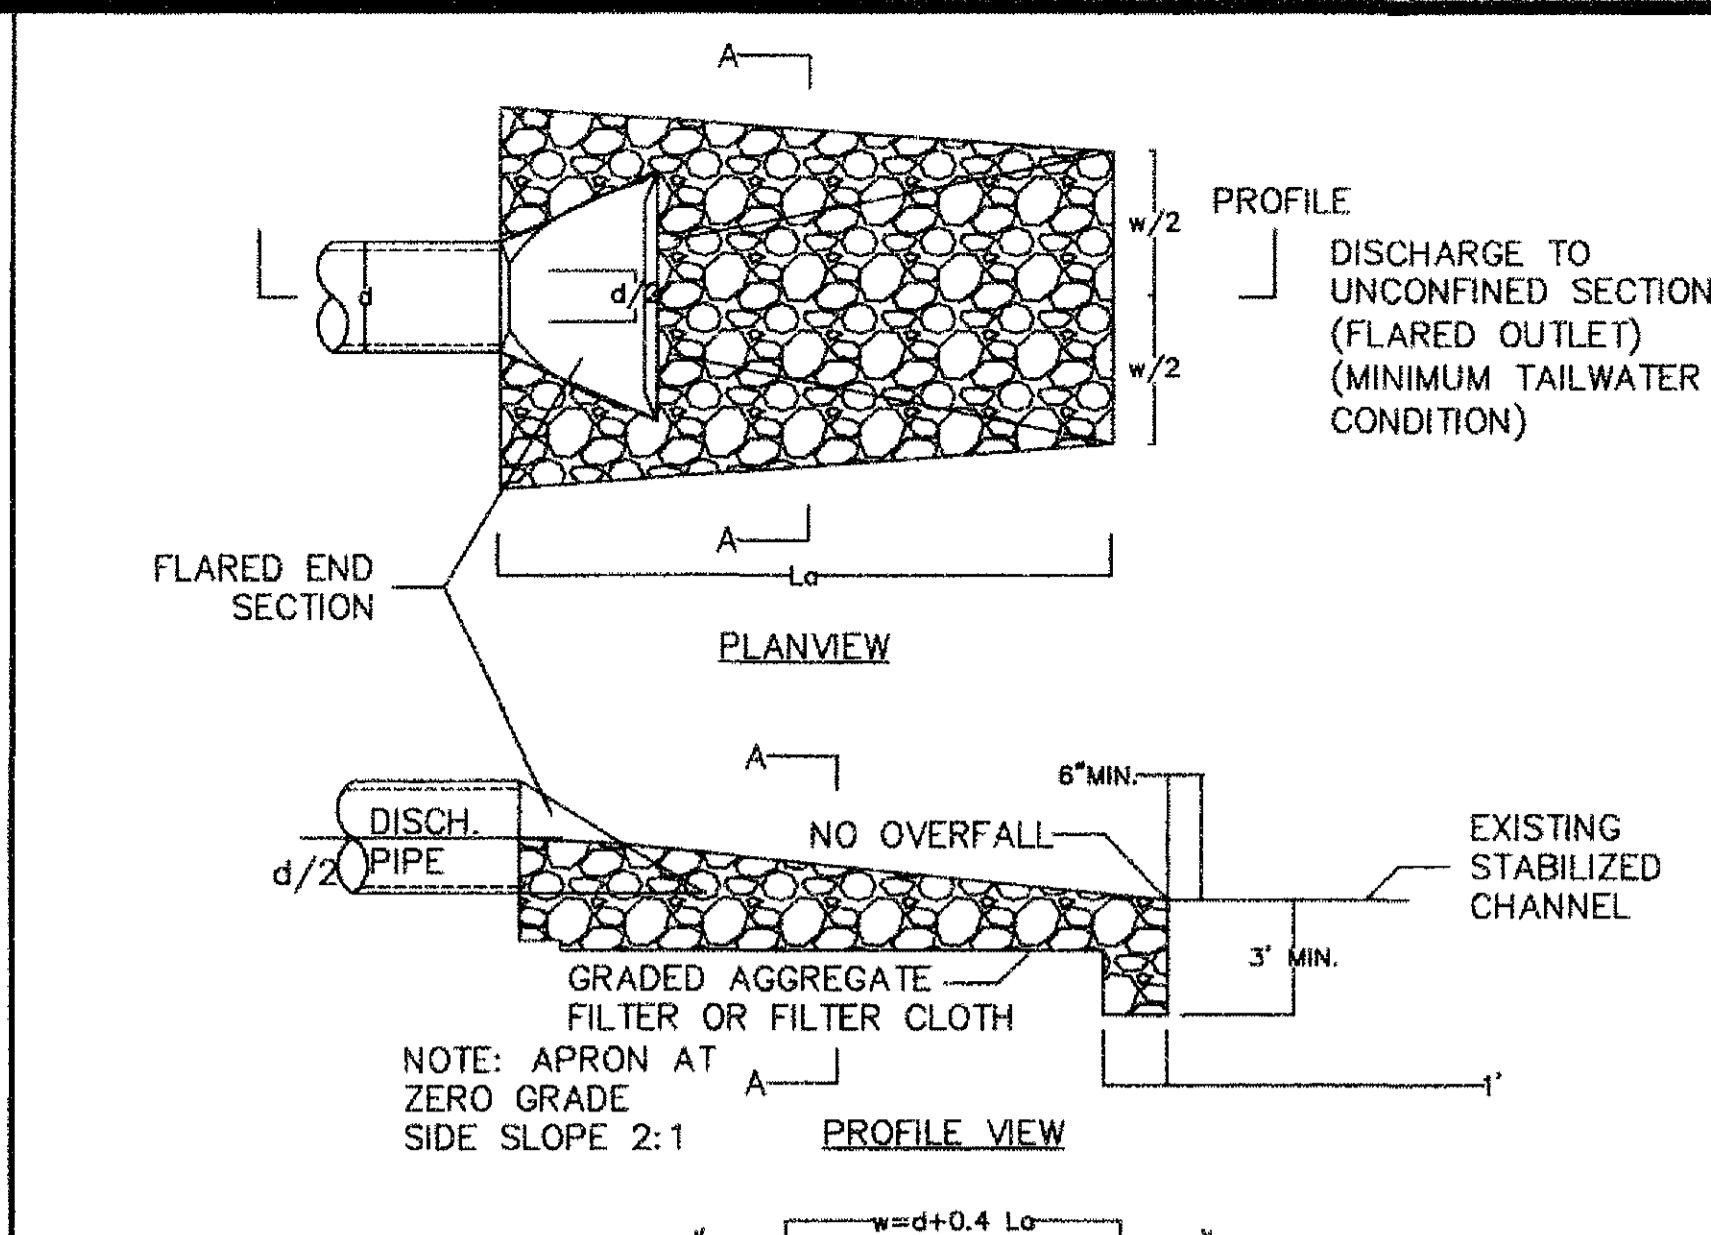

CONSTRUCTION SPECIFICATIONS

NOTE: MINIMUM TAILWATER CONDITIONS SEE FOLLOWING TABLE FOR STONE DIMENSIONS

Lo (ft)	d50 (in)	dmax (in)	Min. Blanket Thickness (in)
14	6.3	9.5	14

NOTE: RIP RAP SHALL CONFORM TO NYSDOT STANDARD SPECIFICATIONS (MAY 2008) SECTION 620. STONE FILLING ITEM SHALL BE "MEDIUM" IN ACCORDANCE WITH FIGURE 620-1.

10
6 RIPRAP OUTLET PROTECTION DETAIL
BASED ON NYSDOT AUG 2005
N.T.S.

U.S. DEPARTMENT OF AGRICULTURE
NATURAL RESOURCES CONSERVATION SERVICE
NEW YORK STATE DEPARTMENT OF ENVIRONMENTAL CONSERVATION
NEW YORK STATE SOIL & WATER CONSERVATION COMMITTEE

9
6 STRAW BALE DIKE

U.S. DEPARTMENT OF AGRICULTURE
NATURAL RESOURCES CONSERVATION SERVICE
NEW YORK STATE DEPARTMENT OF ENVIRONMENTAL CONSERVATION
NEW YORK STATE SOIL & WATER CONSERVATION COMMITTEE

7
6 CHECK DAM


U.S. DEPARTMENT OF AGRICULTURE
NATURAL RESOURCES CONSERVATION SERVICE
NEW YORK STATE DEPARTMENT OF ENVIRONMENTAL CONSERVATION
NEW YORK STATE SOIL & WATER CONSERVATION COMMITTEE

5
6 FILTER FABRIC
DROP INLET
PROTECTION


U.S. DEPARTMENT OF AGRICULTURE
NATURAL RESOURCES CONSERVATION SERVICE
NEW YORK STATE DEPARTMENT OF ENVIRONMENTAL CONSERVATION
NEW YORK STATE SOIL & WATER CONSERVATION COMMITTEE

3
6 SILT FENCE

1
6 RIPRAP OUTLET PROTECTION DETAIL
BASED ON NYSDOT AUG 2005
N.T.S.

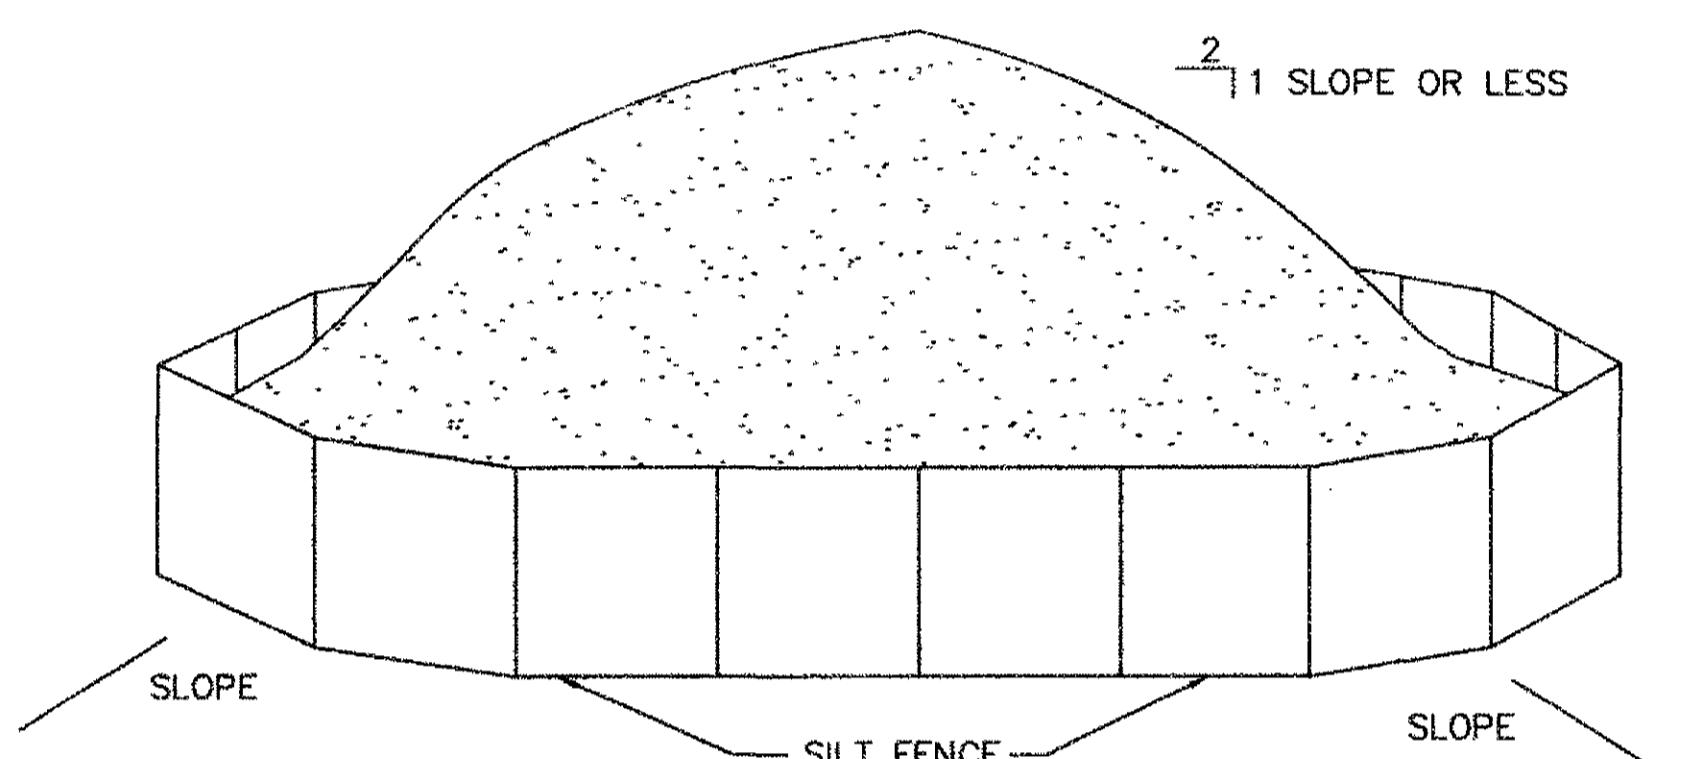

- AREA CHOSEN FOR STOCKPILING OPERATIONS SHALL BE DRY AND STABLE.
- MAXIMUM SLOPE OF STOCKPILE SHALL BE 1: 2
- SILT FENCE SHALL BE PLACED 5-FEET DOWNSLOPE OF EACH PILE. UPON SEEDING OF SOIL STOCKPILING, TOPSOIL SHALL BE STABILIZED WITH SEED AND MULCH IF NOT TO BE DISTURBED/UTILIZED WITHIN 14 DAYS.
- SEE ADDITIONAL DETAILS FOR INSTALLATION OF SILT FENCE.
- TEMPORARY PERIMETER DIKES MAY BE REQUIRED TO DIRECT CLEAN RUNOFF FROM STOCKPILE AREAS. REFER TO EROSION AND SEDIMENT CONTROL PLAN.

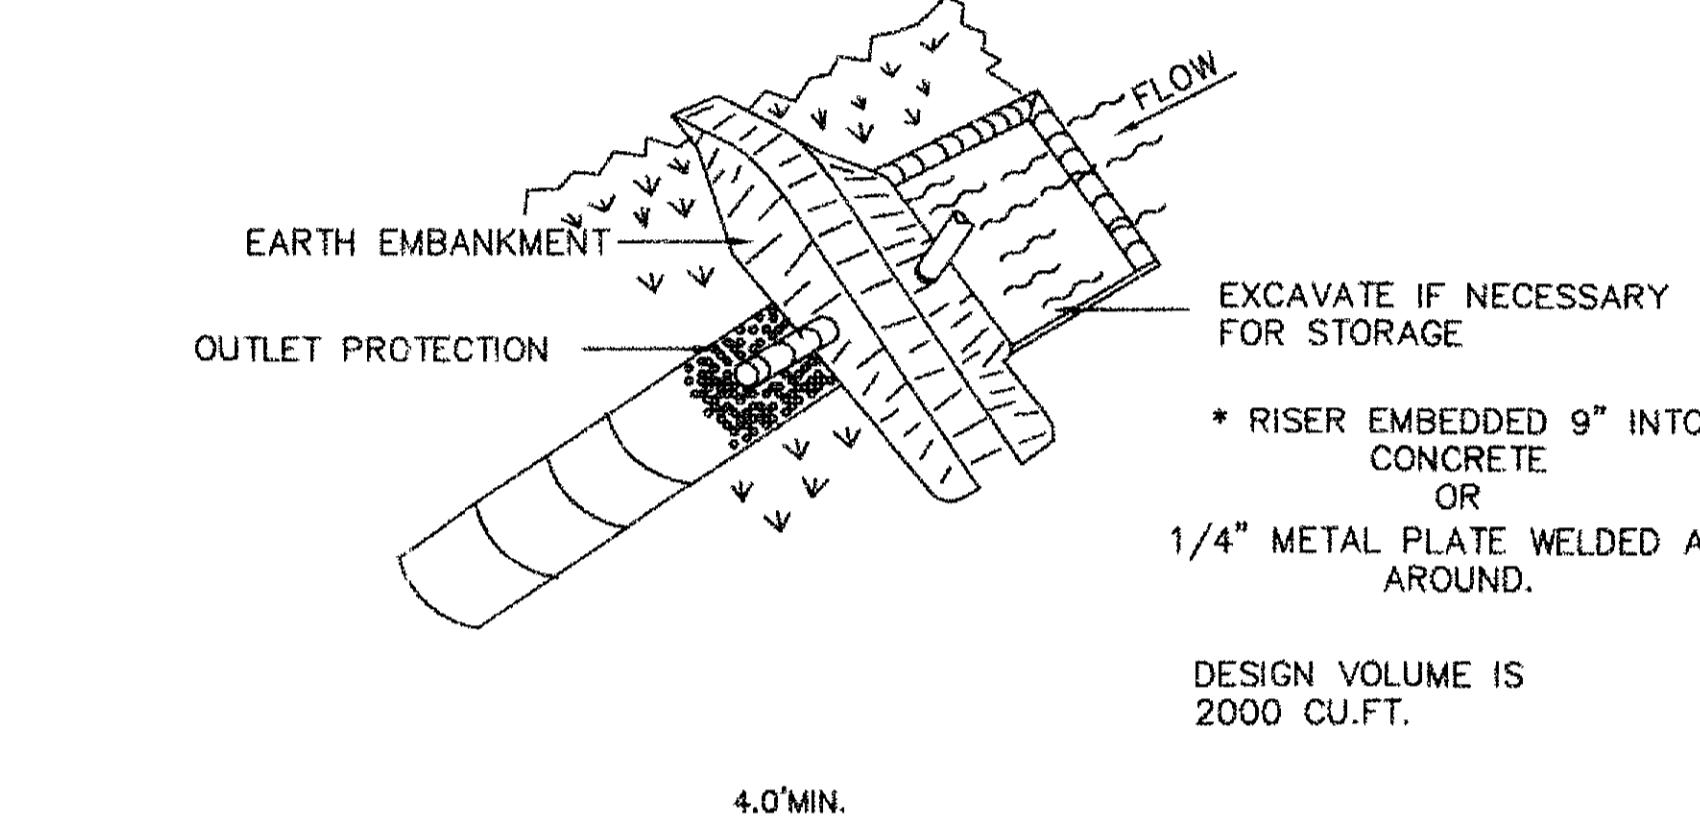

CONSTRUCTION SPECIFICATIONS

- AREA UNDER EMBANKMENT SHALL BE CLEARED, GRUBBED AND STRIPPED OF ANY VEGETATION AND ROOT MAT. THE POOL AREA SHALL BE CLEARED.
- THE FILL MATERIAL FOR THE EMBANKMENT SHALL BE FREE OF ROOTS OR OTHER WOODY VEGETATION AS WELL AS OVER-SIZED STONES, ROCKS, ORGANIC MATERIAL OR OTHER OBJECTIONABLE MATERIAL. THE EMBANKMENT SHALL BE COMPACTED BY TRAVERSING WITH EQUIPMENT WHILE IT IS BEING CONSTRUCTED.
- VOLUME OF SEDIMENT STORAGE SHALL BE 1800 CUBIC FEET PER ACRE OF CONSIDERATION FOR DRAINAGE.
- SEDIMENT SHALL BE REMOVED AND TRAP RESTORED TO ITS ORIGINAL DIMENSIONS WHEN THE SEDIMENT HAS ACCUMULATED TO 1/2 THE DESIGN DEPTH OF THE TRAP. REMOVED SEDIMENT SHALL BE DEPOSITED IN A SUITABLE AREA AND IN SUCH A MANNER THAT IT WILL NOT ERODE.
- THE STRUCTURE SHALL BE INSPECTED AFTER EACH RAIN AND REPAIRS MADE AS NEEDED.
- CONSTRUCTION OPERATIONS SHALL BE CARRIED OUT IN SUCH A MANNER THAT EROSION AND WATER POLLUTION ARE MINIMIZED.
- THE STRUCTURE SHALL BE REMOVED AND AREA STABILIZED WHEN THE DRAINAGE AREA HAS BEEN PROPERLY STABILIZED.
- ALL FILL SLOPES SHALL BE 2:1 OR FLATTER; CUT SLOPES 1:1 OR FLATTER.
- ALL PIPE CONNECTIONS SHALL BE WATERTIGHT.
- THE TOP 2/3 OF THE RISER SHALL BE PERFORATED WITH ONE (1) INCH DIAMETER HOLES IN SLITS SPACED SIX (6) INCHES VERTICALLY AND HORIZONTALLY AND PLACED IN THE CENTER OF THE RISER. THE BOTTOM 1/3 OF THE RISER SHALL BE PERFORATED WITH ONE (1) INCH DIAMETER HOLES SPACED SIX (6) INCHES VERTICALLY AND HORIZONTALLY AND PLACED IN THE CENTER OF THE RISER.
- THE RISER SHALL BE WRAPPED WITH 1/4 TO 1/2 INCH HARDWARE CLOTH WIRE THEN WRAPPED WITH FILTER CLOTH (HAVING AN EQUIVALENT SEIVE SIZE OF 40-80). THE FILTER CLOTH SHALL EXTEND SIX (6) INCHES ABOVE THE HIGHEST HOLE AND SIX (6) INCHES BELOW THE LOWEST HOLE. THE FILTER CLOTH AND HARDWARE CLOTH SHALL BE TIED TOGETHER, THEY SHALL BE OVER-LAPPED, FOLDED AND STAPLED TO PREVENT BYPASS.
- STRAPS OR CONNECTING BANDS SHALL BE USED TO HOLD THE FILTER CLOTH AND WIRE FABRIC IN PLACE. THEY SHALL BE PLACED AT THE TOP AND BOTTOM OF THE CLOTH.
- FILL MATERIAL AROUND THE PIPE SPILLWAY SHALL BE HAND COMPACTED IN FOUR (4) INCH LAYERS. A MINIMUM OF TWO (2) FEET OF HAND COMPACTED BACKFILL SHALL BE PLACED OVER THE PIPE SPILLWAY BEFORE CROSSING IT WITH CONSTRUCTION EQUIPMENT.
- THE RISER SHALL BE ANCHORED WITH EITHER A CONCRETE BASE OR STEEL PLATE. PLATE TO PREVENT FLOATING. FOR CONCRETE BASE, THE DEPTH SHALL BE TWELVE (12) INCHES. THE RISER EMBEDDED NINE (9) INCHES. THE CONCRETE BASE MINIMUM THICKNESS SHALL BE ATTACHED TO THE RISER BY A CONTINUOUS WELD AROUND THE BOTTOM TO FORM A WATERTIGHT CONNECTION AND THEN PLACE TWO (2) FEET OF STONE, GRAVEL, OR TAMPED EARTH ON THE PLATE.


SIZES OF PIPE NEEDED:
BARREL DIAMETER: 15"
RISER DIAMETER: 18"

NOTE:
CONSTRUCTION SPECIFICATION SHOULD BE ATTACHED TO THIS DETAIL TO COMPLETE DESIGN.

MAXIMUM DRAINAGE AREA: 5 ACRES


EMBANKMENT SECTION THRU RISER

DESIGN CRITERIA:
DRAINAGE AREA IS GENERALLY STABLE AND COVERED WITH PAVEMENT, GRASS AND OTHER VEGETATION.

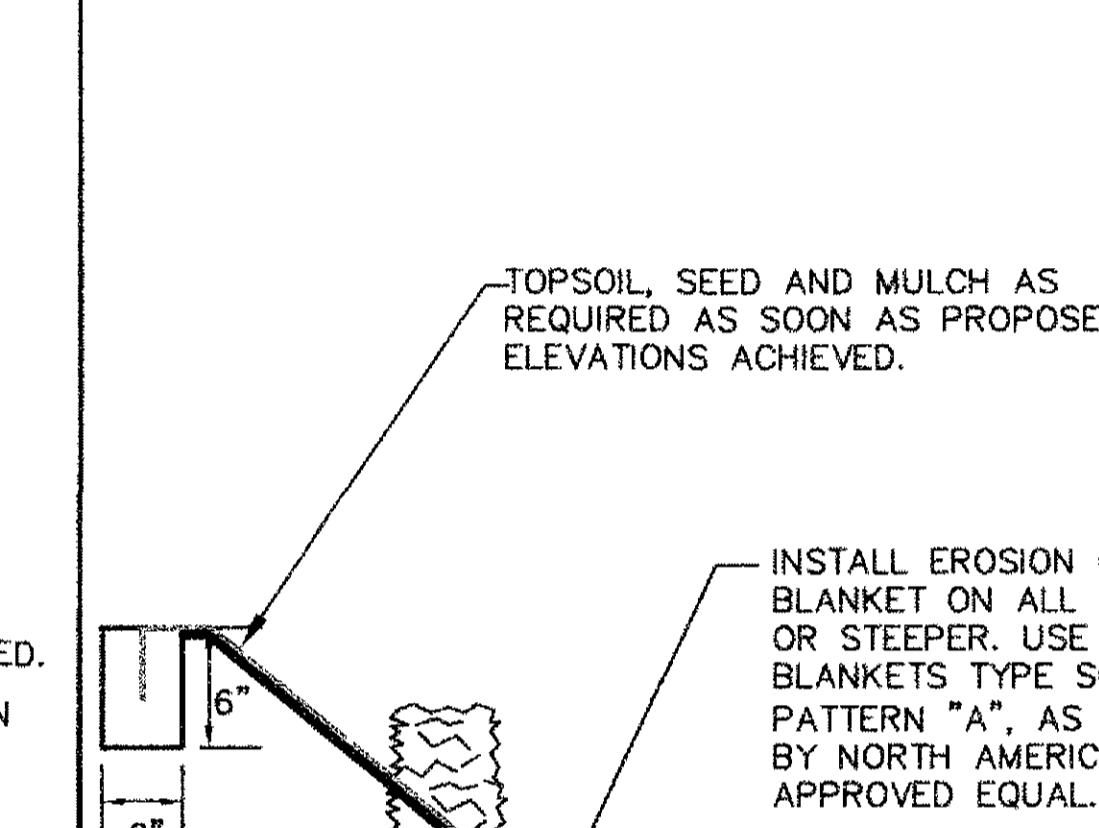

CONSTRUCTION SPECIFICATIONS

- TOPSOIL, SEED AND MULCH AS REQUIRED AS SOON AS PROPOSED ELEVATIONS ACHIEVED.
- INSTALL EROSION CONTROL BLANKET ON ALL SLOPES 1 OR 3 OR STEEPER. USE EROSION BLANKET TYPE SC-200N, STAPLE TYPE "T" AS MANUFACTURED BY NORTH AMERICAN GREEN OR APPROVED EQUIVALENT.
- INSTALL AND SECURELY STAKE HAY BALES AS NEEDED. REMOVE HAY BALES WHEN PERMANENT VEGETATION HAS BEEN ESTABLISHED.

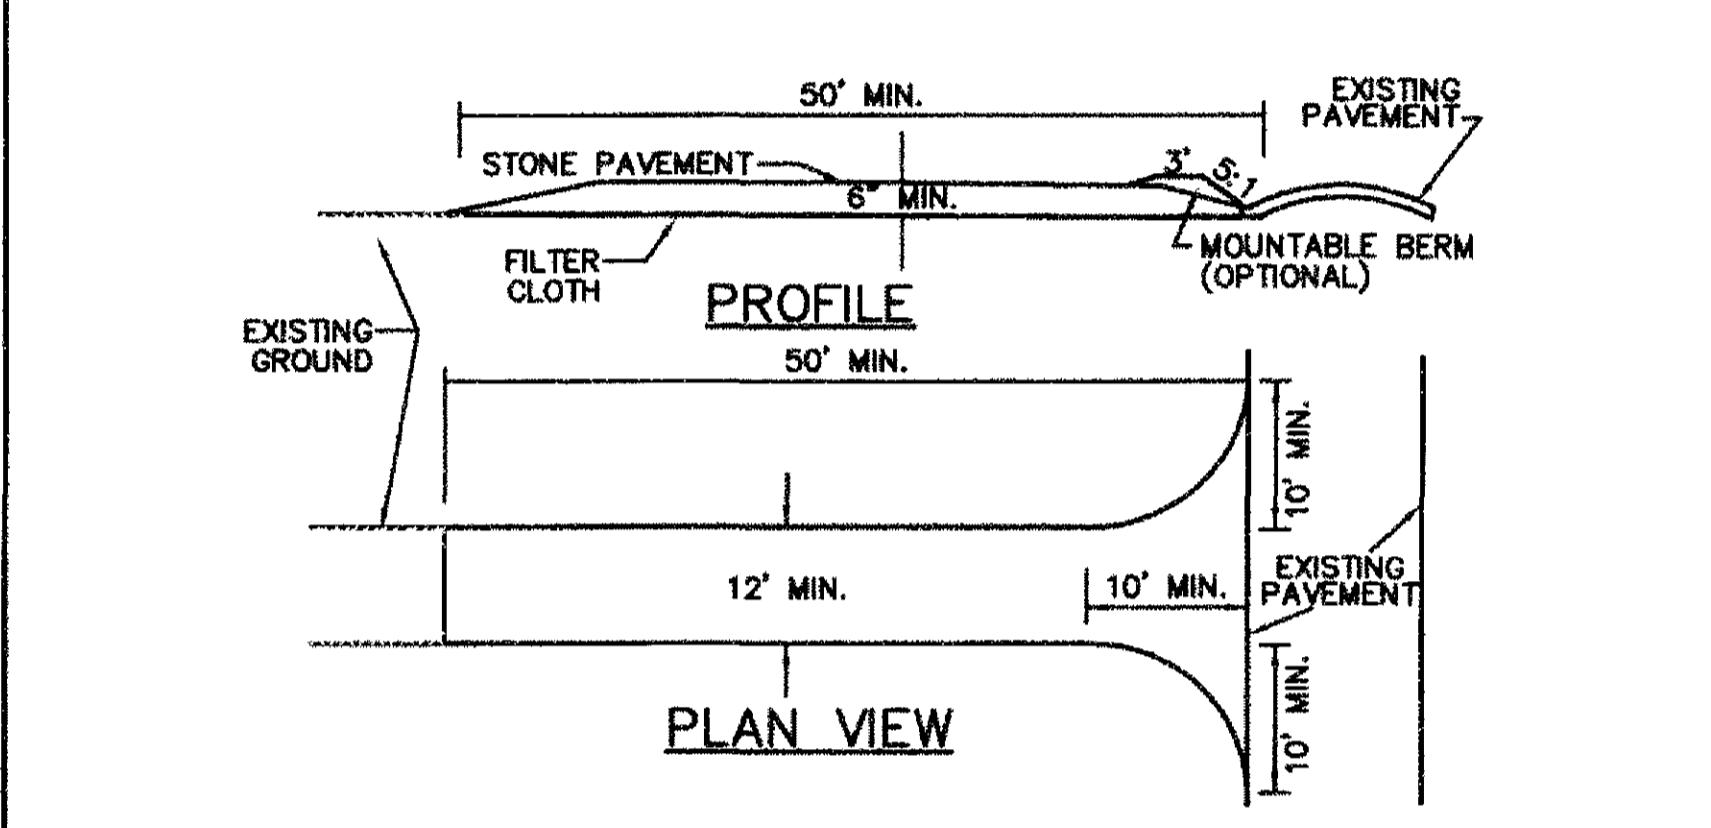

CONSTRUCTION SPECIFICATIONS

- STONE SIZE - USE 1-4 INCH STONE OR RECLAIMED OR RECYCLED CONCRETE EQUIVALENT.
- LENGTH - NOT LESS THAN 50 FEET (EXCEPT ON A SINGLE RESIDENCE LOT WHERE A 3 FOOT MINIMUM LENGTH WILL APPLY).
- THICKNESS - NOT LESS THAN 6 INCHES.
- WIDTH - 12 FOOT MINIMUM, BUT NOT LESS THAN THE FULL WIDTH AT POINTS WHERE INGRESS OR EGRESS OCCURS. 24 FOOT IF SINGLE ENTRANCE TO SITE.
- GEOTEXTILE - WILL BE PLACED OVER THE ENTIRE AREA PRIOR TO PLACING OF STONE.
- SURFACE WATER - ALL SURFACE WATER FLOWING OR DIVERTED TOWARD CONSTRUCTION ENTRANCES SHALL BE FILLED BENEATH THE ENTRANCE IF PIPING IS IMPRACTICAL. A MOUNTABLE BERM WITH 5:1 SLOPES WILL BE PERMITTED.
- MANAGEMENT - THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION WHICH WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC RIGHTS-OF-WAY. ALL SEDIMENT SPILLED, DROPPED, WASHED, OR TRACKED ONTO PUBLIC RIGHTS-OF-WAY MUST BE REMOVED IMMEDIATELY.
- WHEN WASHING IS REQUIRED, IT SHALL BE DONE ON AN AREA STABILIZED WITH STONE AND WHICH DRAINS INTO AN APPROVED SEDIMENT TRAPPING DEVICE.
- PERIODIC INSPECTION AND NEEDED MAINTENANCE SHALL BE PROVIDED AFTER EACH RAINFALL EVENT.

10
6 SOIL STOCKPILE STABILIZATION
N.T.S.

U.S. DEPARTMENT OF AGRICULTURE
NATURAL RESOURCES CONSERVATION SERVICE
NEW YORK STATE DEPARTMENT OF ENVIRONMENTAL CONSERVATION
NEW YORK STATE SOIL & WATER CONSERVATION COMMITTEE


8
6 PIPE OUTLET
SEDIMENT
TRAP ST-1

U.S. DEPARTMENT OF AGRICULTURE
NATURAL RESOURCES CONSERVATION SERVICE
NEW YORK STATE DEPARTMENT OF ENVIRONMENTAL CONSERVATION
NEW YORK STATE SOIL & WATER CONSERVATION COMMITTEE

6
6 PIPE OUTLET
SEDIMENT TRAP
ST-1

4
6 SLOPE
STABILIZATION

2
6 STABILIZED CONSTRUCTION ENTRANCE
N.Y.S.D.C. AUG 05
N.T.S.

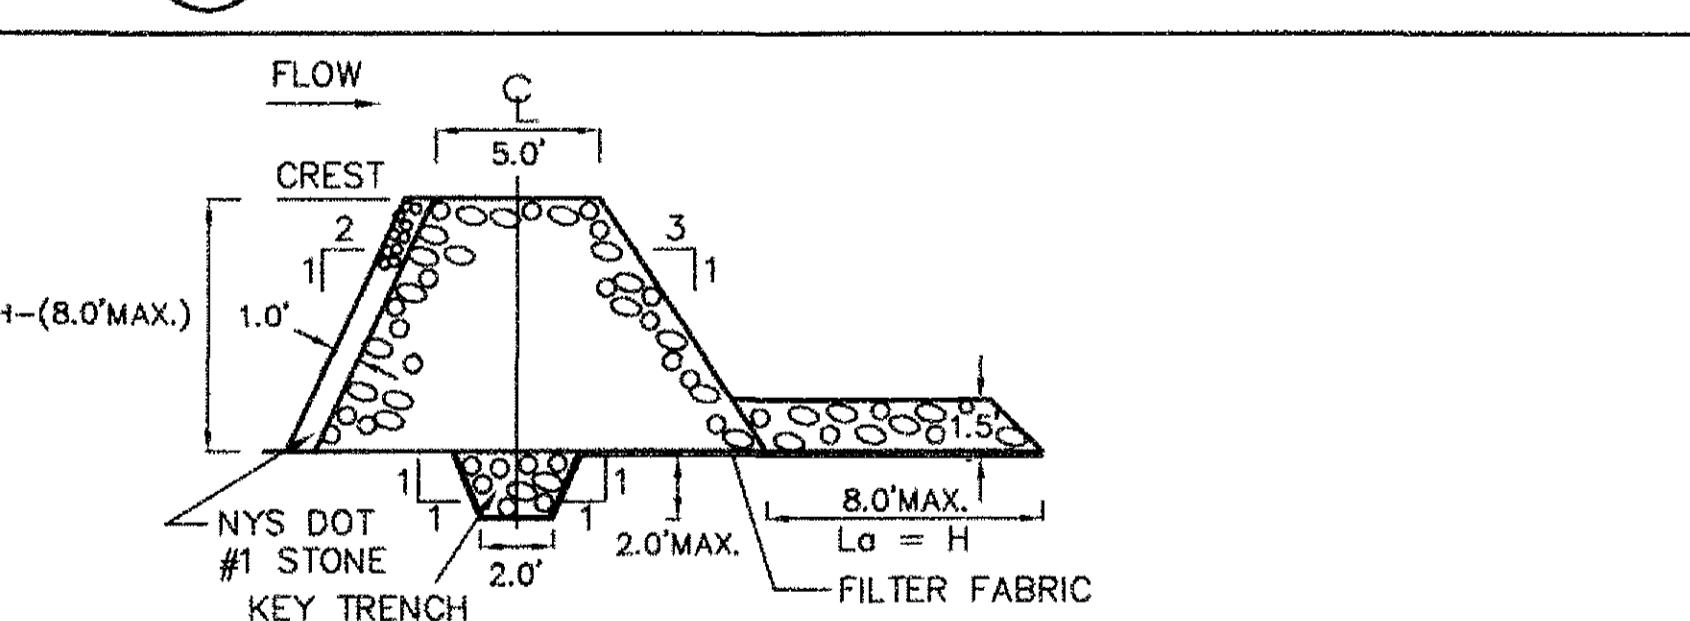


GENERAL EROSION & SEDIMENT CONTROL PLAN NOTES:

- LOCATIONS AS SHOWN ON THE OVERALL/EROSION CONTROL PLAN.
- ALL PROPOSED EROSION CONTROLS SHALL BE INSTALLED PRIOR TO BEGINNING OF CONSTRUCTION. FINAL LOCATION & CONSTRUCTION SHALL BE REVIEWED BY THE ENGINEER.
- STAKEOUT OF ALL PROPOSED EROSION CONTROLS SHALL BE DONE BY A NEW YORK STATE LICENSED PROFESSIONAL SURVEYOR.
- REMOVE EROSION CONTROLS ONLY UNDER THE AUTHORIZATION OF THE ENGINEER.
- CONTRACTOR MUST PROTECT ALL SURFACE WATERS FROM SILTATION DURING CONSTRUCTION WITH APPROPRIATE MEASURES INCLUDING, BUT NOT LIMITED TO PLACING STRAW BALES AND SILTATION FENCING AROUND WORK.
- EROSION AND SEDIMENT CONTROL MEASURES SHOWN ON THIS PLAN ARE THE MINIMUM REQUIRED. ADDITIONAL MEASURES MAY BE REQUIRED DURING CONSTRUCTION AS DIRECTED BY THE ENGINEER.
- EROSION AND SEDIMENT METHODS SHALL COMPLY WITH "THE NEW YORK STATE STANDARDS AND SPECIFICATIONS FOR EROSION AND SEDIMENT CONTROL," LATEST EDITION.

CONSTRUCTION SPECIFICATIONS

- THE AREA UNDER THE ROCK DAM SHALL BE CLEARED AND STRIPPED OF ROOTS AND OTHER OBSTACLES. THE RESERVOIR SHALL BE FLOORED AS NEEDED TO FACILITATE SEDIMENT REMOVAL.
- DIMENSIONS SHOWN ARE MINIMUM. TRENCH SHALL BE EXCAVATED FROM ABUTMENT TO ABUTMENT ON THE DAM CENTERLINE. FILTER FABRIC SHALL BE PLACED FROM UPSTREAM EDGE OF KEYTRENCH TO DOWNSTREAM EDGE OF APRON JOINTS. MILL LAP A MINIMUM OF 1 FT. WITH UPSTREAM STRIP ON TOP.
- CONSTRUCT THE ROCK EMBANKMENT TO THE DIMENSIONS SHOWN ON THE DRAWING. ROCK ABUTMENTS SHALL BE MAINTAINED 2 FT. ABOVE THE CREST.
- THE ROCK DAM SHALL BE CONSTRUCTED PRIOR TO CLEARING THE BASIN AREA, WITH TEMPORARY SEEDING.
- FENCES AND WARNING SIGNS SHOULD BE PLACED AS APPROPRIATE.

MAXIMUM DRAINAGE AREA: 50 ACRES

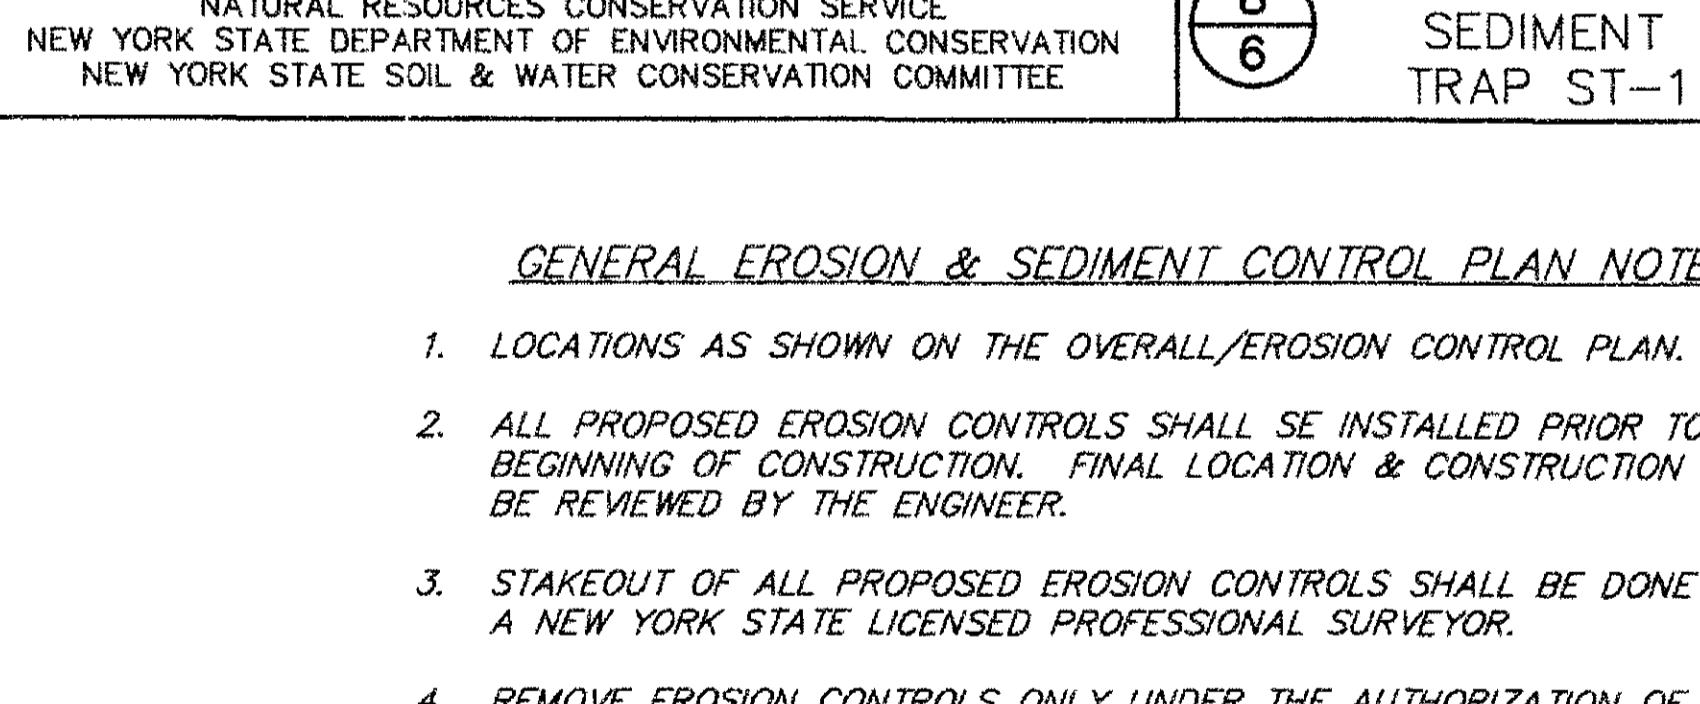

CONSTRUCTION SPECIFICATIONS

- EROSION AND SEDIMENT CONTROL DEVICES SHALL BE INSPECTED PERIODICALLY AND AFTER EACH RAINFALL EVENT. THE CONTRACTOR SHALL REPAIR THE EROSION AND SEDIMENT CONTROL DEVICES AS NECESSARY AND AS DIRECTED BY THE ENGINEER.
- ALL TEMPORARY EXPOSED FACES OF EARTH CUTS AND FILLS SHALL BE VEGETATED OR PROTECTED FROM EROSION IMMEDIATELY UPON COMPLETION OF EARTHWORK. PROVISIONS SHALL BE MADE IN ORDER TO MINIMIZE THE AREA TO BE DISTURBED AND PREVENTING WATER RUNOFF TO CONCENTRATE AND ERODE THE DISTURBED EARTH SLOPE.
- UPON COMPLETION OF GRADING OPERATIONS THE DISTURBED AREAS SHALL BE STABILIZED BY THE FOLLOWING METHODS, DEPENDING UPON THE CLASSIFICATION OF THE AREA AS EITHER TO RECEIVE PERMANENT OR TEMPORARY SEEDING: SEED BED PREPARATION - IF AREAS ARE DEEMED AS REQUIRING TOPSOIL THEN APPLY TOPSOIL TO A DEPTH OF ONE (1) INCH. THE TOPSOIL SHALL BE FRIABLE AND LOAMY, FREE OF DEBRIS, OBSTACLES, NEEDS, AND STONES, AND CONTAIN NO TOXIC MATERIALS. IF TOPSOIL IS DEEMED UNNECESSARY THAN PREPARE SEED BED BY SCARIFYING COMPACTED AREAS AND REMOVING DEBRIS, ROCKS AND STUMPS. SEEDBED SHALL RECEIVE THE FOLLOWING SOIL AMENDMENTS:

A) LIME TO A PH OF 6.0
B) FERTILIZER WITH 600 LBS OF 5-10-10 OR EQUIVALENT PER ACRE (14 LBS./1000 SQ. FT.)

THE SOIL AMENDMENTS SHALL BE WORKED INTO THE SEED BED WITH A DISC, SPRINGTOOTH HARROW, OR OTHER SUITABLE EQUIPMENT. TEMPORARY SEEDINGS - ANNUAL PYEGRASS SEED SHALL BE APPLIED AT A RATE OF 0.9 LBS PER 1000 SQUARE FEET. USE WINTER RYE IF SEEDING DURING OCTOBER/NOVEMBER. PERMANENT SEEDINGS - SEEDINGS SHALL CONSIST OF 1 LB PER 1000 SQUARE FEET OF SEED CONTINUOUSLY. USE SOD-LESS SPROUTING PERENNIAL RYE GRASS AND 100% PINE CLOVER OR ALFALFA. THE SEED MIX SHALL BE SPREAD BY UTILIZING A CYCLONE SEEDER, DRILL, OR CULTIPACK SEEDER. SEED DEPTH SHALL BE FROM 1/4 TO 1/2 INCH DEEP. SEED MAY ALSO BE APPLIED BY APPROPRIATE HYDROSEEDING METHODS. ALL SEEDDED AREAS SHALL BE MULCHED WITH STRAW MULCH APPLIED AT RATE OF 2 TON/ACRE (90 LBS PER 1000 SQUARE FEET) AND ANCHORED WITH "TERRA-TACK" OR EQUAL.

- IF STABILIZATION BY SEEDING CANNOT OCCUR DURING THE RECOMMENDED SEEDING PERIODS, TOPSOIL, FILL, AND EXCAVATED MATERIALS AREAS SHALL BE TEMPORARILY STABILIZED WITH ANCHORED MULCH UNTIL SUCH TIME AS EFFECTIVE SEEDING CAN OCCUR.
- STOCKPILE MATERIALS SHALL NOT BE LOCATED WITHIN 25 FEET OF ANY DITCH, STREAM, OR OTHER SURFACE WATER BODY.
- IF CONSTRUCTION IS SUSPENDED, OR SECTIONS COMPLETED, AREAS SHALL BE SEDED AND/OR MULCHED IMMEDIATELY.

14. GRADING DISTURBANCE IS LIMITED TO A MAXIMUM OF 5 ACRES. IF A GREATER DISTURBANCE IS REQUIRED, THE CONTRACTOR SHALL SUBMIT A GRADING DISTURBANCE PLAN TO THE ENGINEER FOR REVIEW. AT A MINIMUM, DAILY INSPECTIONS BY THE ENGINEER SHALL BE REQUIRED IF THE 5 ACRE MINIMUM IS EXCEEDED.

15. SEDIMENT SHALL BE REMOVED FROM TRAPS WHEN THE SEDIMENT HAS ACCUMULATED TO ONE HALF THE BASIN DEPTH.

0 INCHES
A-45
4405
TOWN OF BETHLEHEM

NOTE:

THE CONTRACTOR SHALL LOCATE SEDIMENT TRAPS AT STRATEGIC LOCATIONS BASED UPON THE WORK AREA AND AMOUNT OF DISTURBANCE. PRIOR TO CONSTRUCTING A SEDIMENT TRAP THE CONTRACTOR SHALL SUBMIT A WORK PLAN TO THE ENGINEER FOR REVIEW OF THE PROPOSED WORK AREAS TO BE PERFORMED AND THE AMOUNT OF AREA TO BE DISTURBED.

L. SIPPERLY & ASSOCIATES
ENGINEERS • SURVEYORS • LAND PLANNERS
696 TROY-SCHENECTADY ROAD, LATHAM, N.Y. 12110
PHONE: (518) 782-1800 FAX: (518) 782-1252

UNAUTHORIZED ALTERATION OR ADDITION TO THIS DOCUMENT IS A VIOLATION OF SECTION 7209, SUB-DIVISION 2, OF THE NEW YORK STATE EDUCATION LAW
PROFESSIONAL ENGINEER
074179
Date 10/18/08

DESIGNED BY: M.R.
DRAWN BY: T.M.
CHECKED BY: T.M.
APPROVED BY: T.M.
SCALE: AS NOTED
DATE: AUGUST 20, 2008

BETHLEHEM TOWN CENTER II
NORTH SLOPE EARTH SLIDE SITE IMPROVEMENTS
PHASE 1 AND PHASE 2
EROSION DETAILS
N.Y.S. ROUTE 9W
COUNTY OF ALBANY
TOWN OF BETHLEHEM
STATE OF NEW YORK

6
SHEET 6 OF 6
REV. NO. DWG. NO.
B E-08252