

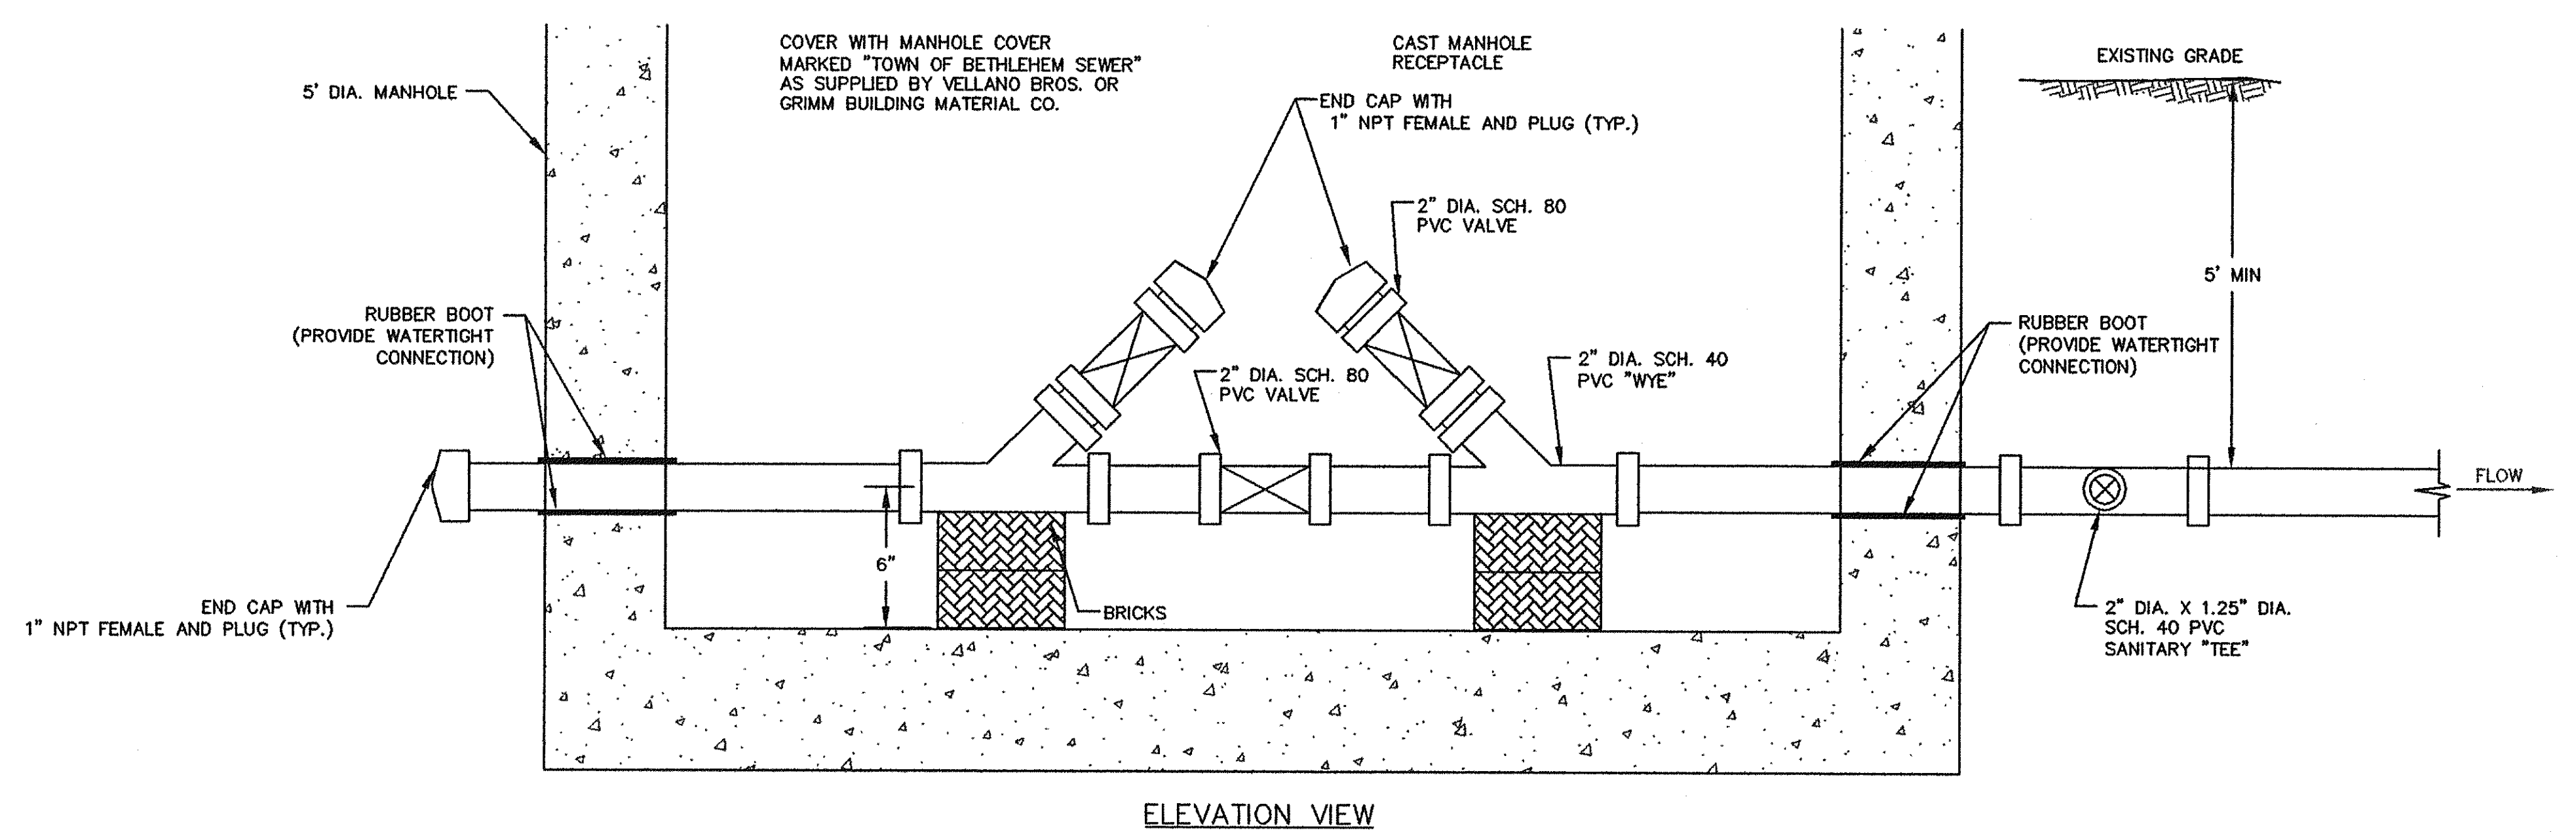
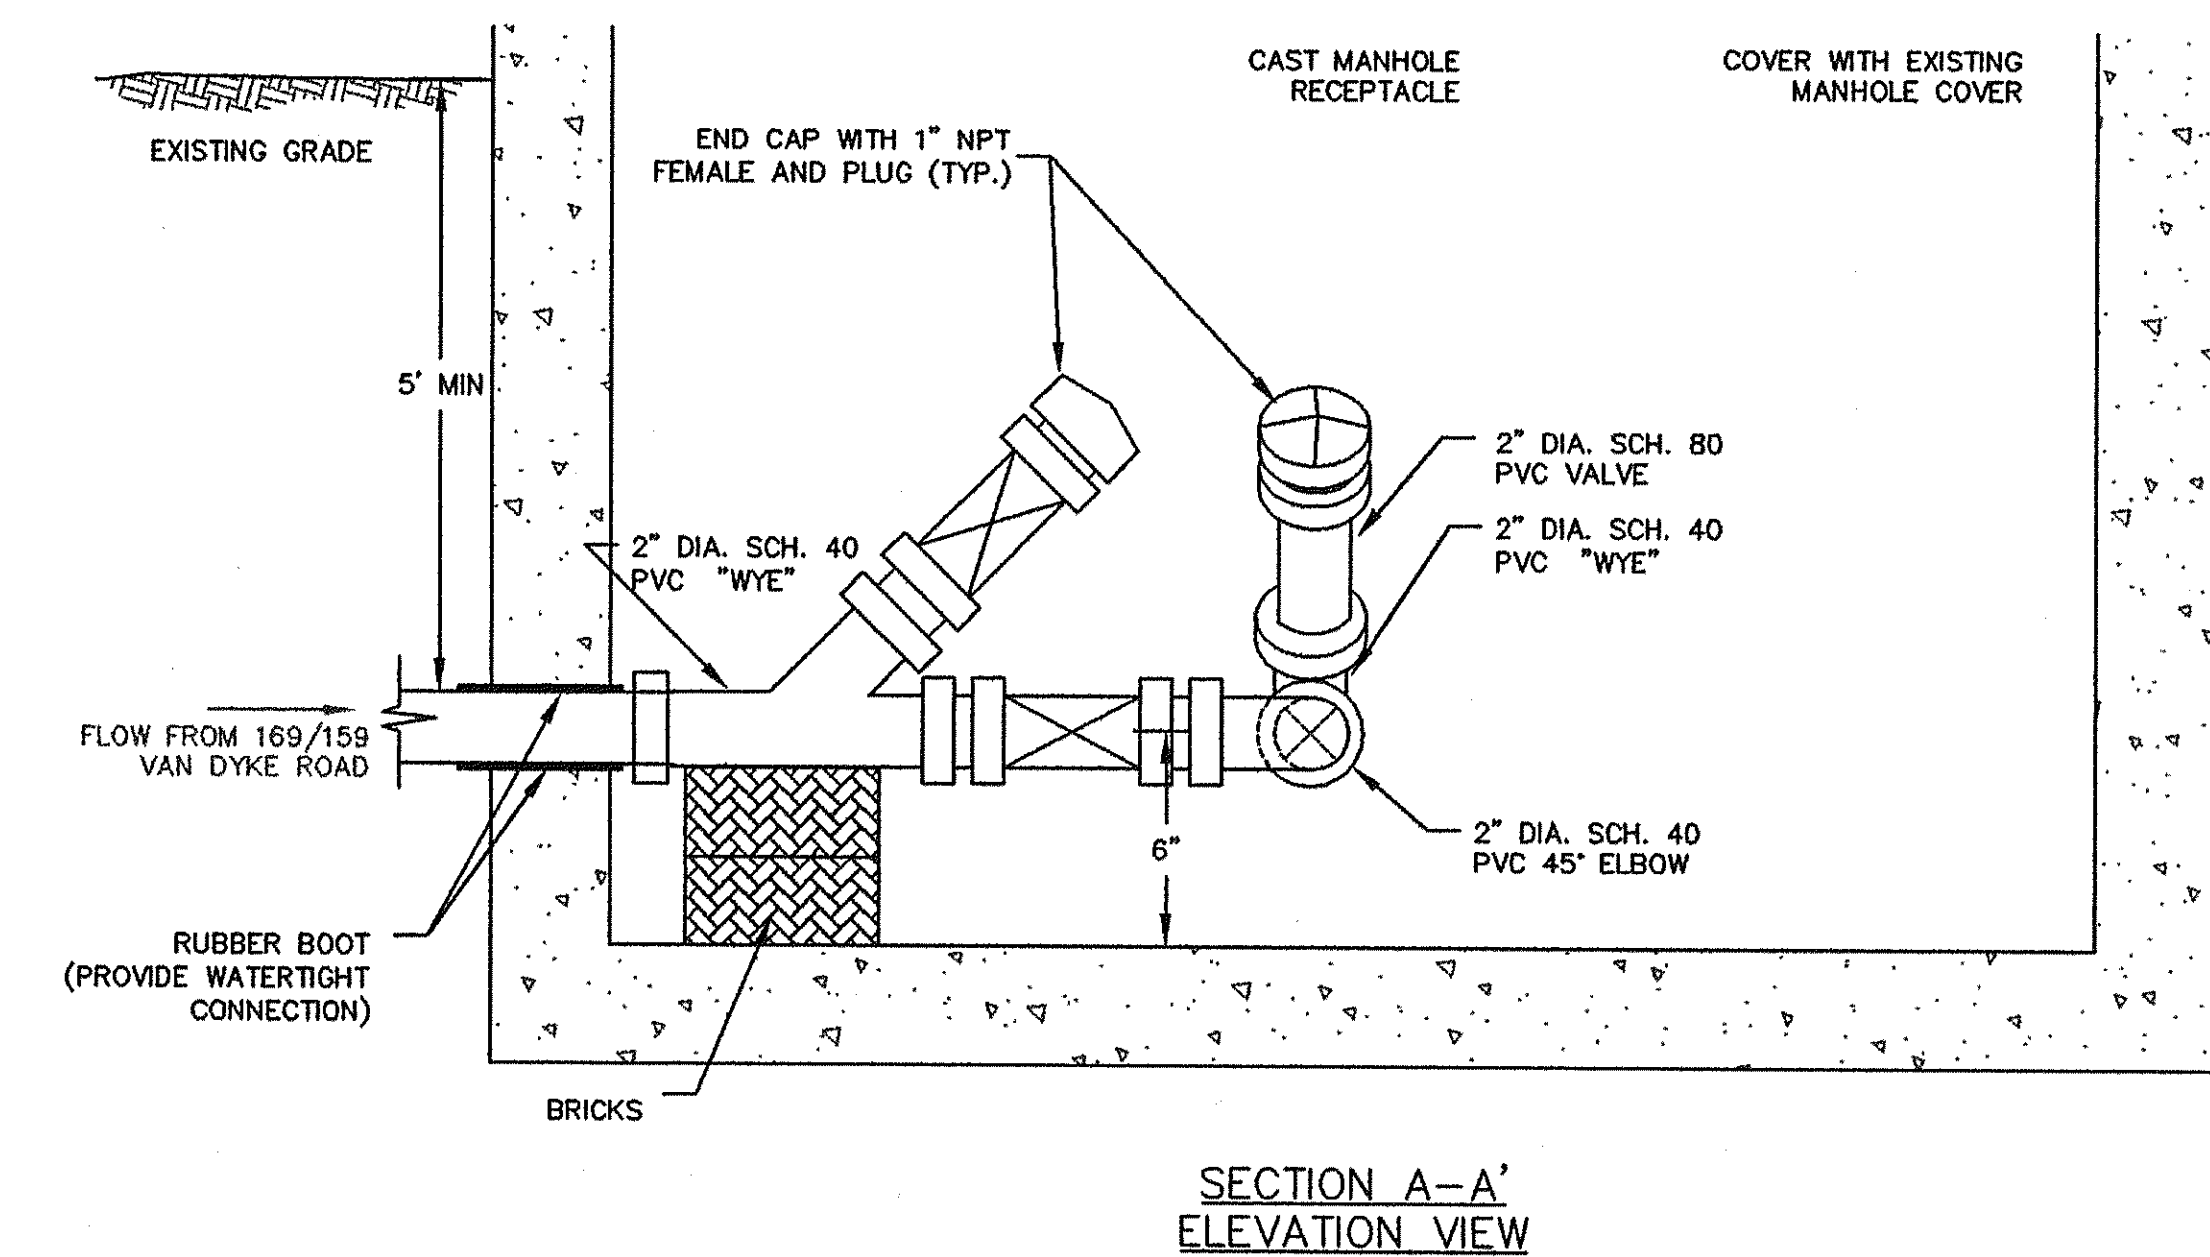
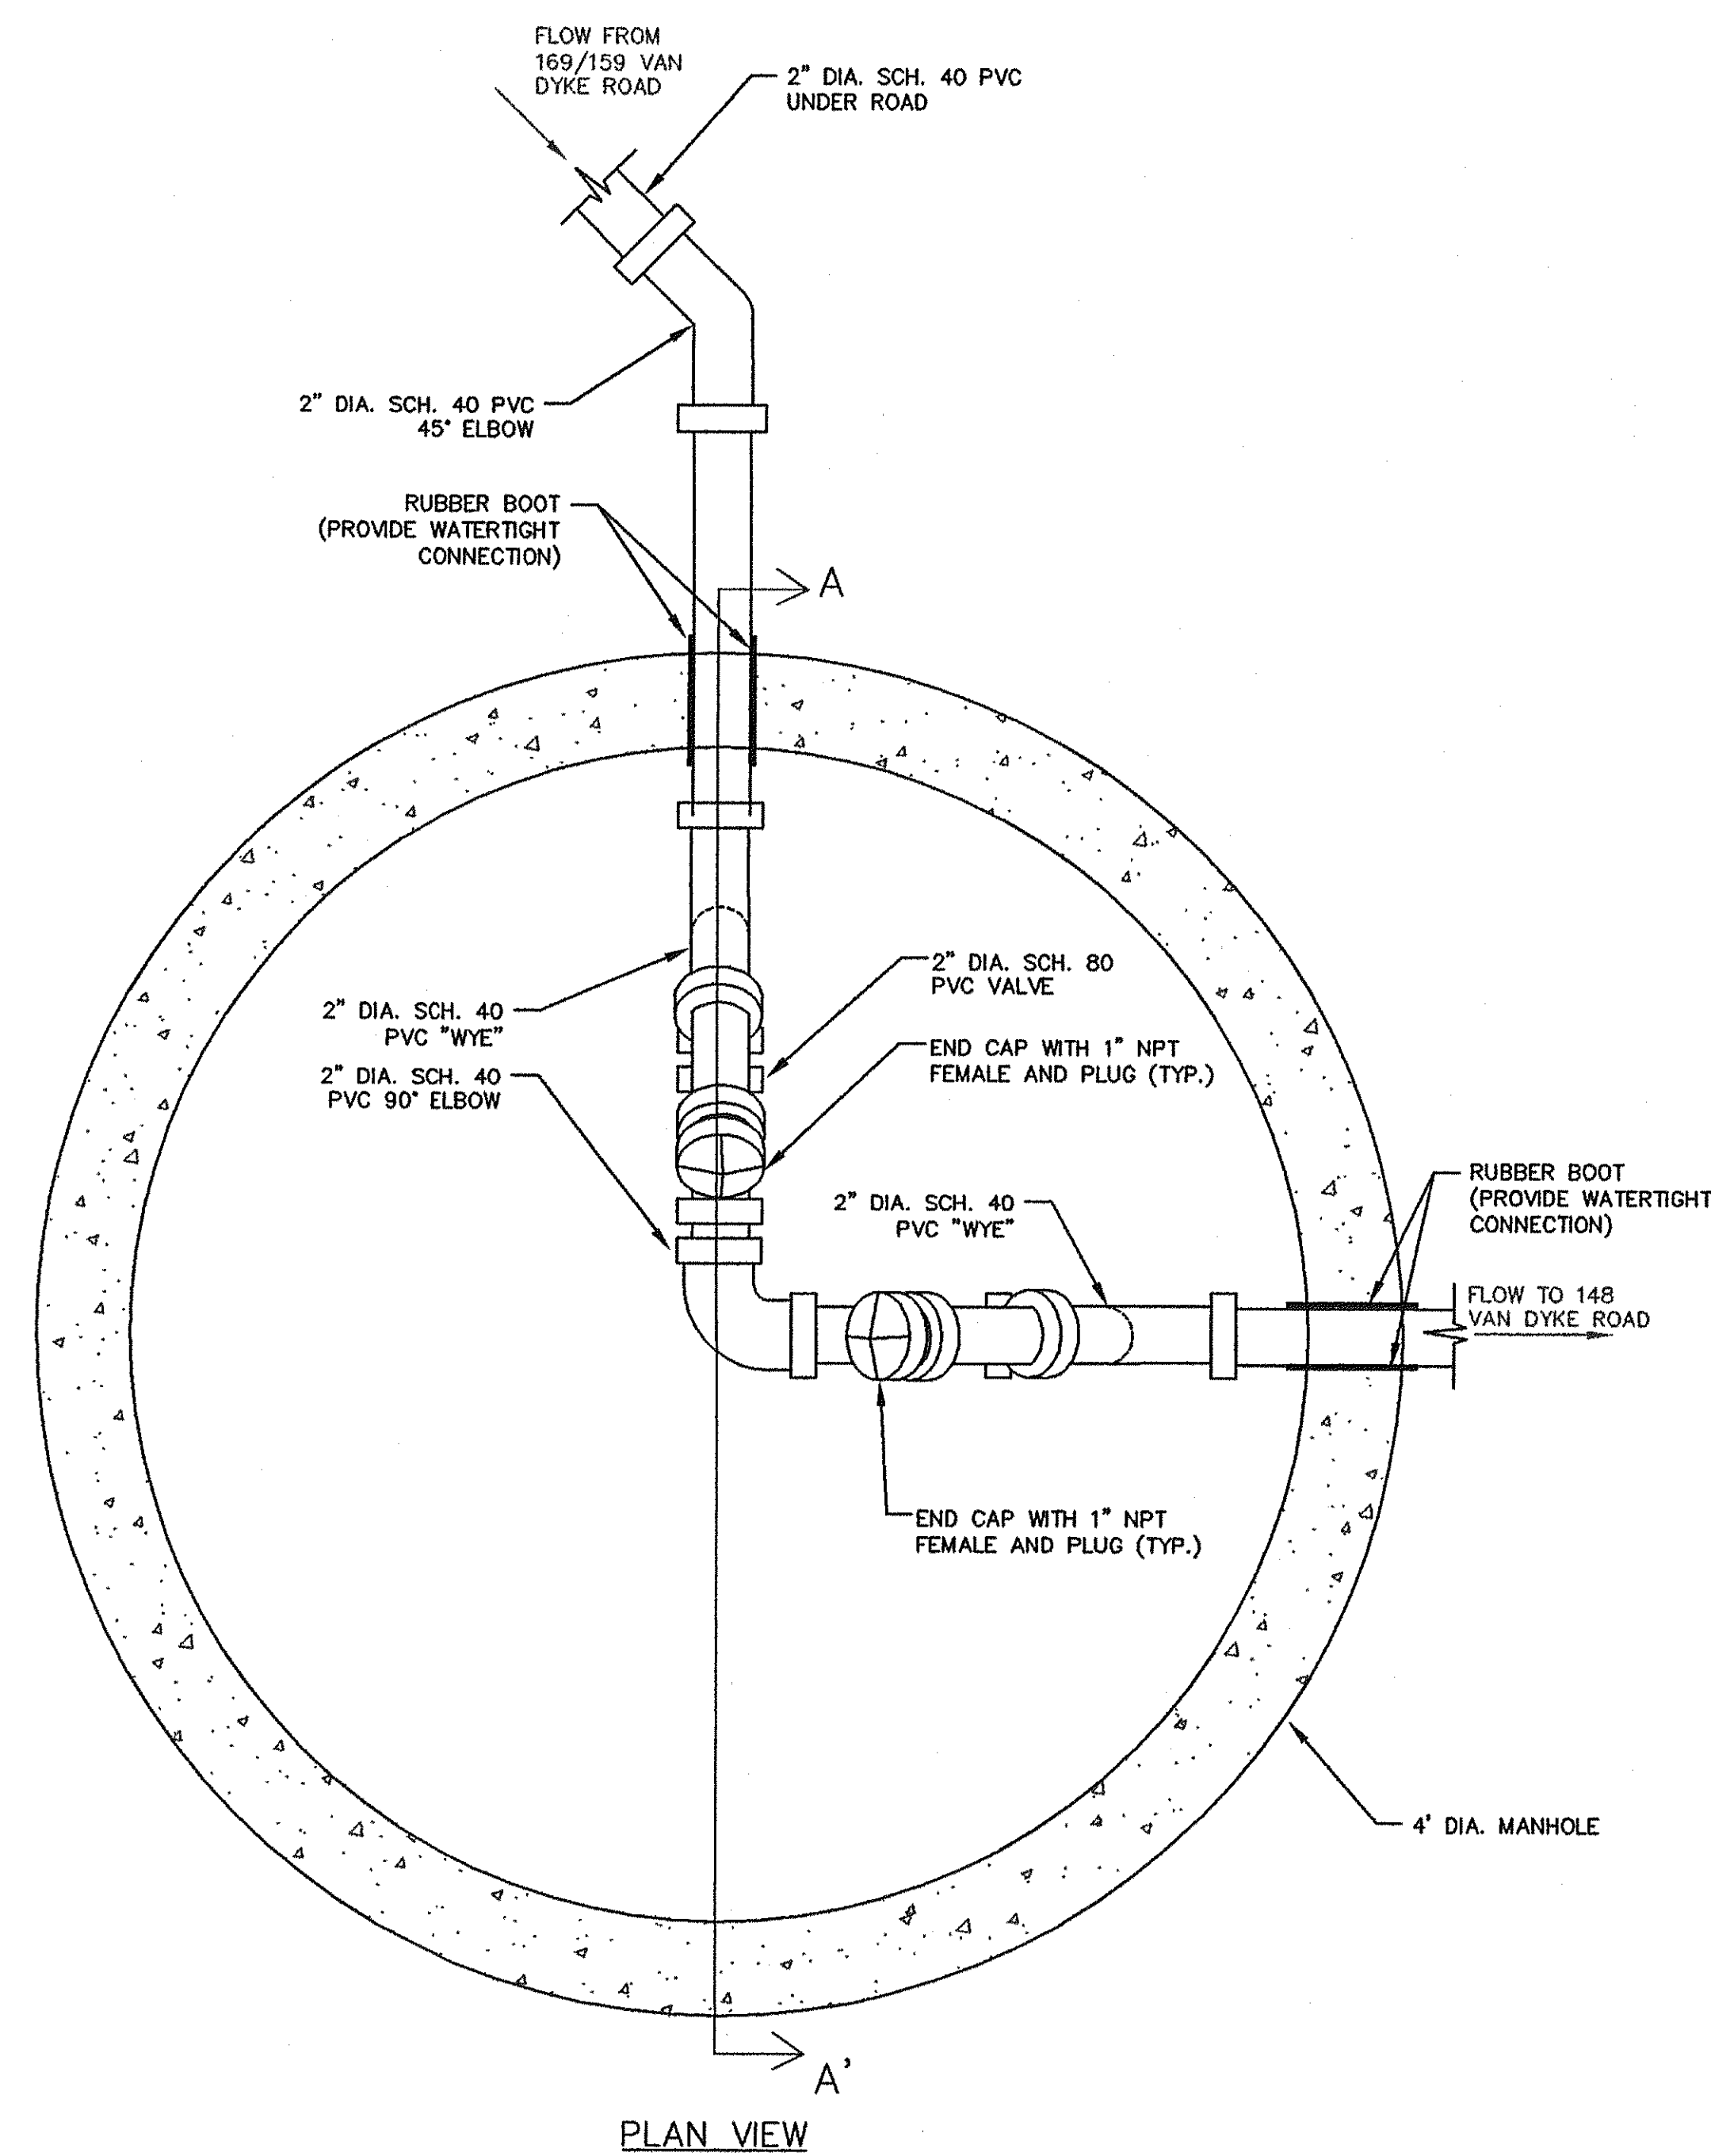


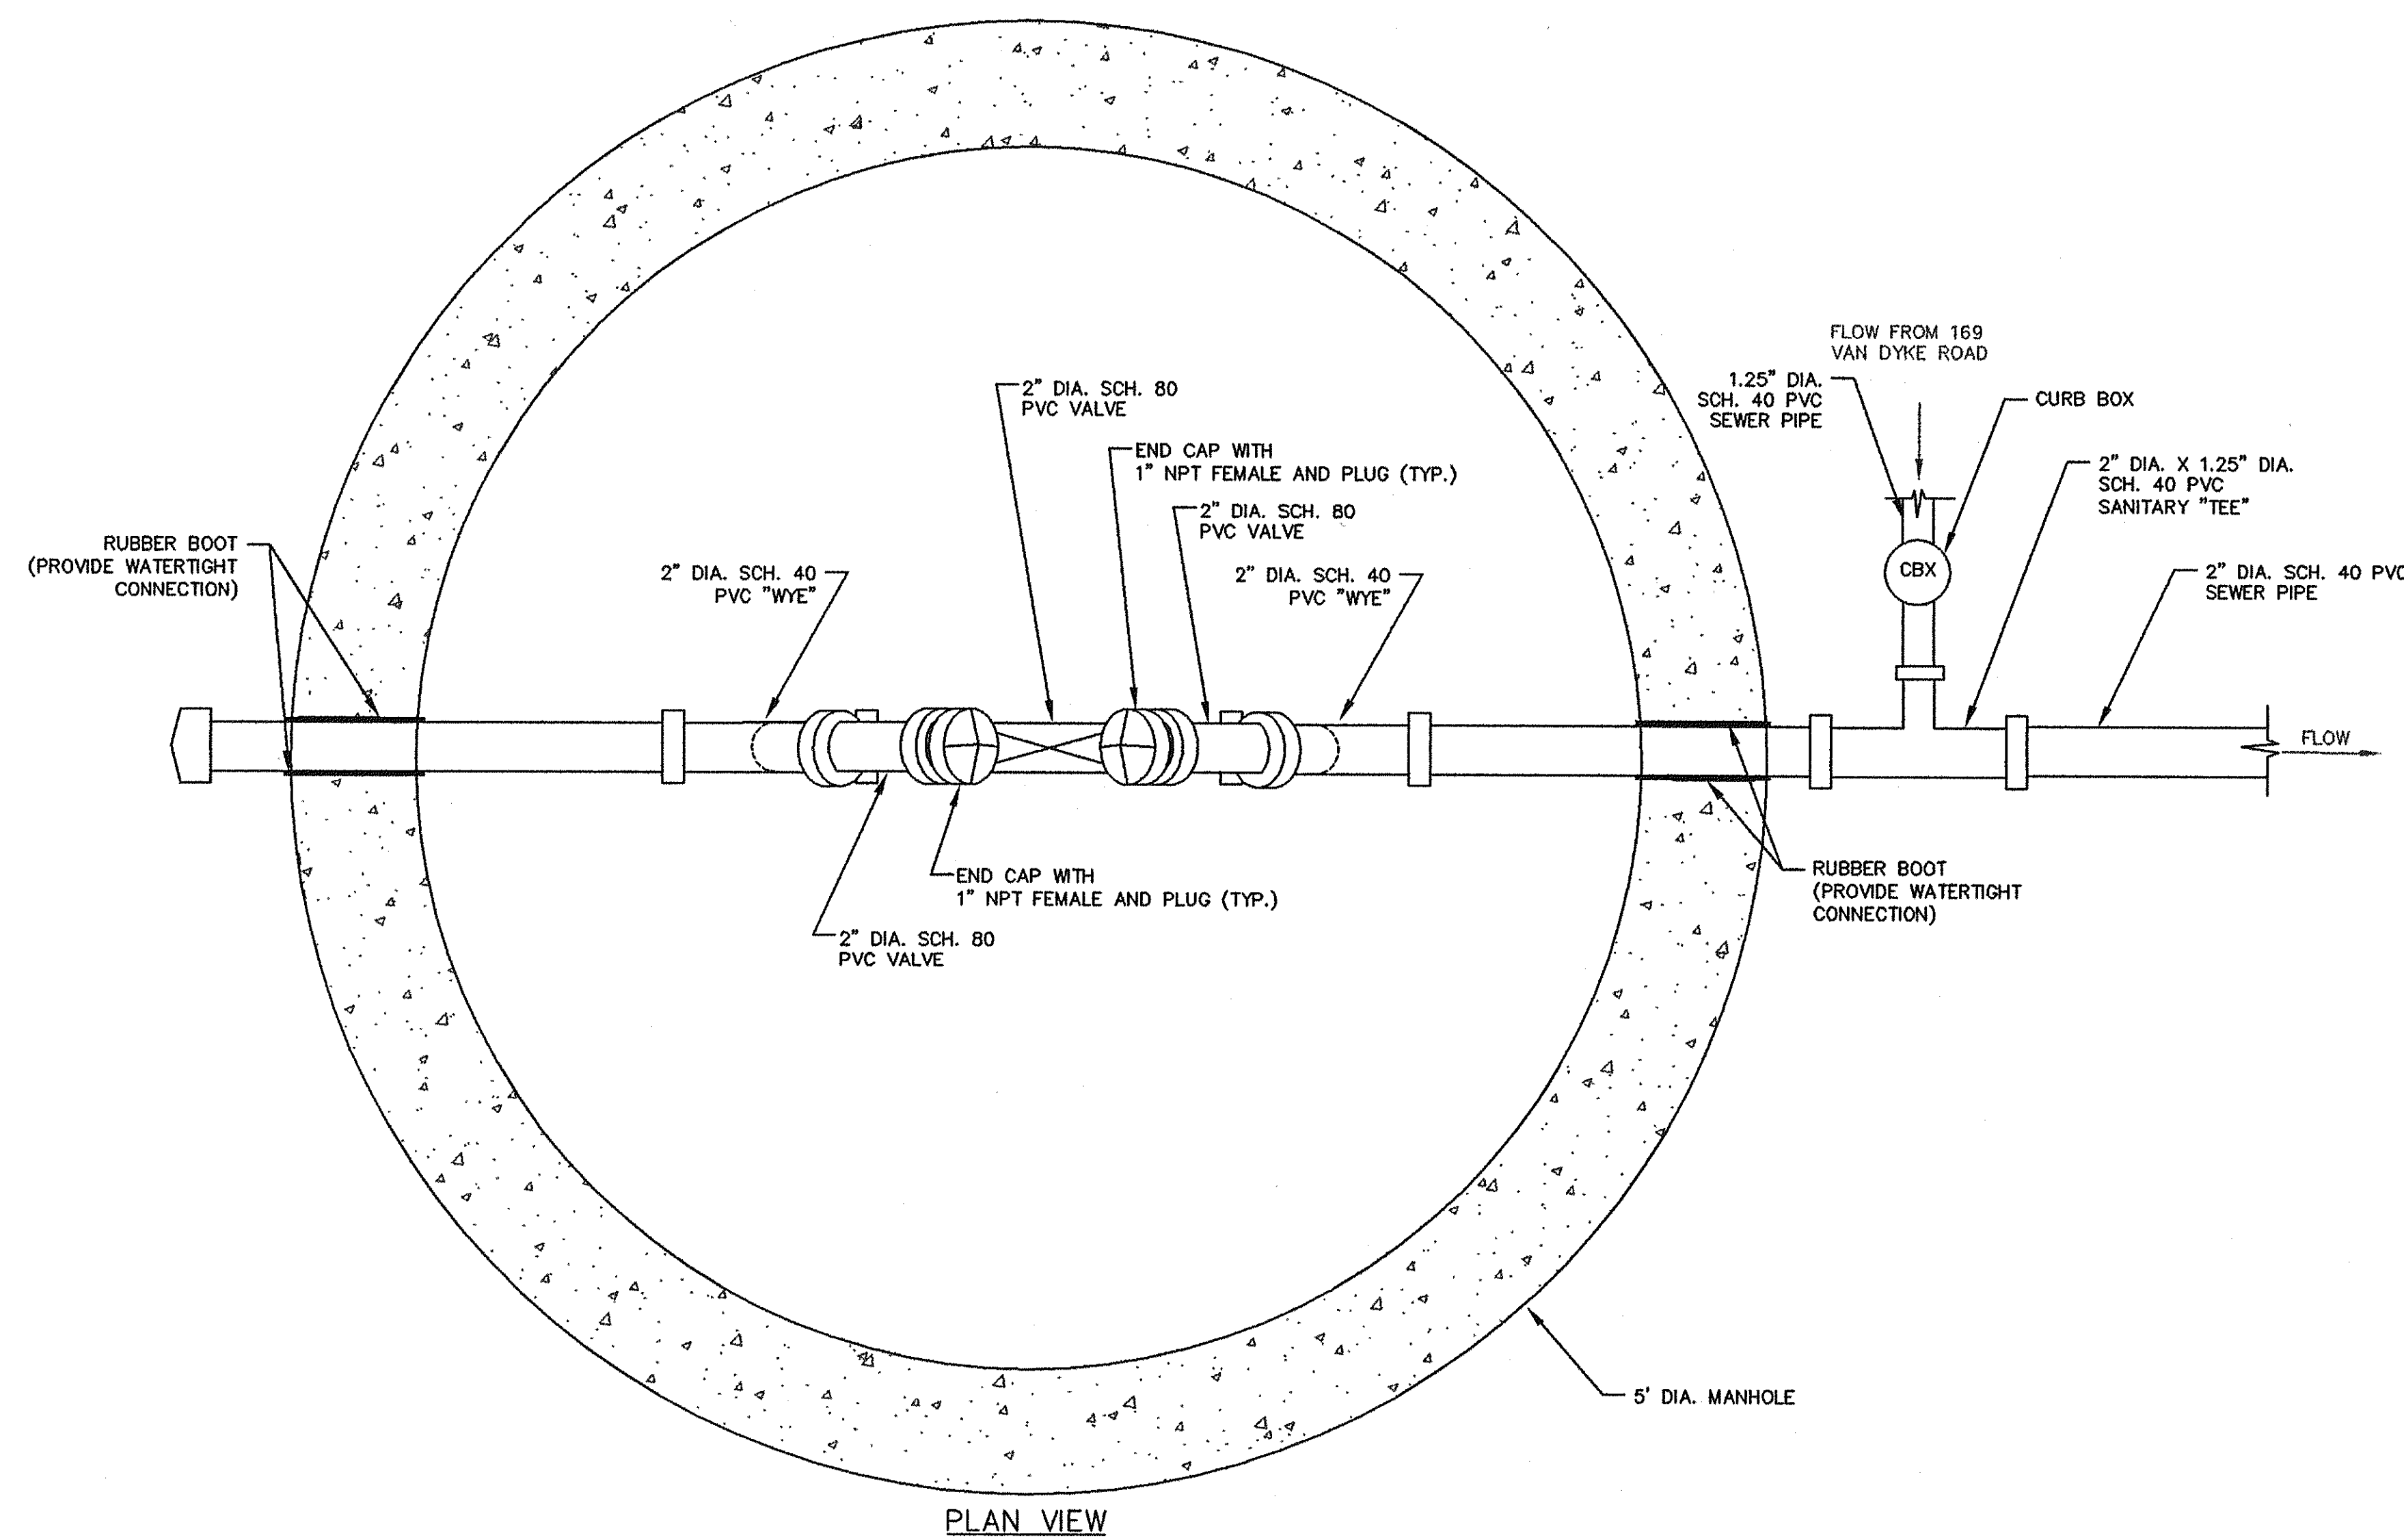


TOWN SEWER LINE TERMINATION AND
TIE IN FOR 169 VAN DYKE DETAIL 3/2
1" = 8'


NOTE: USE LOCATOR WIRE #12 AWG SINGLE CONDUCTOR
STRANDED COPPER W/TW 600 VOLT INSULATION

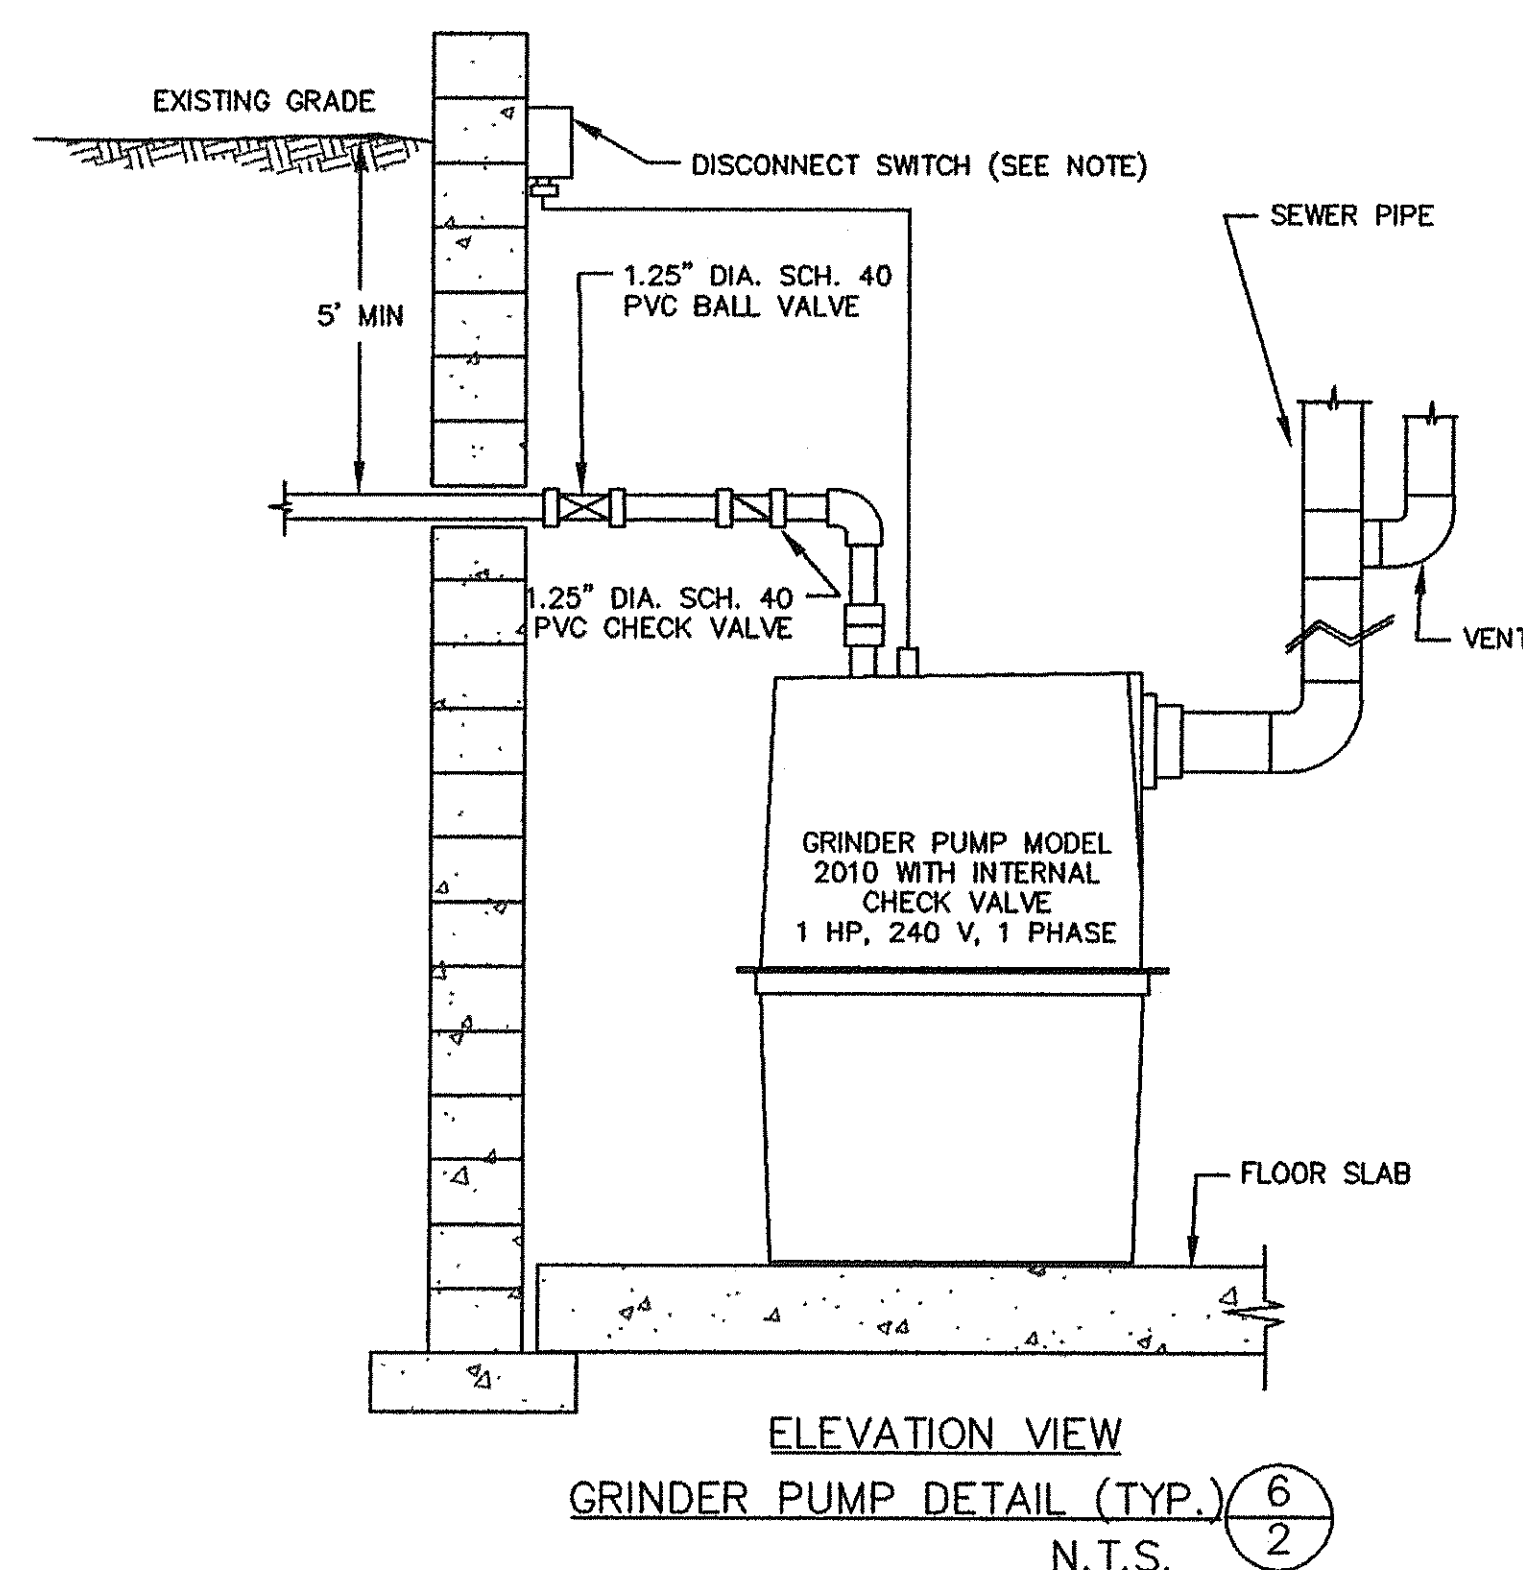

NOTE: GENERATOR ACCESSIBILITY TO BE
PROVIDED AT POWER SUPPLY. DISCONNECT
SWITCH TO BE INSTALLED AT POWER SUPPLY.

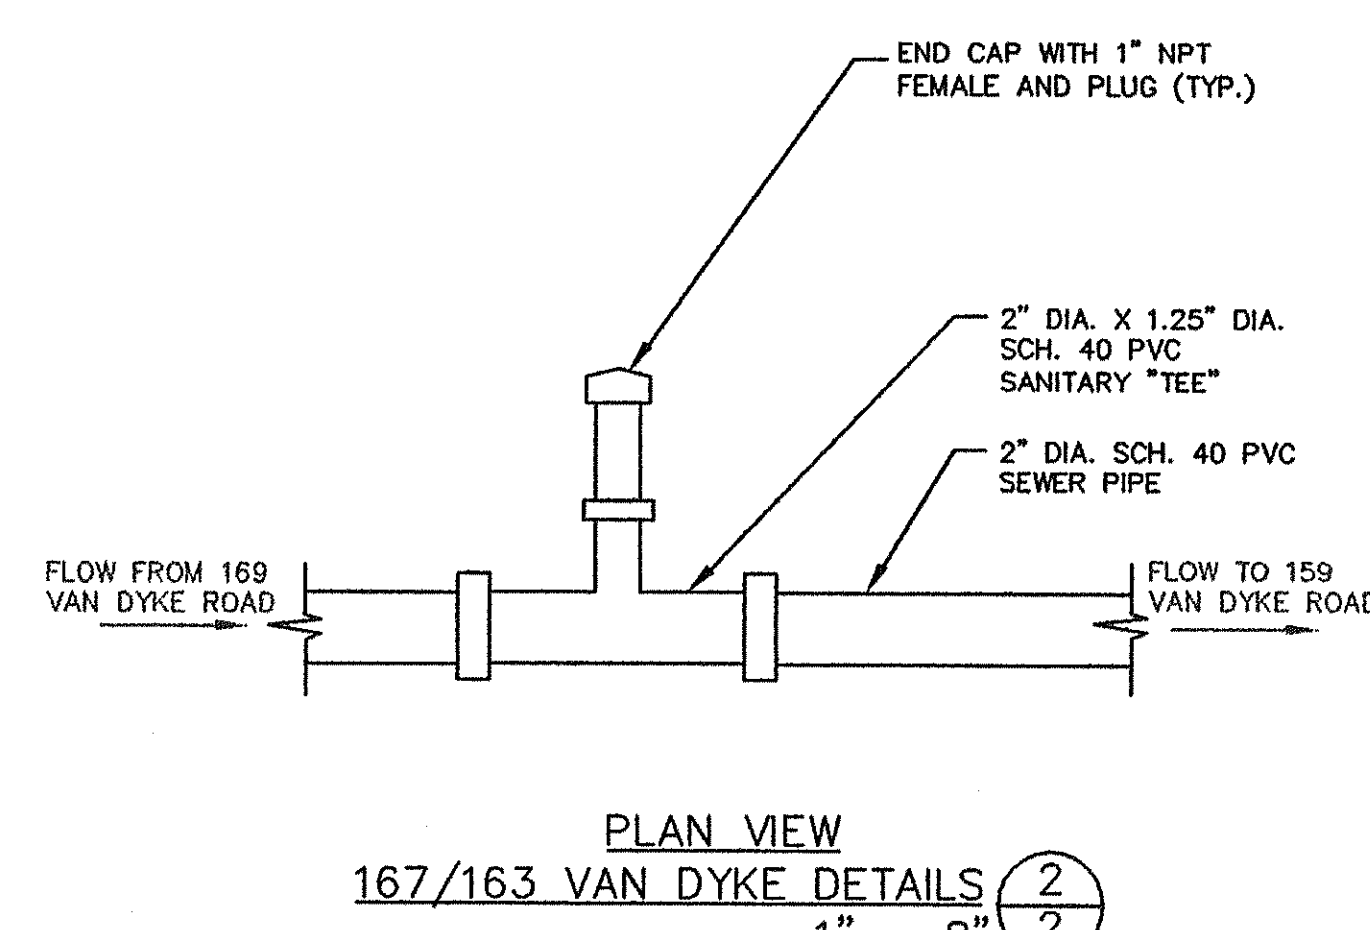


NOTE: USE LOCATOR WIRE #12 AWG SINGLE CONDUCTOR
STRANDED COPPER W/TW 600 VOLT INSULATION

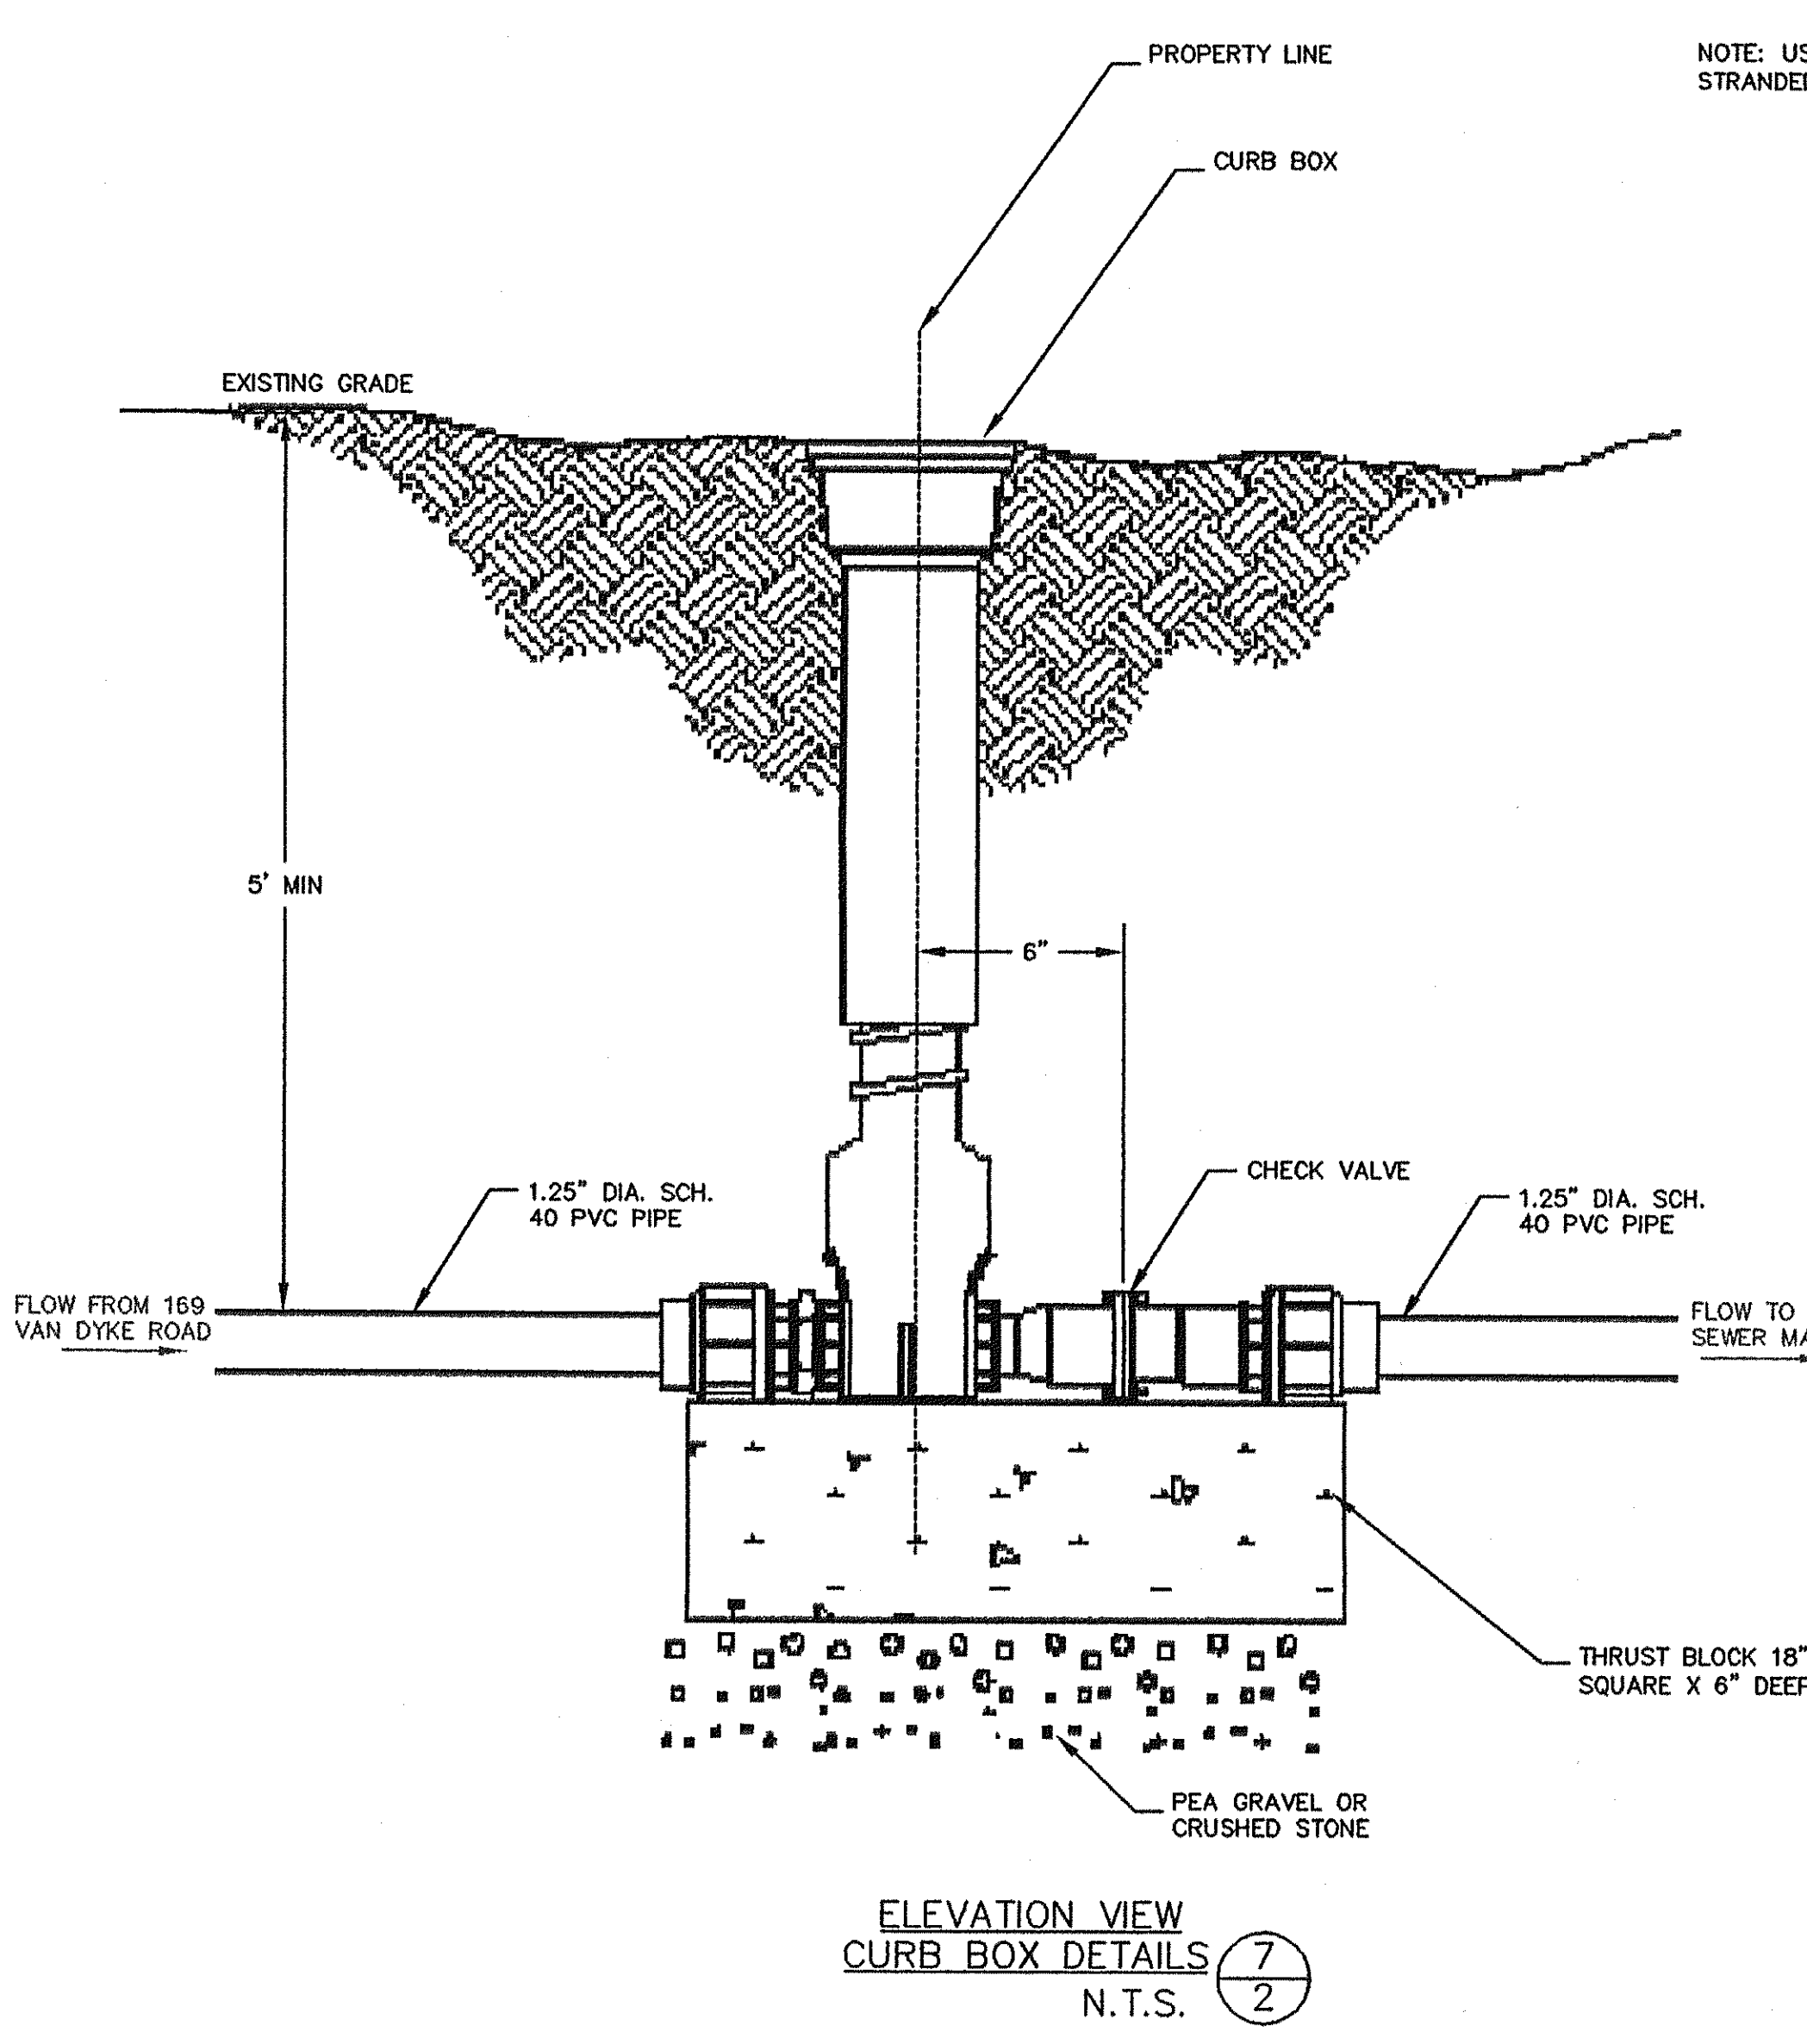

CLEANOUT DETAIL 1/2
1" = 8'

NOTE: USE LOCATOR WIRE #12 AWG SINGLE CONDUCTOR
STRANDED COPPER W/TW 600 VOLT INSULATION

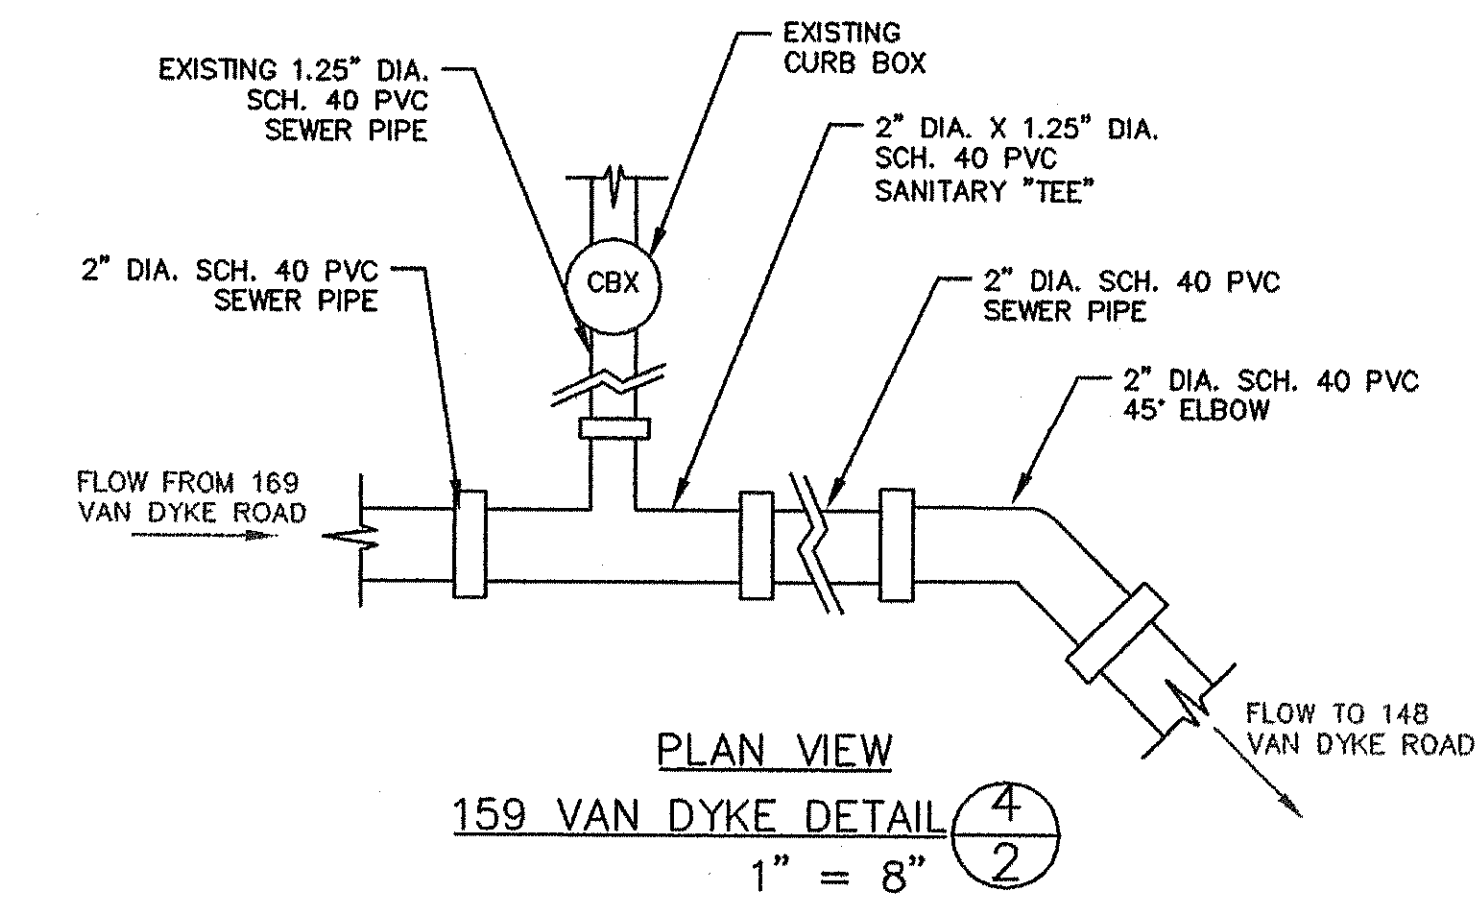

NOTE: USE LOCATOR WIRE #12 AWG SINGLE CONDUCTOR
STRANDED COPPER W/TW 600 VOLT INSULATION



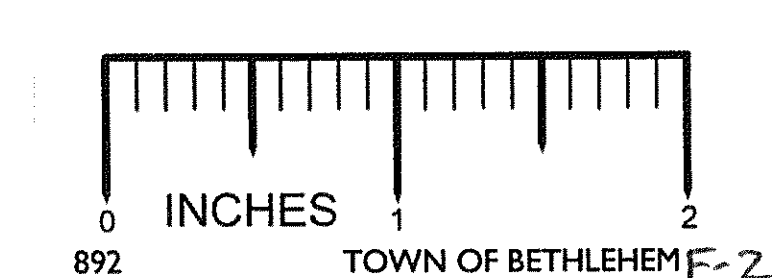


PLATE 2

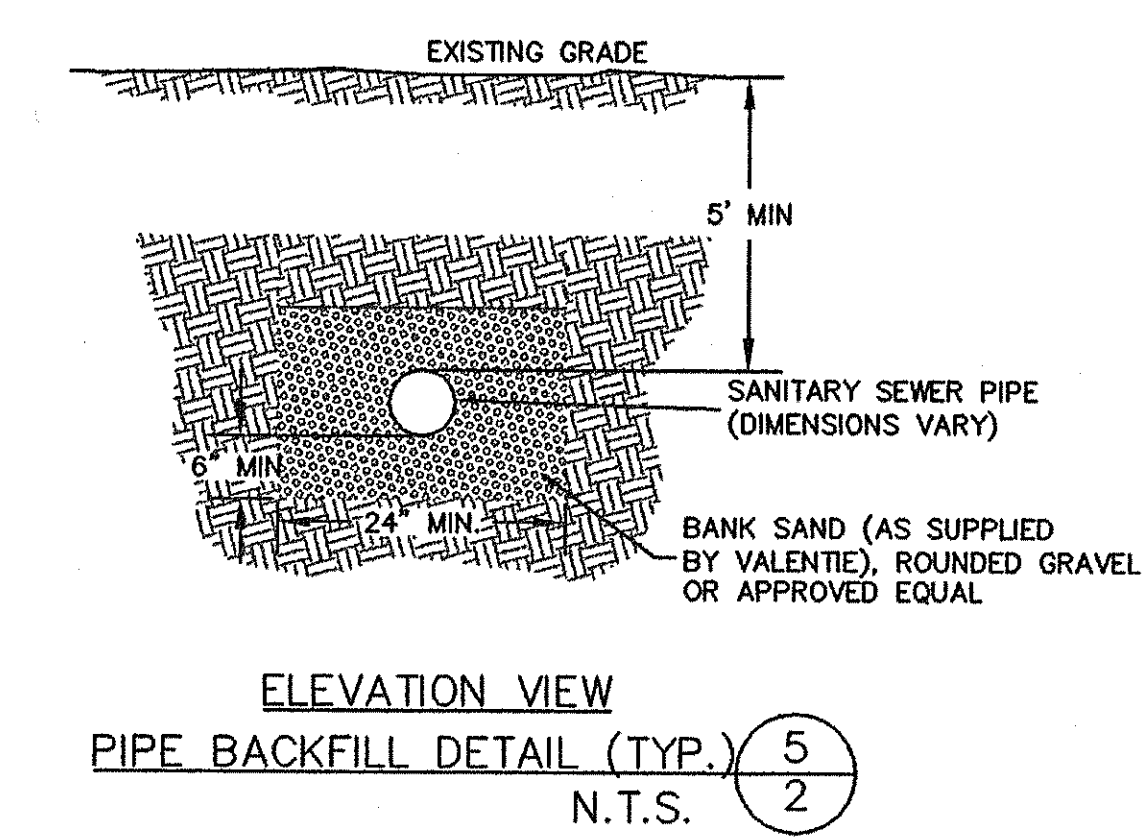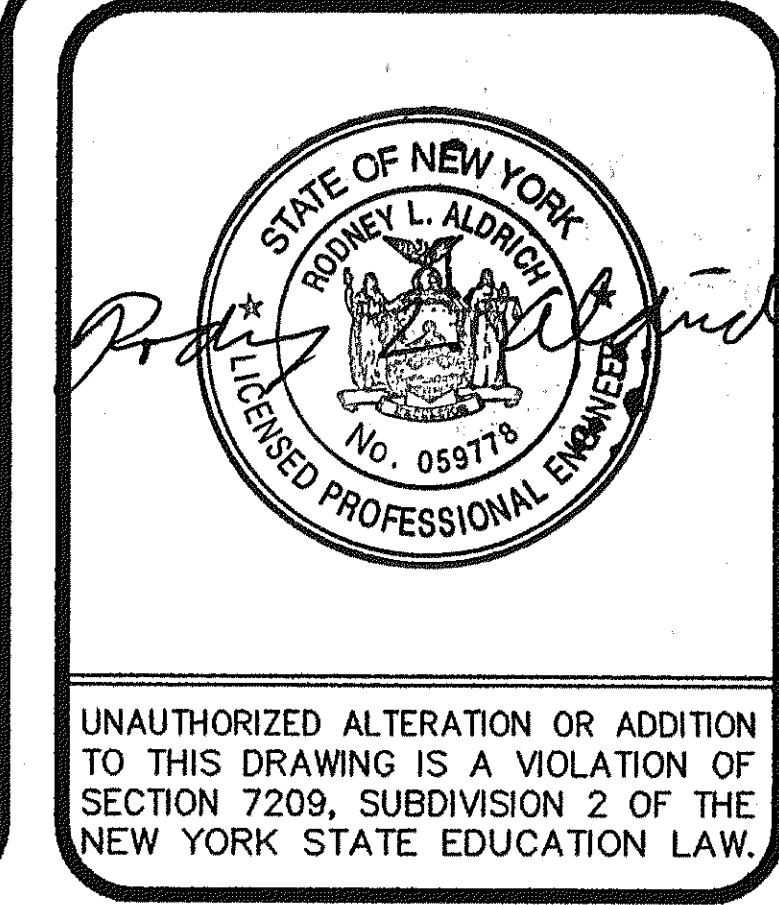

NO.	DATE	RECORD OF WORK	DRN	CKD	APPR
1	10/15/04	MODIFIED DETAILS 1/2 AND 3/2 PER TOWN ENGINEER	AK	RLA	RLA
2	12/14/04	MODIFIED DETAIL 5/2 AND ADDED DETAIL 7/2 PER ALBANY COUNTY ENGINEER	AK	RLA	RLA
3	02/04/05	MODIFIED DETAIL 5/2 AND ADDED DETAIL 7/2-ADDED DIMENSION BETWEEN CHECK VALVE AND CL OF CURB BOX	AK	RLA	RLA

PROJECT	
PROJ. ENGR.:	R. L. Aldrich, P.E.
PROJ. NO.:	24048
PREPARED BY:	R. L. Aldrich, P.E.
DRAFTED BY:	A. Kohli
CHECKED BY:	
APPROVED BY:	
DATUM:	
CONTOUR INTERVAL =	FEET

DETAILS
VAN DYKE ROAD SEWER SYSTEM
TOWN OF BETHLEHEM
ENGINEERING DIVISION
TOWN OF DELMAR ALBANY CO., N.Y.

STERLING
Sterling Environmental Engineering, P.C.
24 Wade Road • Latham, New York 12110

DATE: 9/10/04 SCALE: AS SHOWN DWG. NO. 24048002 SHEET 2 OF 2

ALBANY COUNTY DEPARTMENT OF HEALTH
DIVISION OF ENVIRONMENTAL HEALTH SERVICES
By direction of the Commissioner of Health, these
plans are hereby approved. See first sheet for
date and signature.