

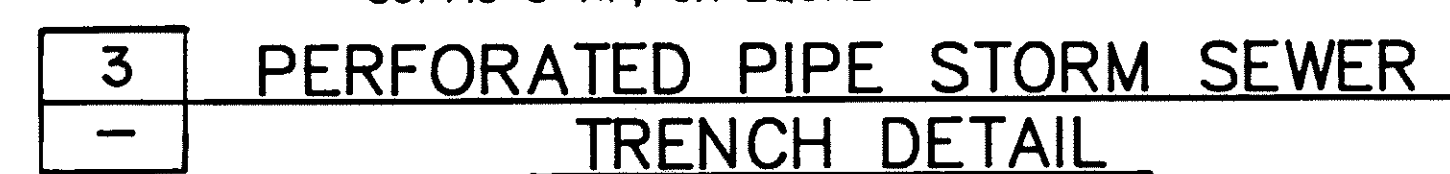
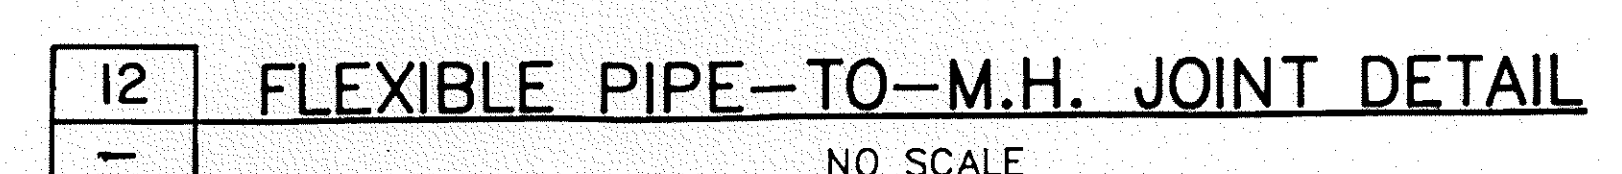
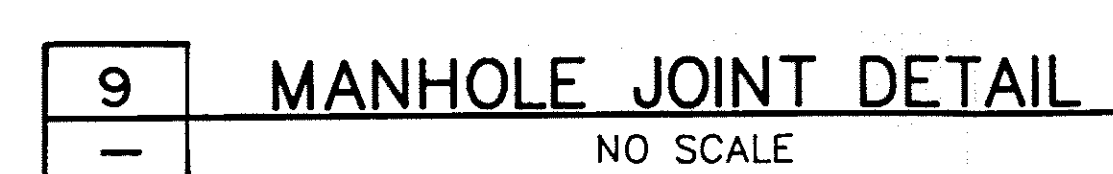
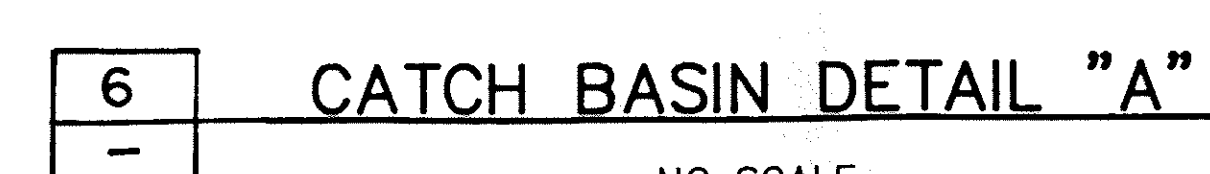
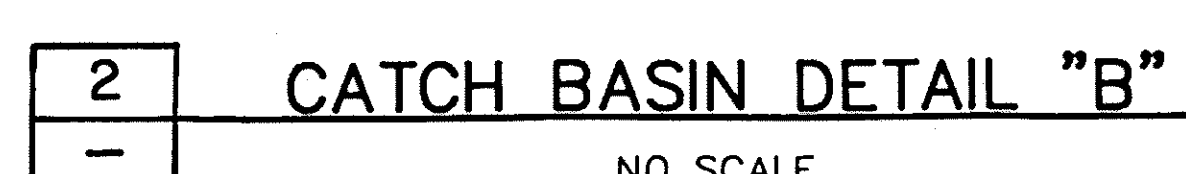


THE MORE STRINGENT REQUIREMENT  
IN EACH CODE SHALL APPLY.

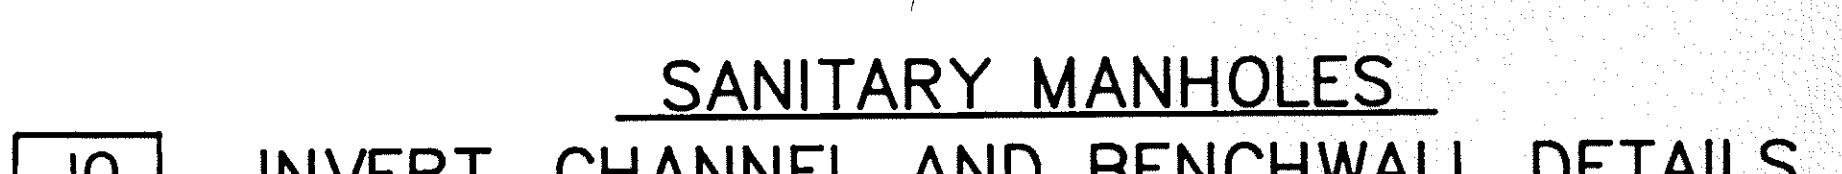

NOTE: CONFORM TO ALL TOWN OF BETHLEHEM STANDARDS  
FOR MANHOLE AND SEWER CONSTRUCTION WITHIN TOWN  
RIGHT-OF-WAY AND EASEMENTS.

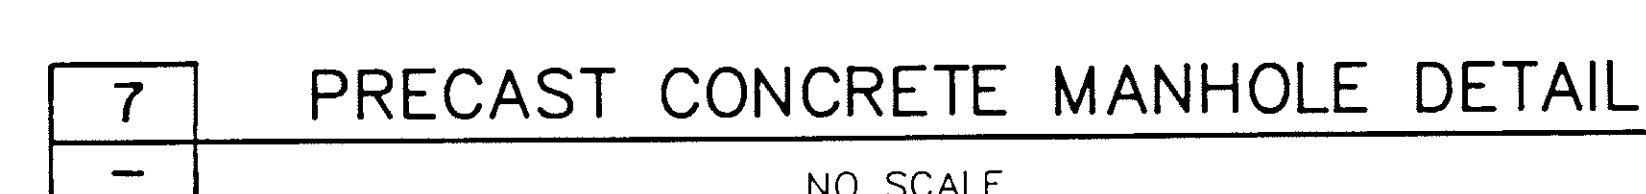

|                           | TABLE         |                         |
|---------------------------|---------------|-------------------------|
| OUTLET SEWER<br>PIPE SIZE | "0" DIA. MIN. | "1" WALL THICKNESS MIN. |
| 8" THRU 24"               | 4'-0"         | 5"                      |
| 30"                       | 5'-0"         | 6"                      |
| INSIDE DROP               | 5'-0"         | 6"                      |



|    |                                       |
|----|---------------------------------------|
| 10 | INVERT, CHANNEL AND BENCHWALL DETAILS |
| -  |                                       |

