



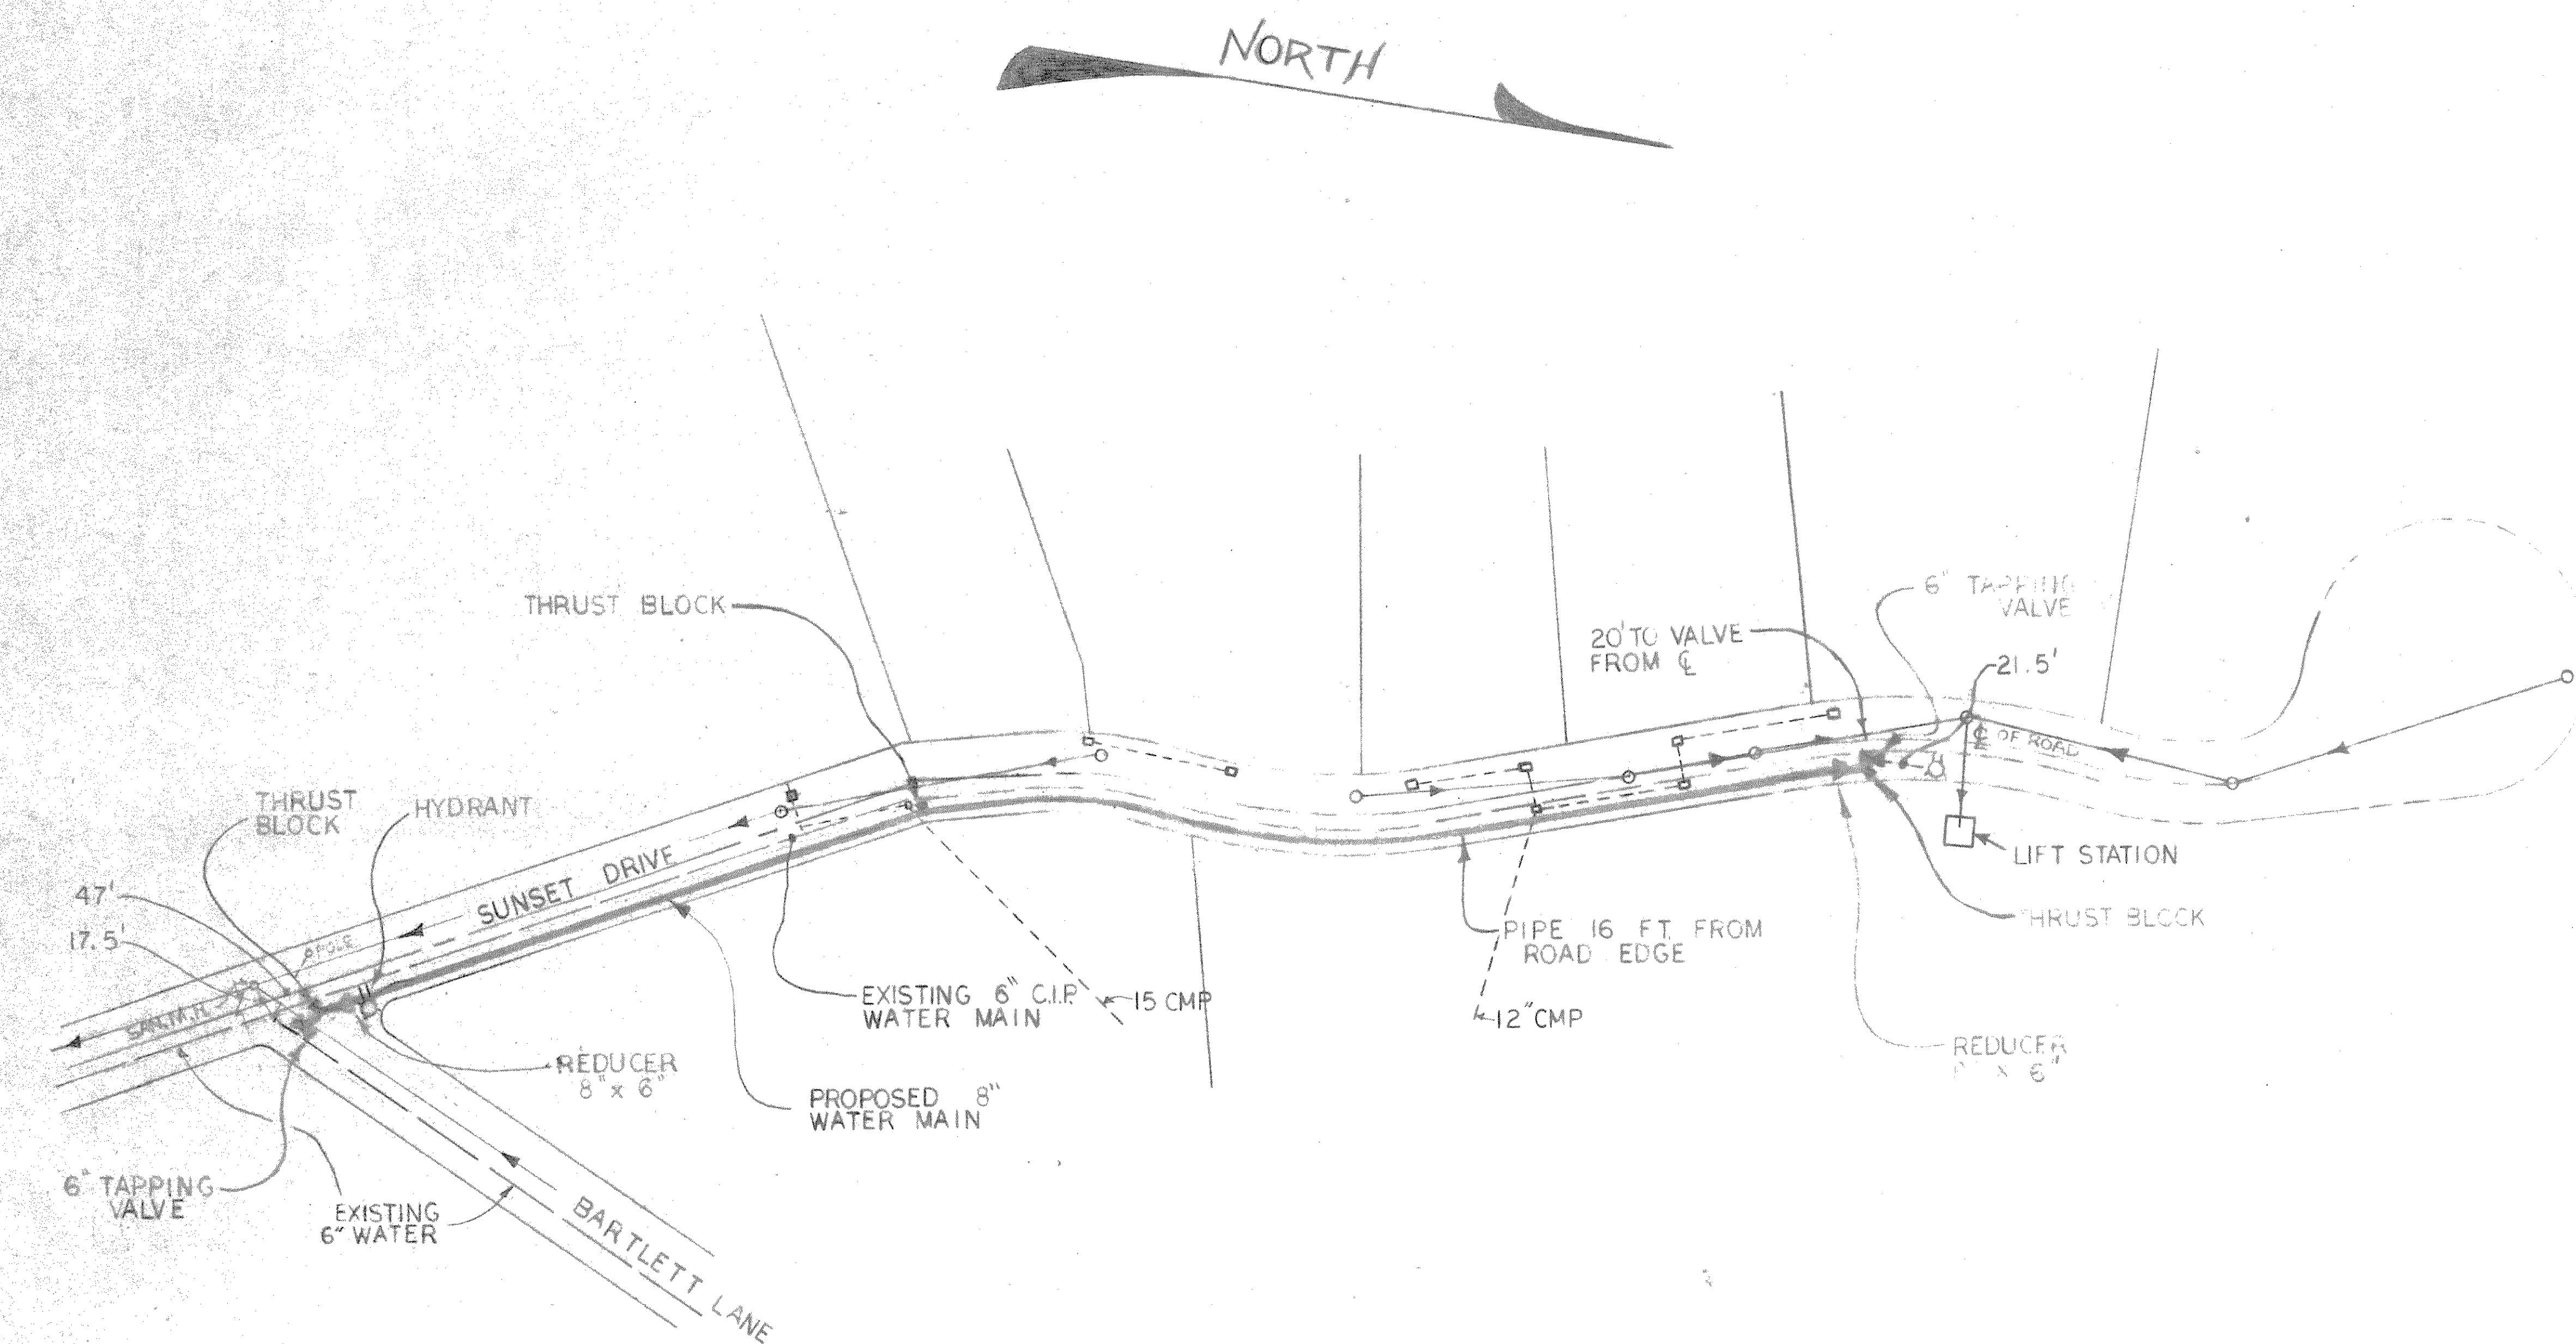

LEGEND

- S --- STORM SEWER
- S --- SANITARY SEWER
- EXISTING 6" WATER MAIN
- PROPOSED WATER MAIN 8"
- HYDRANT

PLAN - SUNSET DRIVE
SCALE: 1" = 40'

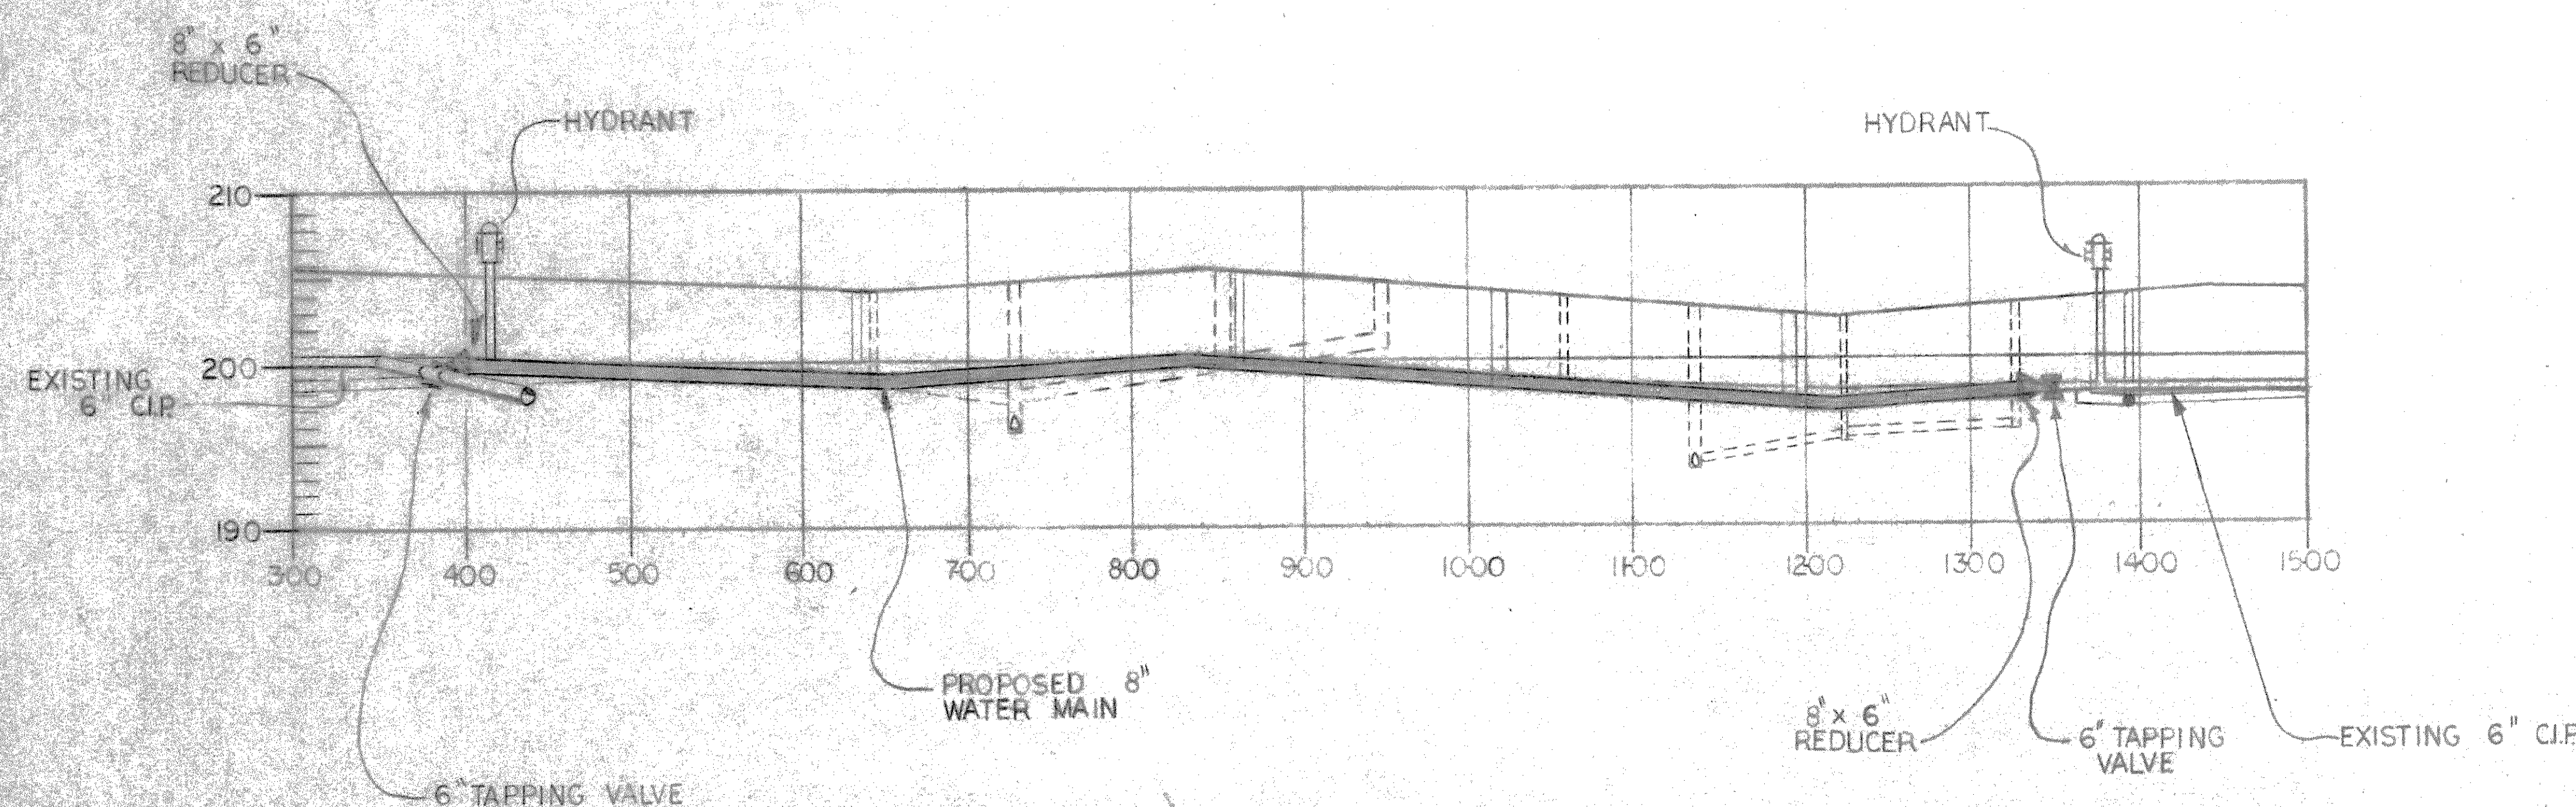




PROFILE - SUNSET DRIVE
SCALE: HORIZ. 1" = 100' VERT. 1" = 10'

LEGEND

- S --- STORM SEWER
- S --- SANITARY SEWER
- VALVE --- REDUCER PROPOSED 8" C.I.P. WATER MAIN
- EXISTING WATER MAIN 6"
- THRUST BLOCK
- HYDRANT

NOTES:

1. ALL MAINS TO BE PRESSURE & LEAKAGE TESTED, AND STERILIZED TO CONFORM TO N.Y.S.D.E.C. AND AWWA REQUIREMENTS.
2. AT SANITARY SEWER CROSSINGS, WATER MAINS MUST BE A MINIMUM OF 18" FROM THE INVERT OF THE WATER MAIN TO THE CROWN OF THE SEWER.
3. A 6" MINIMUM CLEARANCE AT SEWER CROSSINGS.

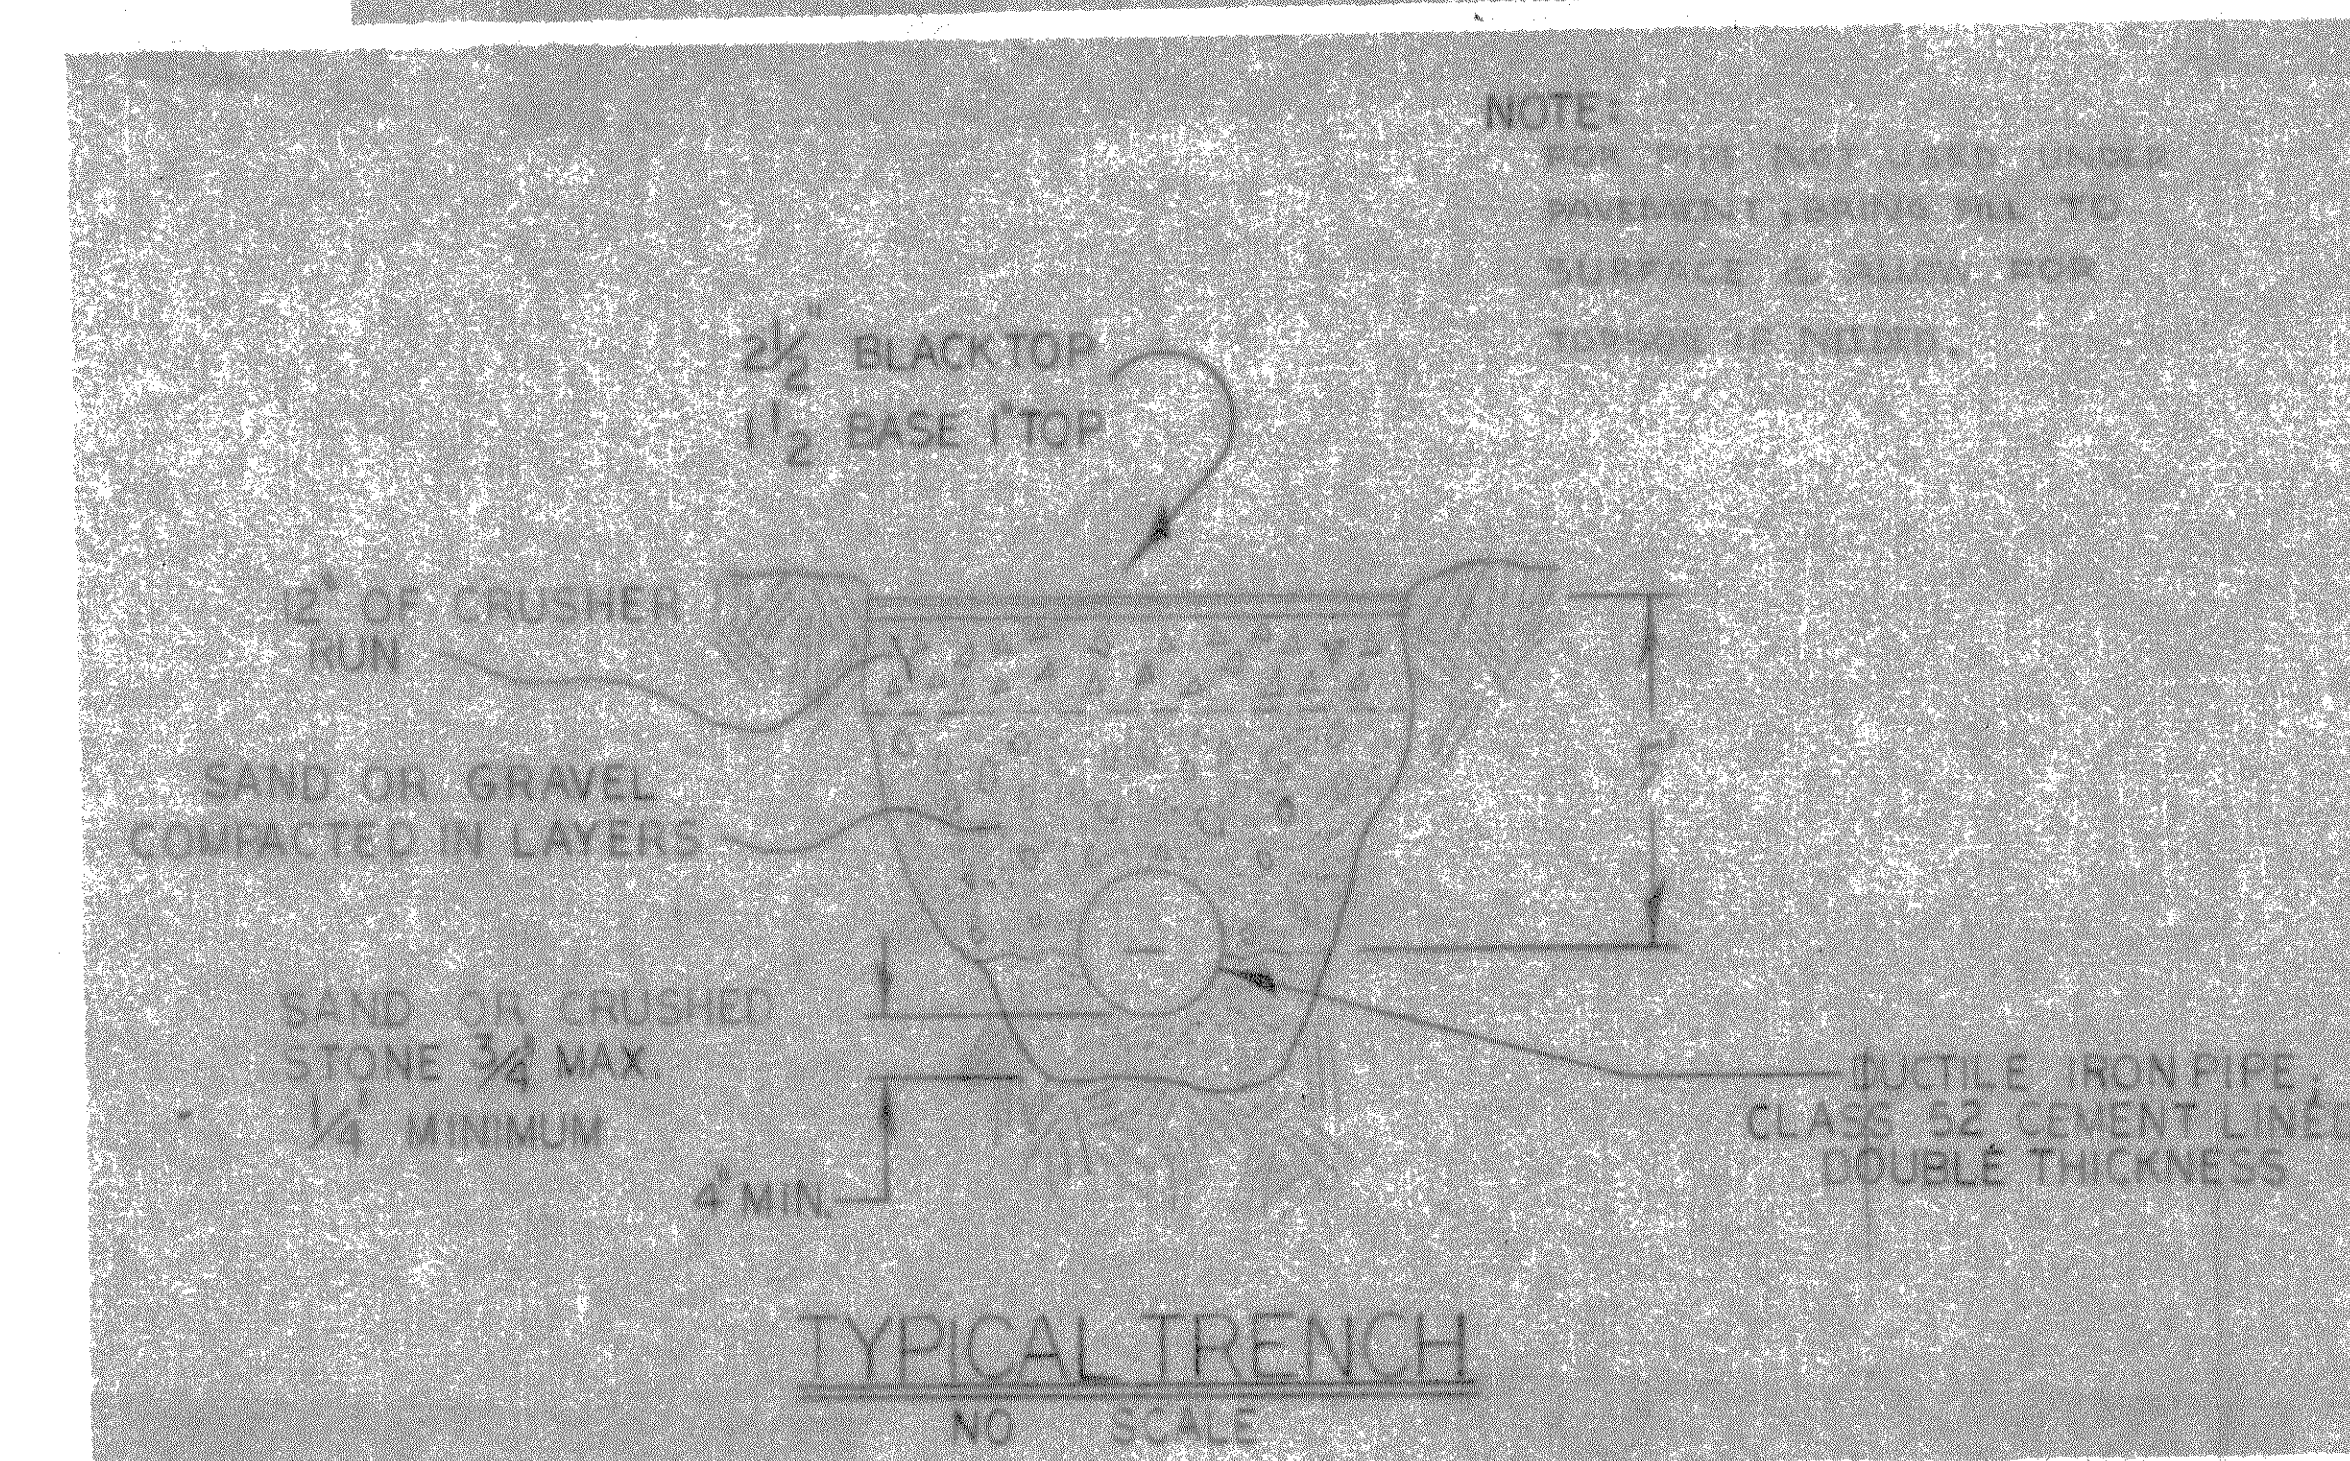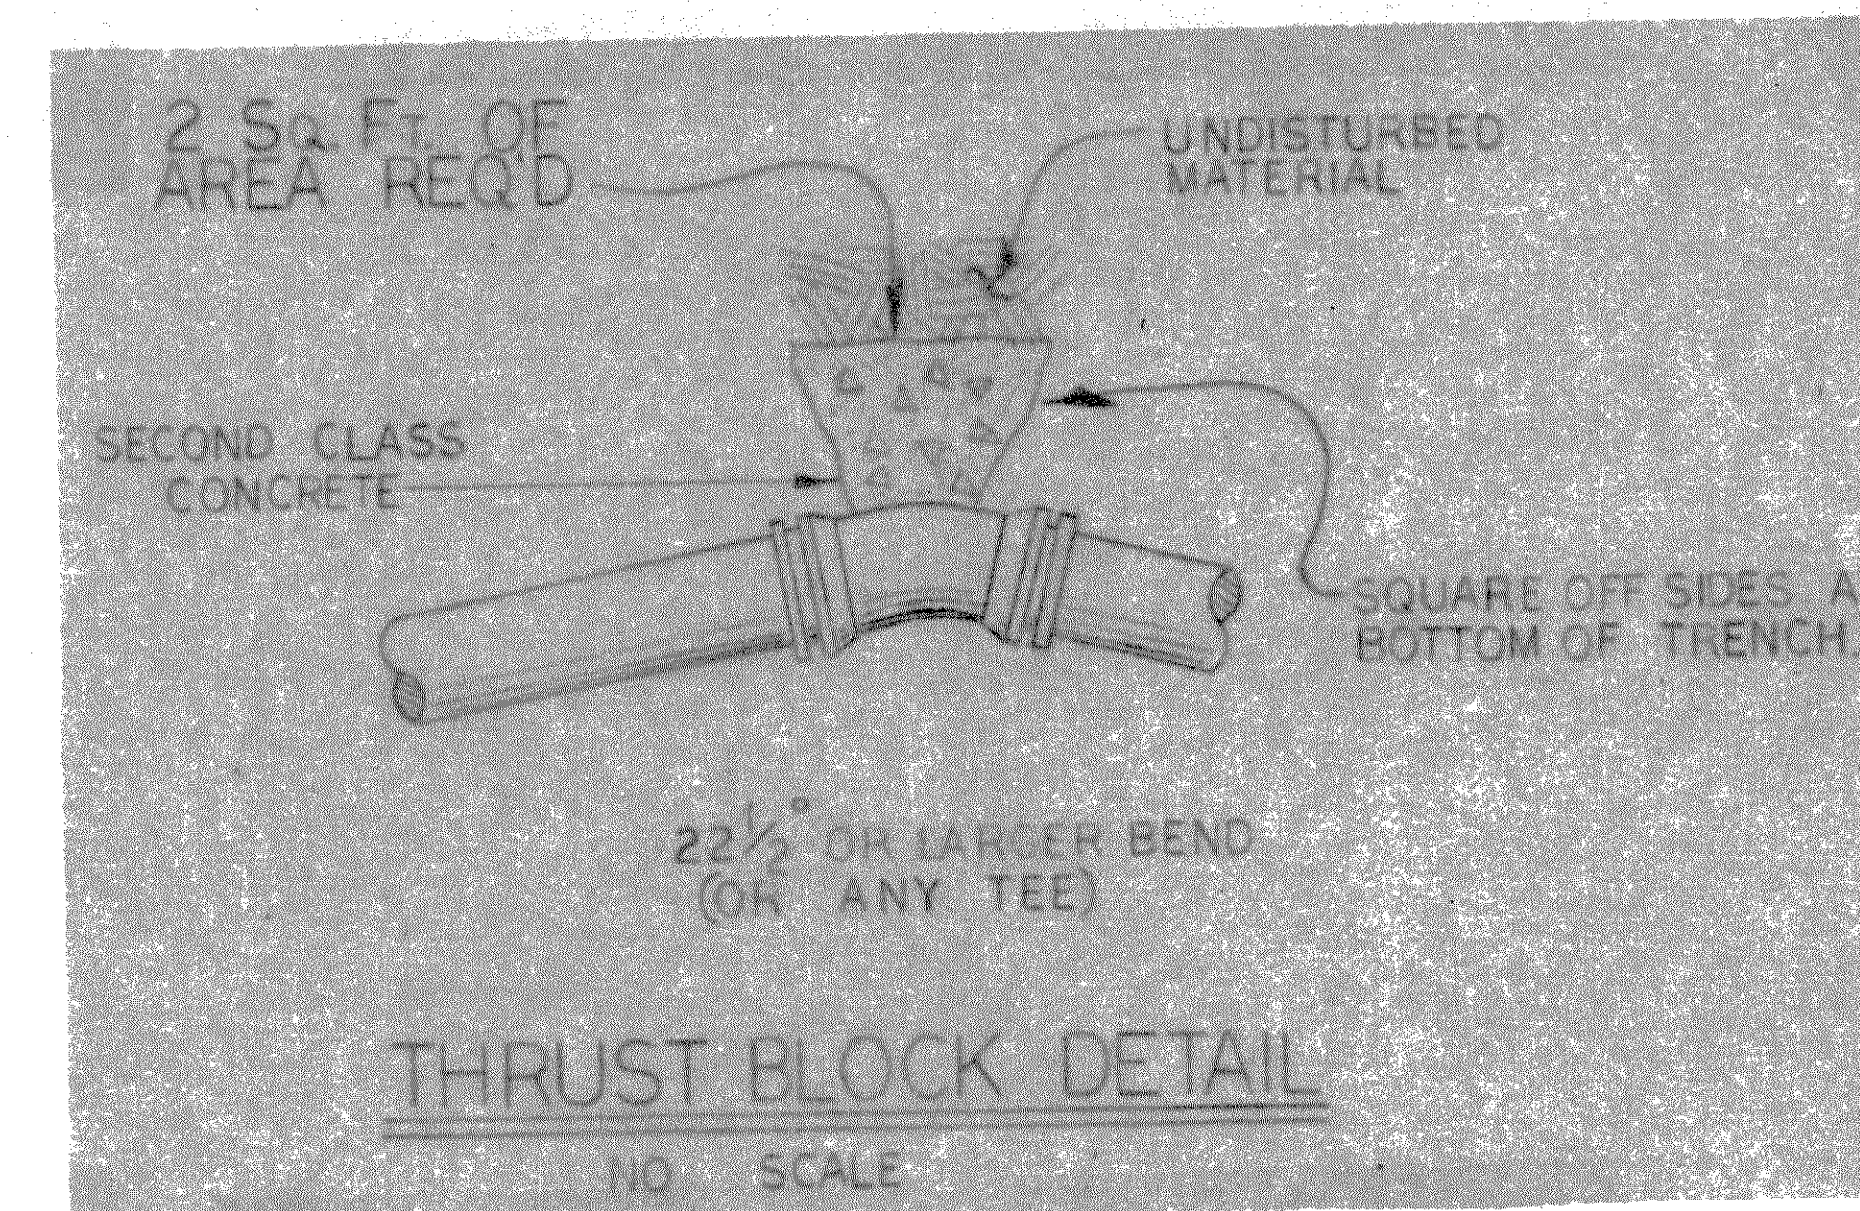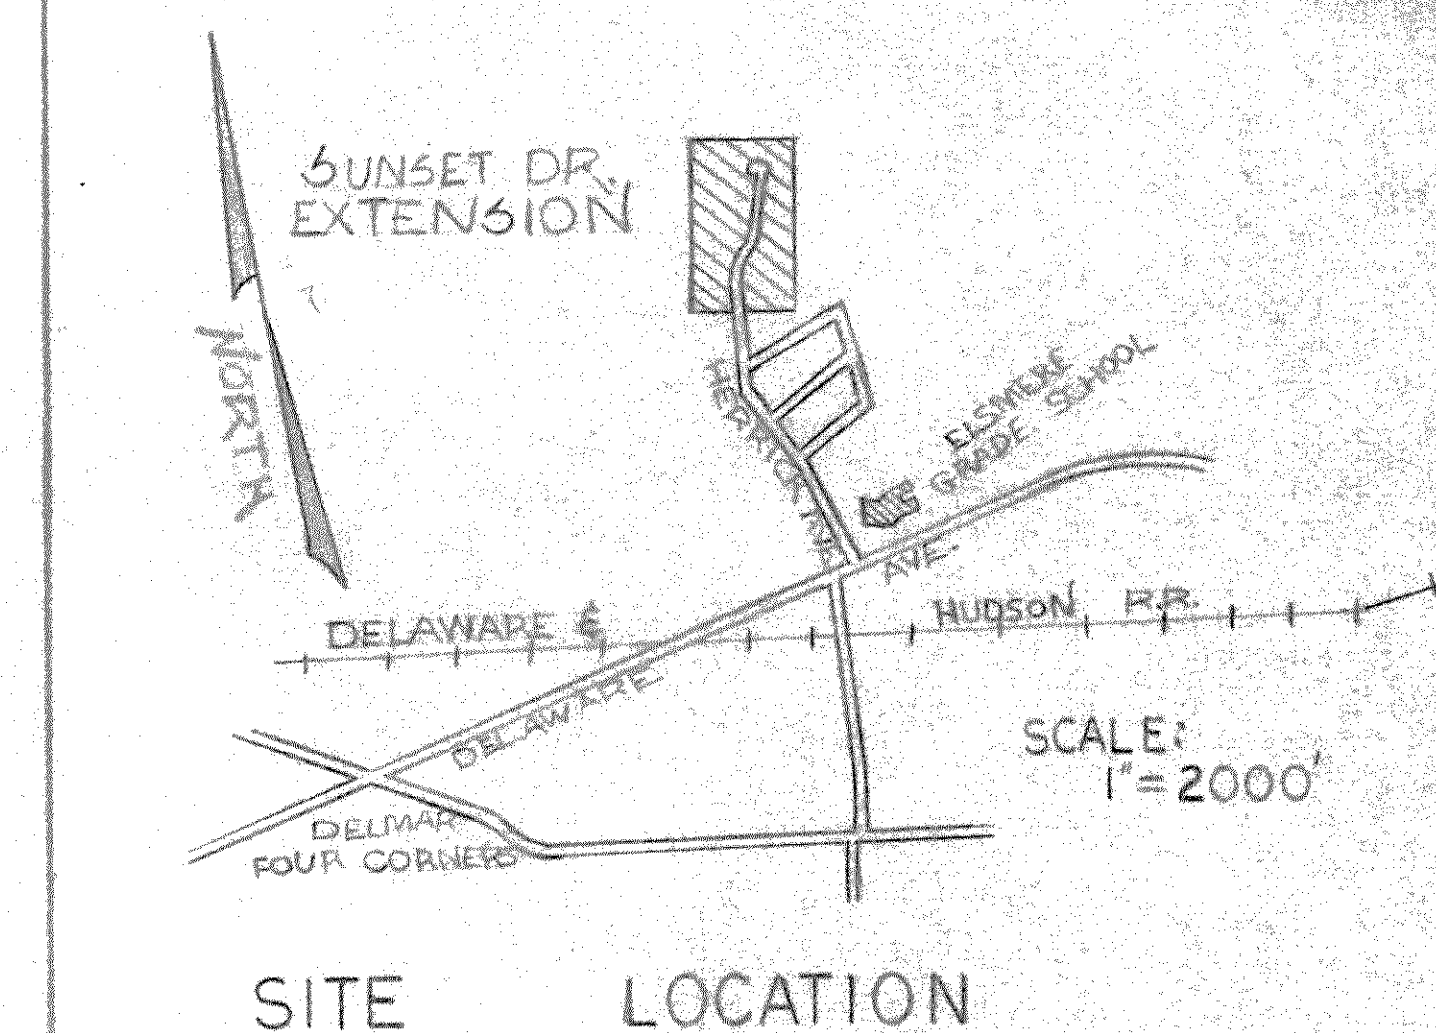


ALBANY COUNTY DEPT. OF HEALTH

DATE 11/2/78

These plans for *Water System Improvements*
EXAMINED AND APPROVED

Richard W. Jones, P.E.

DIRECTOR, DIVISION OF ENVIRONMENTAL
HEALTH SERVICES

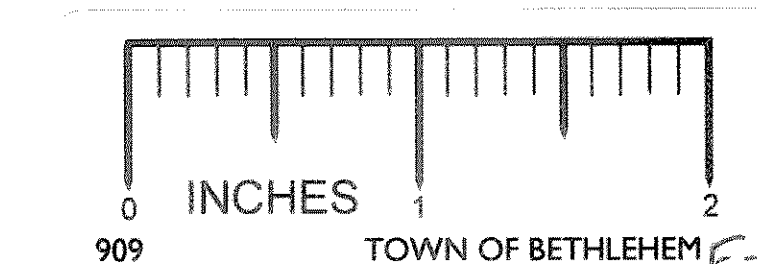

REVISIONS	
DATE	DESCRIPTION

WATER DISTRICT No. 1	
TOWN OF BETHLEHEM	
ALBANY COUNTY	NEW YORK
WATER SUPPLY	
SUNSET DRIVE	
DRWN: S.R. MYERS	
SCALE: AS NOTED	DATE: SEPTEMBER 1978
	DWG. NO: 78-SD-A1