
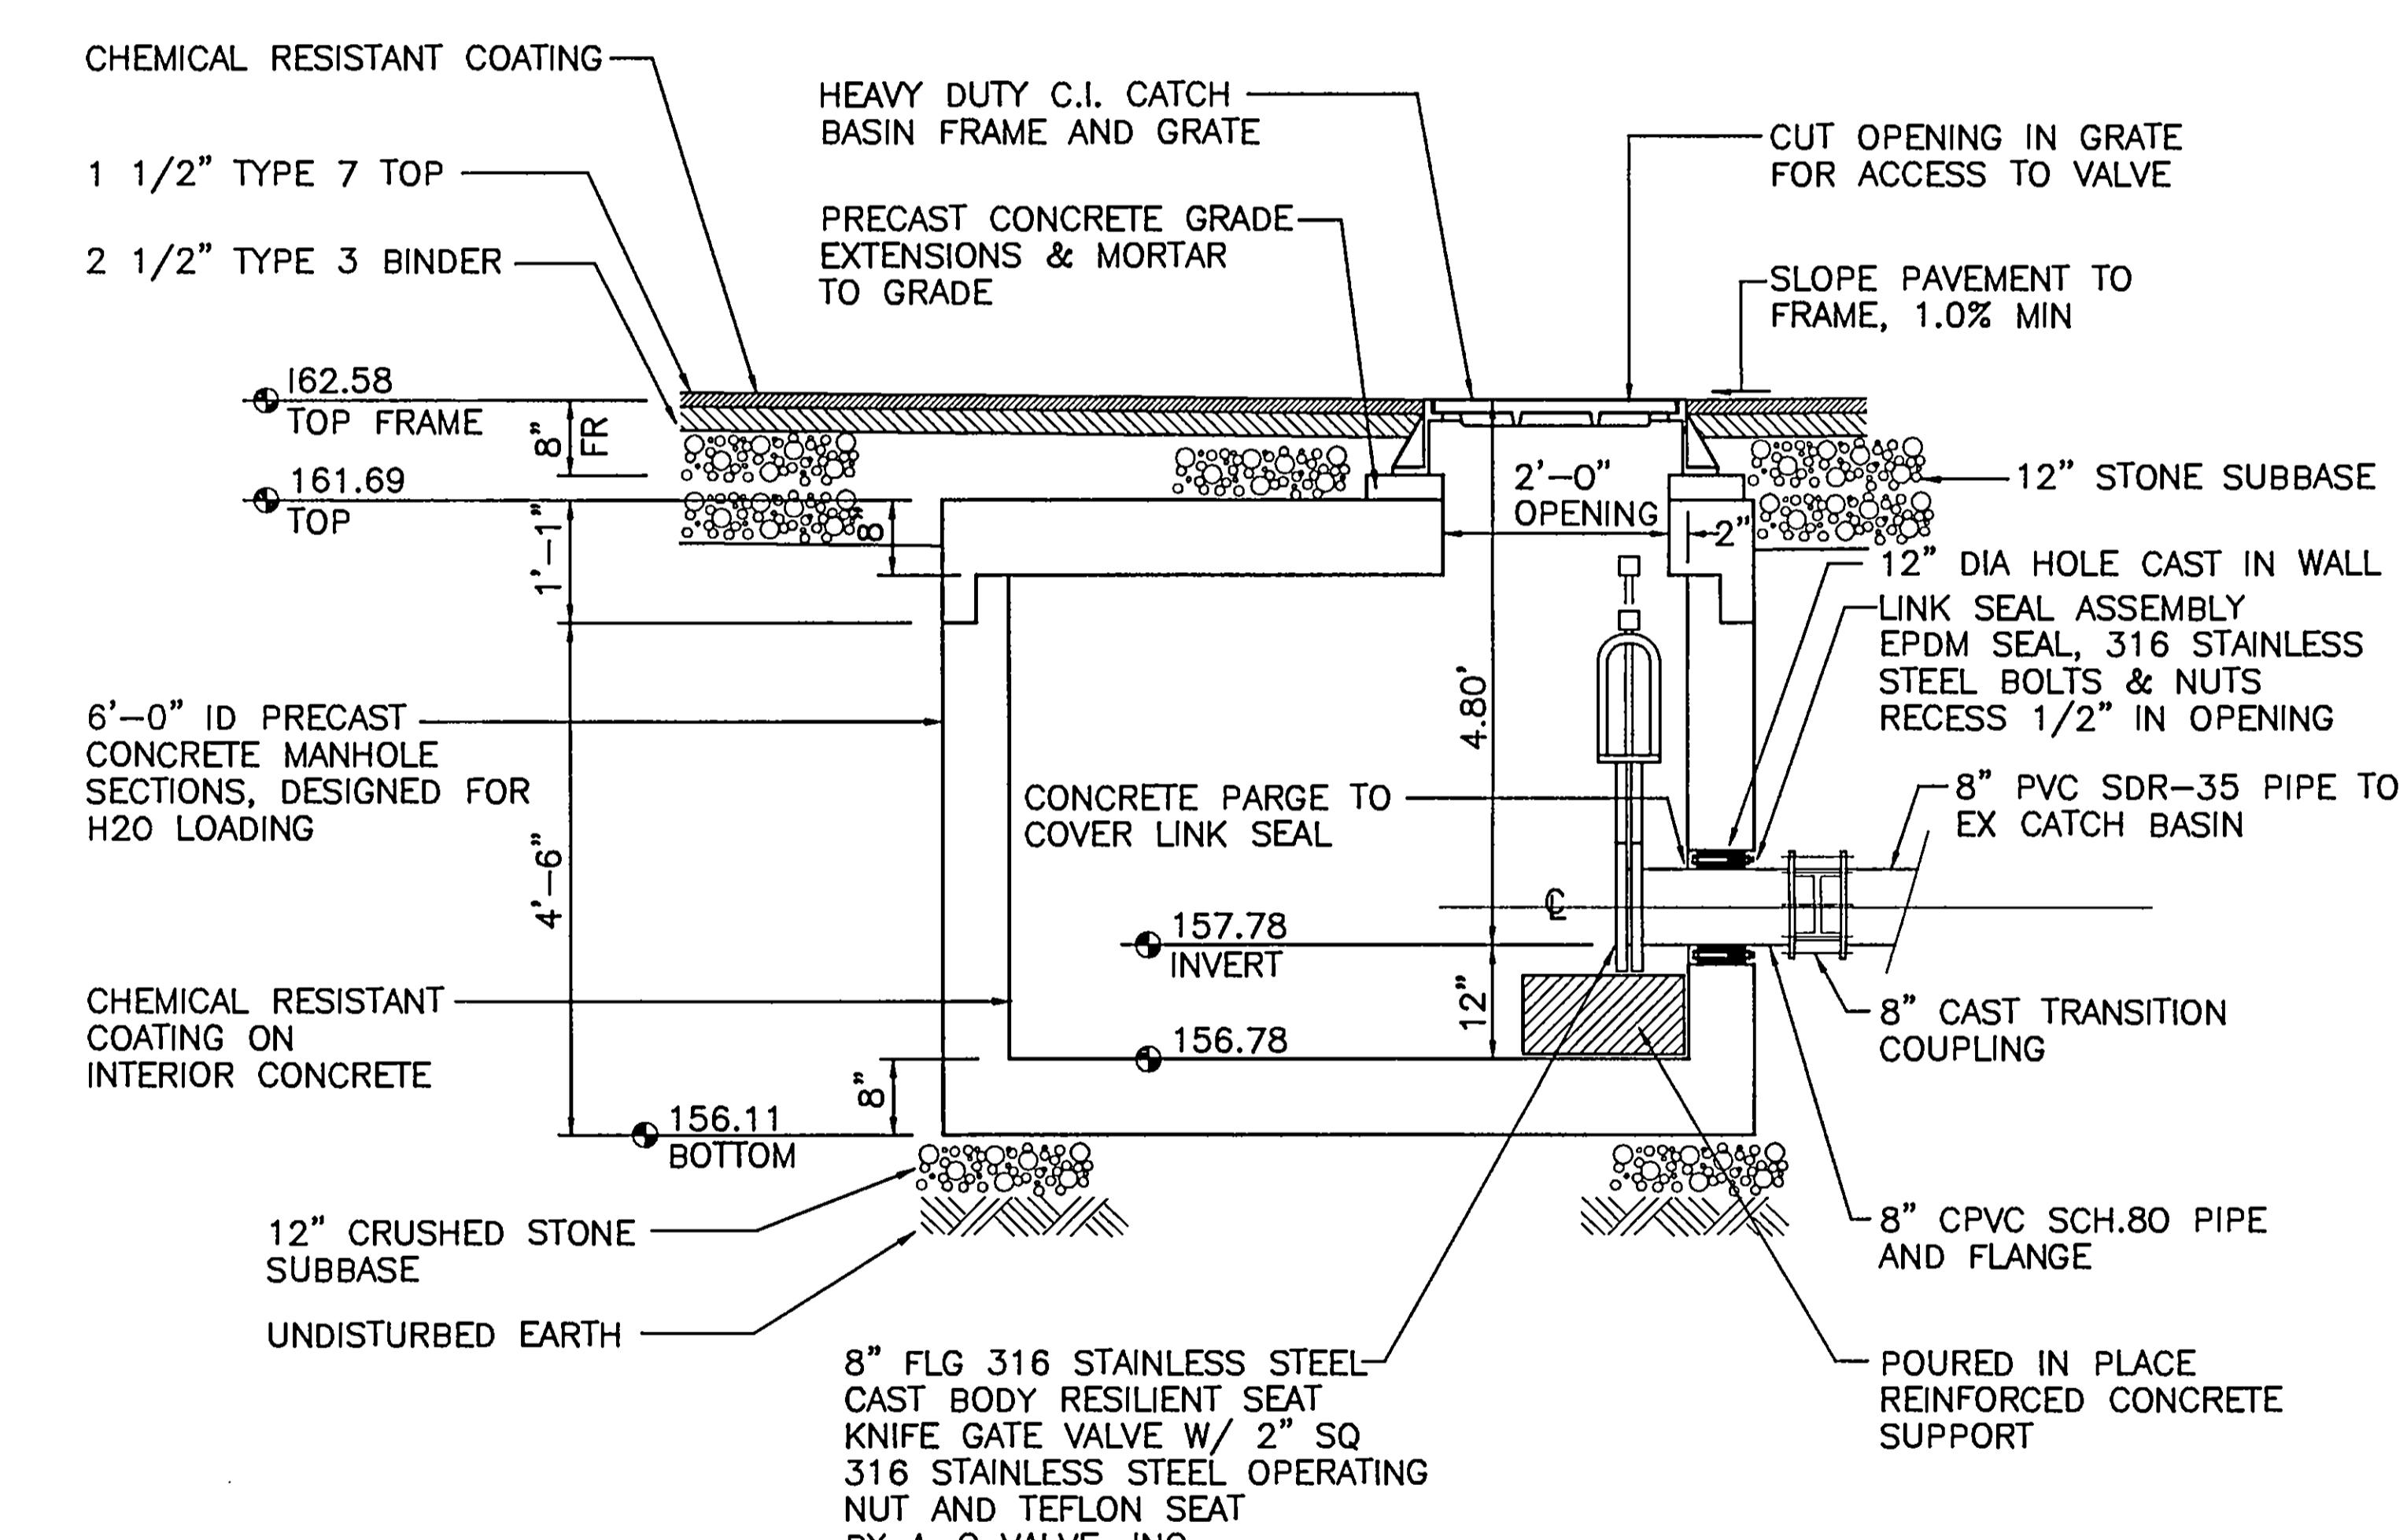




PVC PIPE BEDDING

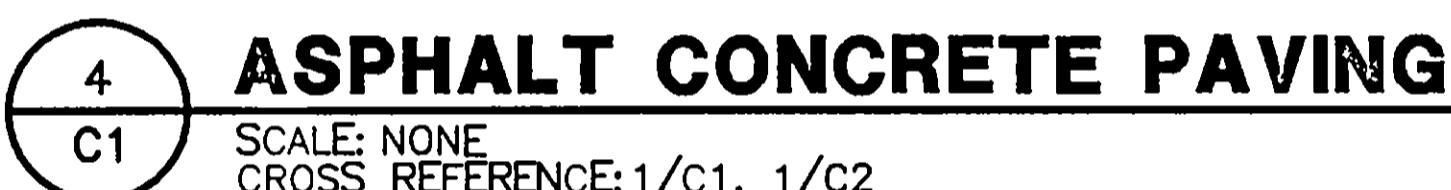

**CLAPPER ROAD WATER TREATMENT PLANT
TRANSFER STATION SUMP DRAIN DETAIL**

NO


1. CHEMICAL RESISTANT COATING TO BE CEVA-DECK 110 BY EPOXY ENGINEERED MATERIALS, LLC OR APPROVED EQUAL.
2. APPLY CHEMICAL RESISTANT COATING TO TRANSFER STATION PAVEMENT AND INTERIOR OF MANHOLE TO MINIMUM THICKNESS OF 60 mils. USING TWO COATS.

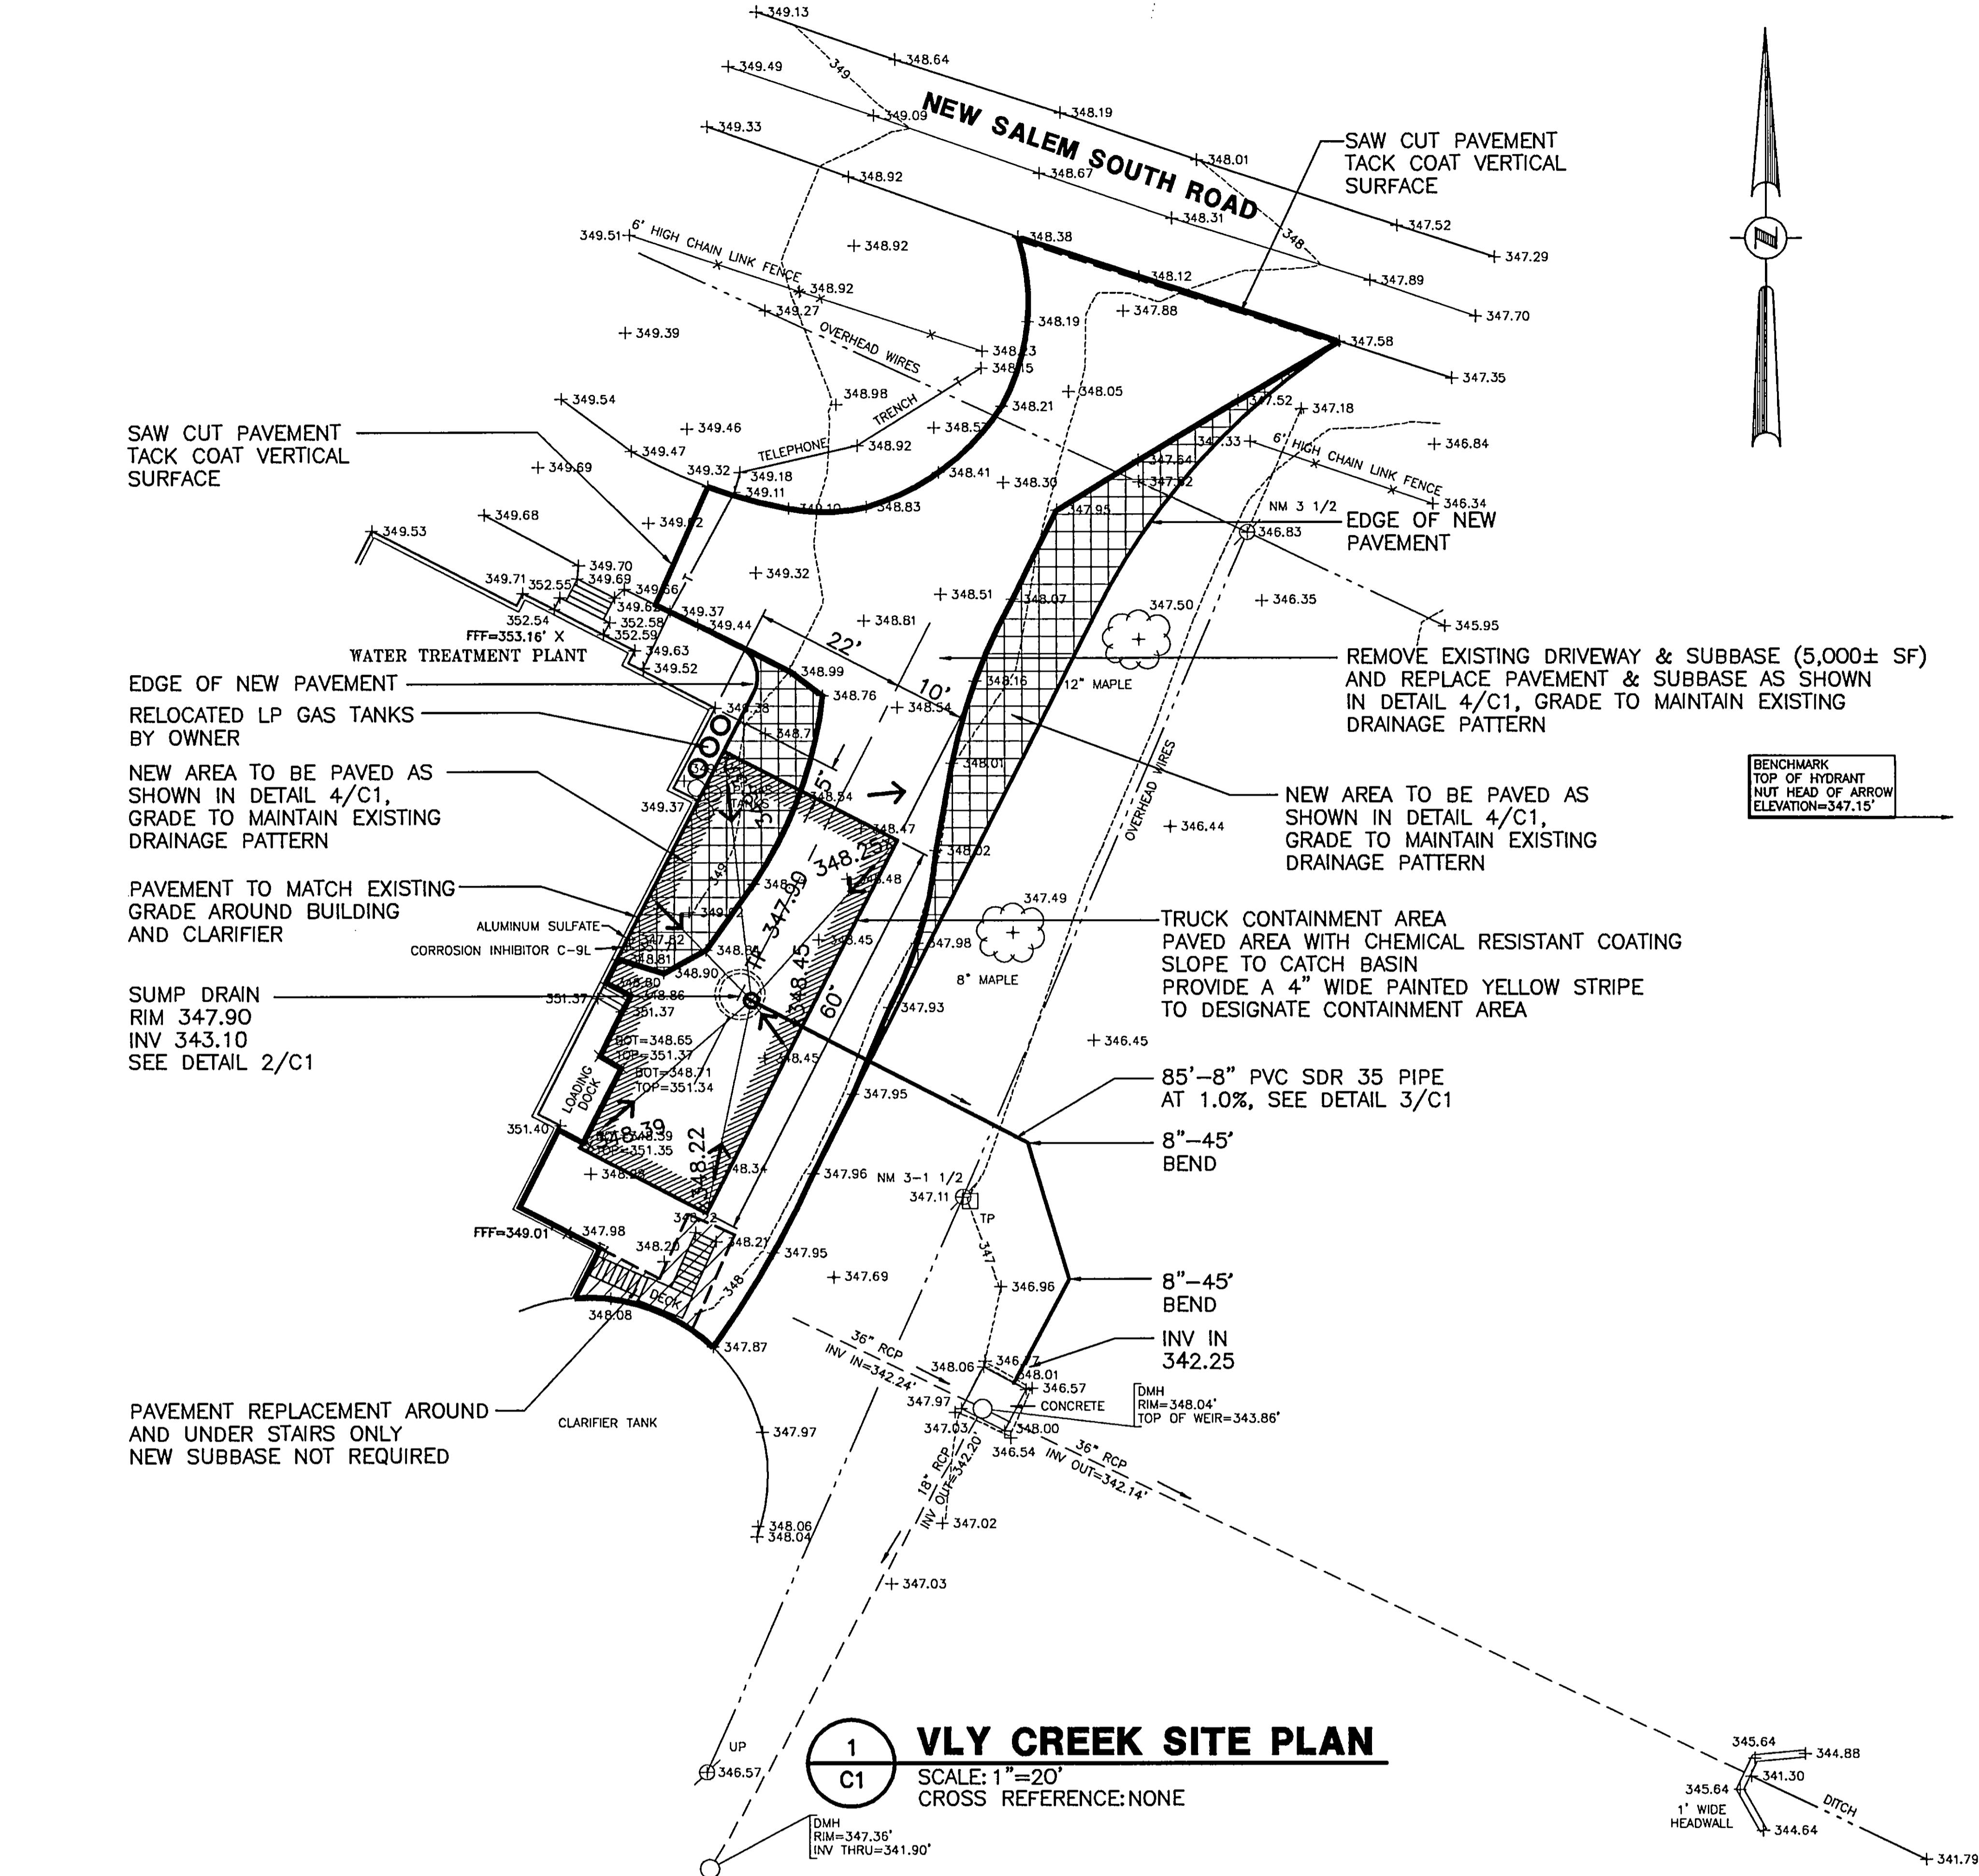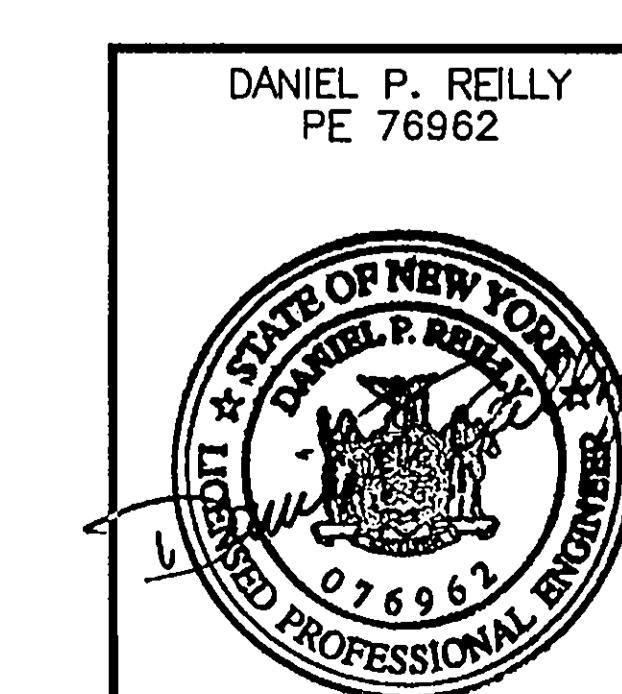

VLY CREEK SITE PLAN

GENERAL NOTES

1. ALL UNDERGROUND UTILITIES ARE SHOWN IN THEIR RELATIVE POSITION AND ARE FOR INFORMATION ONLY. THEIR EXACT LOCATION SHALL BE CHECKED AT THE SITE BEFORE CONSTRUCTION BEGINS.
2. CONTRACTOR SHALL RESTORE LAWNS, DRIVEWAYS, WALKS, CURBS, FENCES ETC. TO A CONDITION AT LEAST AS GOOD AS THEY WERE BEFORE BEING DISTURBED. MAILBOXES, POSTS, ETC., SHALL BE PROTECTED OR REMOVED AND REPLACED EXACTLY AS THEY WERE BEFORE BEING DISTURBED. DAMAGED ITEMS SHALL BE REPLACED AT THE CONTRACTOR'S EXPENSE.
3. BOX ALL TREES AND HOUSE ALL SHRUBS & HEDGES BEFORE PLACING EARTH AGAINST OR NEAR THEM. SHRUBS & HEDGES WHICH MUST BE REMOVED DURING CONSTRUCTION SHALL BE HEALED IN AND REPLANTED IN AS GOOD A CONDITION AS THEY WERE BEFORE THEIR REMOVAL, ANY DAMAGED TREES, SHRUBS AND /OR HEDGES SHALL BE REPLACED AT THE CONTRACTOR'S EXPENSE.

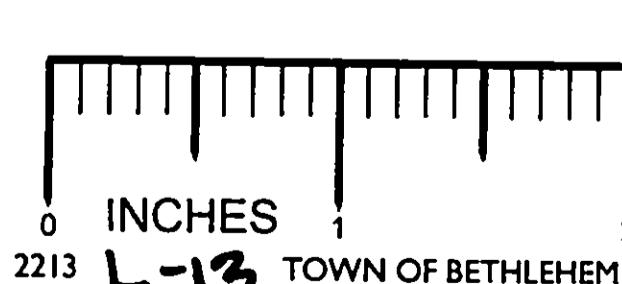

VLY CREEK WATER TREATMENT PLANT SITE PLAN AND DETAILS

CHEMICAL BULK STORAGE TRANSFER STATION

TOWN OF BETHLEHEM

ALBANY COUNTY, NY

GT MAILE ASSOCIATES, P.C.

C.T. MALE ASSOCIATES, P.C.

50 CENTURY HILL DRIVE, P.O. BOX 727, LATHAM, NY 12110
518.786.7400 * FAX 518.786.7299

ARCHITECTURE & BUILDING SYSTEMS ENGINEERING * CIVIL ENGINEERING
ENVIRONMENTAL SERVICES * SURVEY & LAND INFORMATION SERVICES