
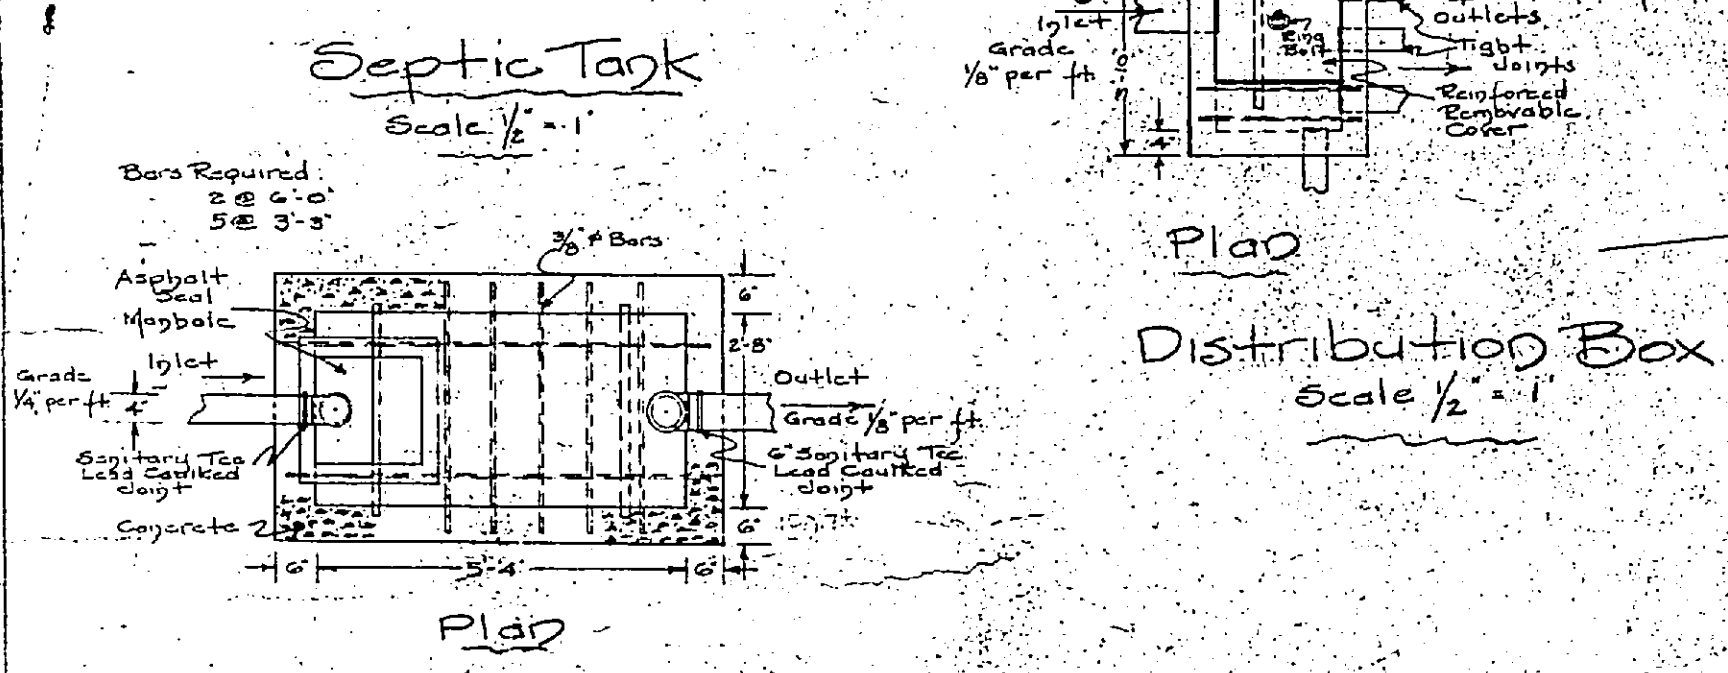


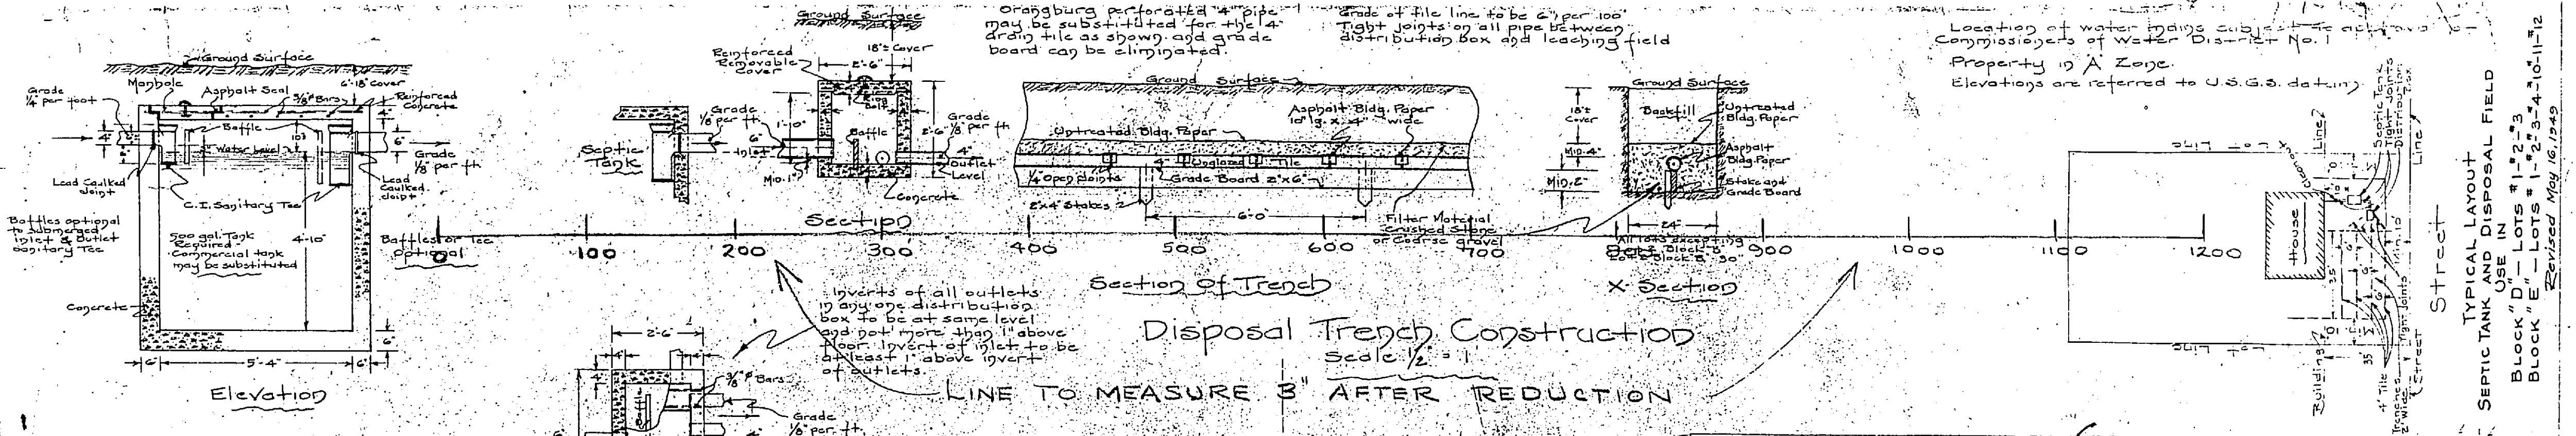

**Notes**

Design of septic tanks and disposal field is based on (3) living units. Liquid capacity of septic tank shall be at least 500 gal.

Line from house sewer and line between septic tank and distribution box shall be ball and spigot type vitrified or concrete pipe with water tight joints.

Minimum lines per field (2)

