


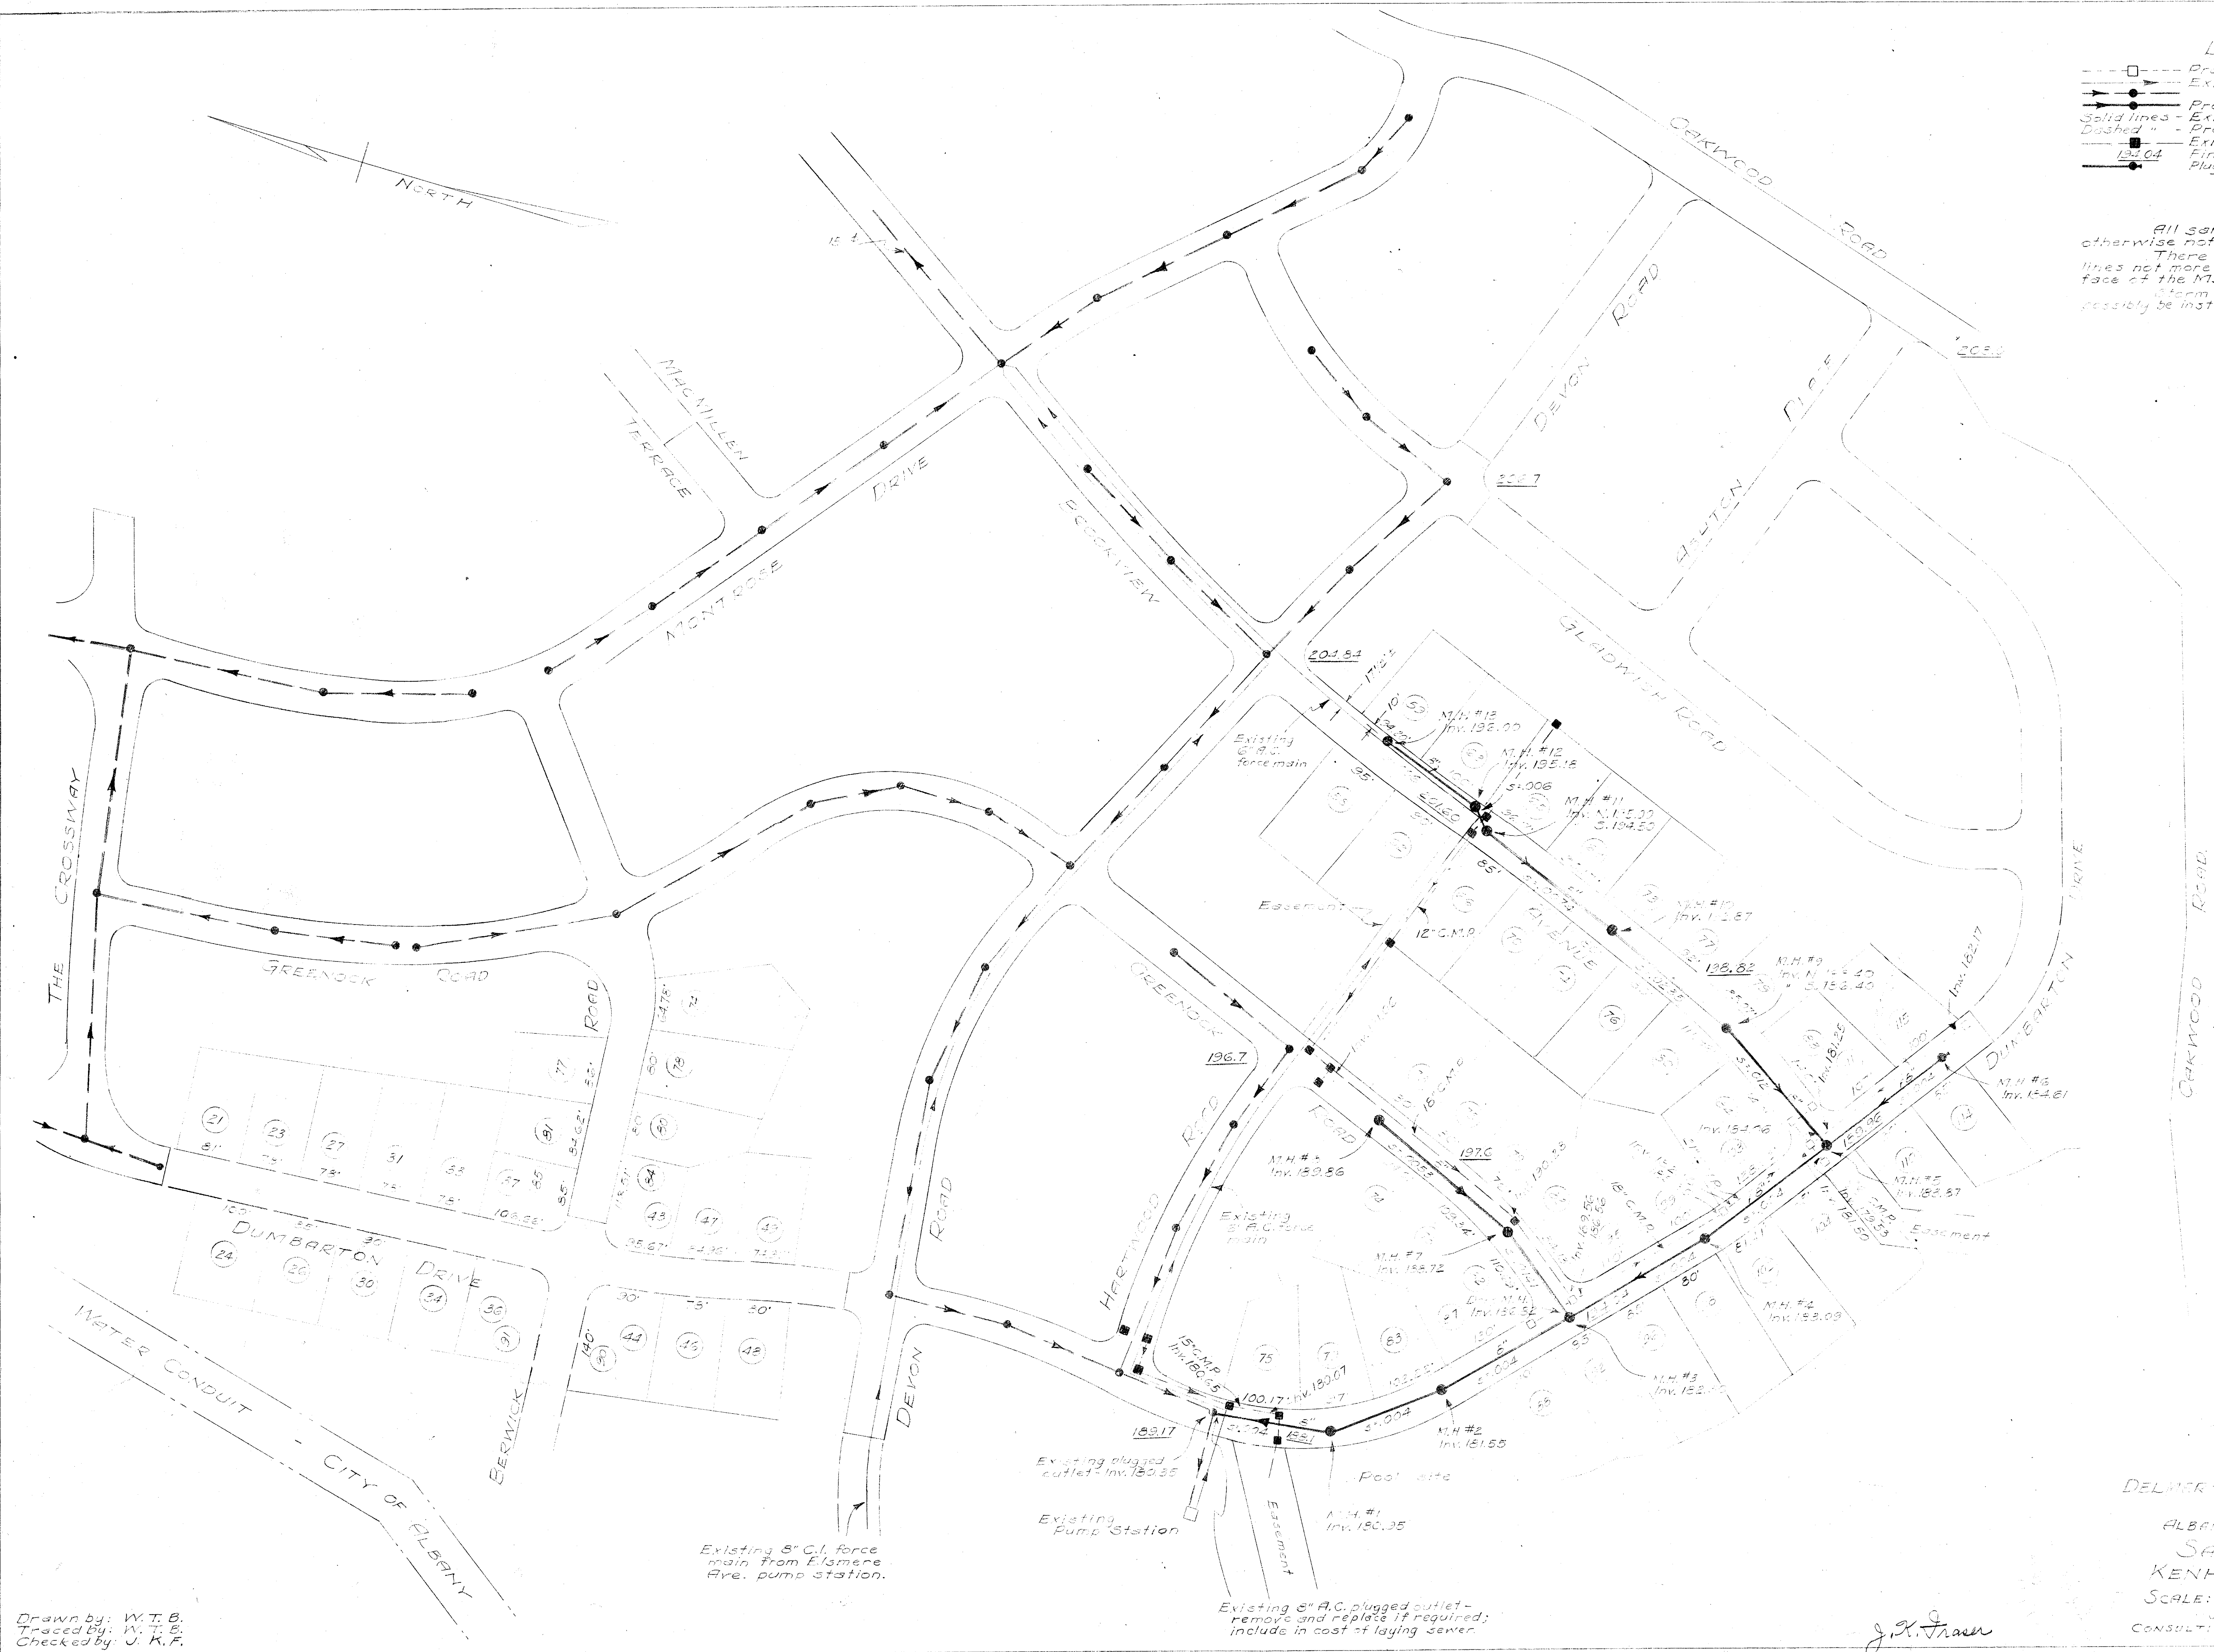

- LEGEND**
- Proposed Storm Sewer
 - Existing Sanitary Force Main
 - Proposed Gravity Sewer
 - Existing Street
 - Proposed " "
 - Existing Storm Sewer
 - Finished Grade
 - Plugged outlet - include in cost of M.H.

NOTES

All sanitary sewers 8" unless otherwise noted.

There shall be a joint in all sewer lines not more than 20' from the outside face of the M.H.

Storm sewers shown proposed may possibly be installed at time of this contract.



CONTRACT 29

DELMAR-ELMERE SEWER DISTRICT

TOWN OF BETHLEHEM

ALBANY COUNTY NEW YORK

SANITARY SEWERS

KENHOLM DEVELOPMENT

SCALE: 1"=100'

APRIL, 1963

J. KENNETH FRASER & ASSOC.

CONSULTING ENGINEERS RENSSELAER, N.Y.

Drawn by: W.T.B.
 Traced by: W.T.B.
 Checked by: J.R.F.

Existing 8" C.I. force main from Elsmere Ave. pump station.

Existing plugged outlet - Inv. 180.35

Existing Pump Station

Existing 8" A.C. plugged outlet - remove and replace if required; include in cost of laying sewer.

J.K. Fraser

1 of 2
 2 Sheets