

**COUNTY HEALTH DEPARTMENT APPROVAL**

Approved by the County Health Department on this 13th day of May 1969.

John J. Schmeder, M.D., Commissioner of Health

**PLANNING BOARD APPROVAL**

TOWN OF BETHLEHEM  
ALBANY COUNTY, NEW YORK

This plat APPROVED subject to such conditions as are stated in Planning Board Certificate of Approval No. 117, dated May 13, 1969.

Lindsay M. Boutelle, Town Engineer



**GENERAL NOTES**

- DESIGN OF SEPTIC TANKS AND TILE FIELDS BASED ON 3, 4 AND 5 BEDROOMS AND A TRANSVAPPER-COLATION RATE OF 0.5 GAL. PER TRENCH SQ. FT. PER DAY.
- LINES: HOUSE TO TANK TO BE 1" CAST IRON PIPE W/LEAD CAULKED JOINTS, 1/4" PER FT.; TANK TO BOX TO BE SOLID ORANGEBURG, 1/2" PER FT.; BOX TO FIELD TO BE SOLID ORANGEBURG, 1/4" PER FT.; FIELD TO BE PERFORATED TILE, 1/4" PER FT. TO LEVEL.
- SEPTIC TANK AND DISTRIBUTION BOX TO BE STANDARD REINFORCED WATERPROOFED CONC. COMMERCIAL TANK AND BOX BY FORT MILLER CO., NORWALK VAULT CO. OR OTHER APPROVED MANUFACTURER.
- FILL TO BE USED MUST BE APPROVED BY THE ALBANY COUNTY HEALTH DEPARTMENT.
- WATER MAIN MATERIAL, SIZE AND LOCATION DETERMINED BY TOWN OF BETHLEHEM WATER DISTRICT NO. 1.
- EASEMENTS SHOWN TO BE GRANTED TO THE TOWN OF BETHLEHEM.
- PROPOSED FINISHED GRADES SHOWN THUS: 210.00
- CONTOUR INTERVAL (5) FIVE FEET.
- PROPOSED GAS MAIN SHOWN THUS: G — G — G — G — G
- PROPOSED 6" C.I. WATER MAIN SHOWN THUS: W — W — W — W — W
- LARGE ROOT PLANT AND TREES ARE NOT TO GROW OVER THE DISPOSAL FIELDS, ALSO DRIVEWAYS ARE NOT TO CROSS DISPOSAL FIELDS.
- LOT NUMBERS SHOWN TO BE USED AS STREET NUMBERS.
- ⊕ DENOTES PERCOLATION TEST.
- ⊙ DENOTES BORINGS.

SEWAGE DISPOSAL SYSTEMS  
DESIGNED BY  
JOSEPH J. SCHMEDER PE  
LIC. NO. 20301

LINDSAY M. BOUTELLE

**DISPOSAL TRENCH CONSTRUCTION CROSS SECTION (NOT TO SCALE)**

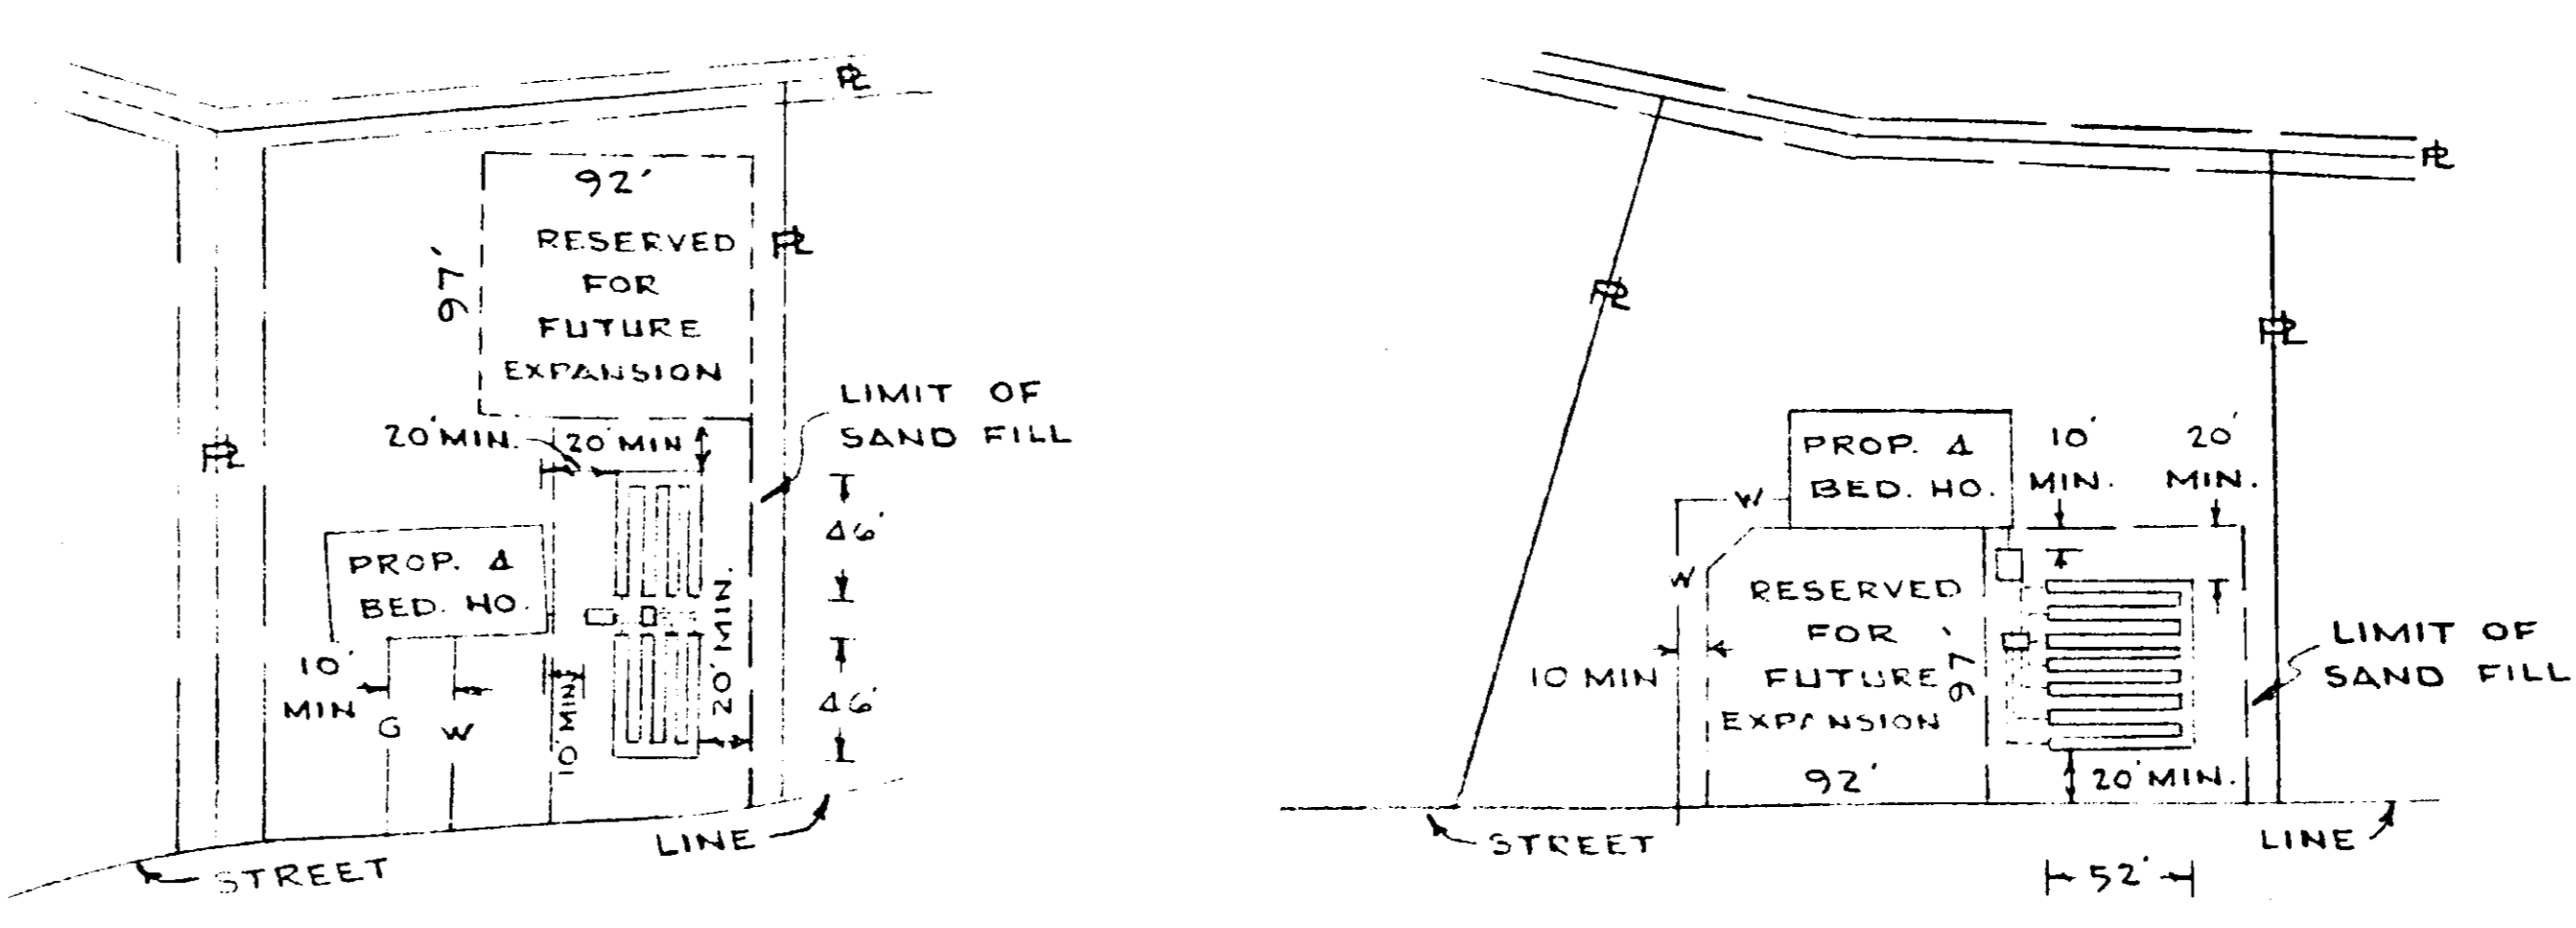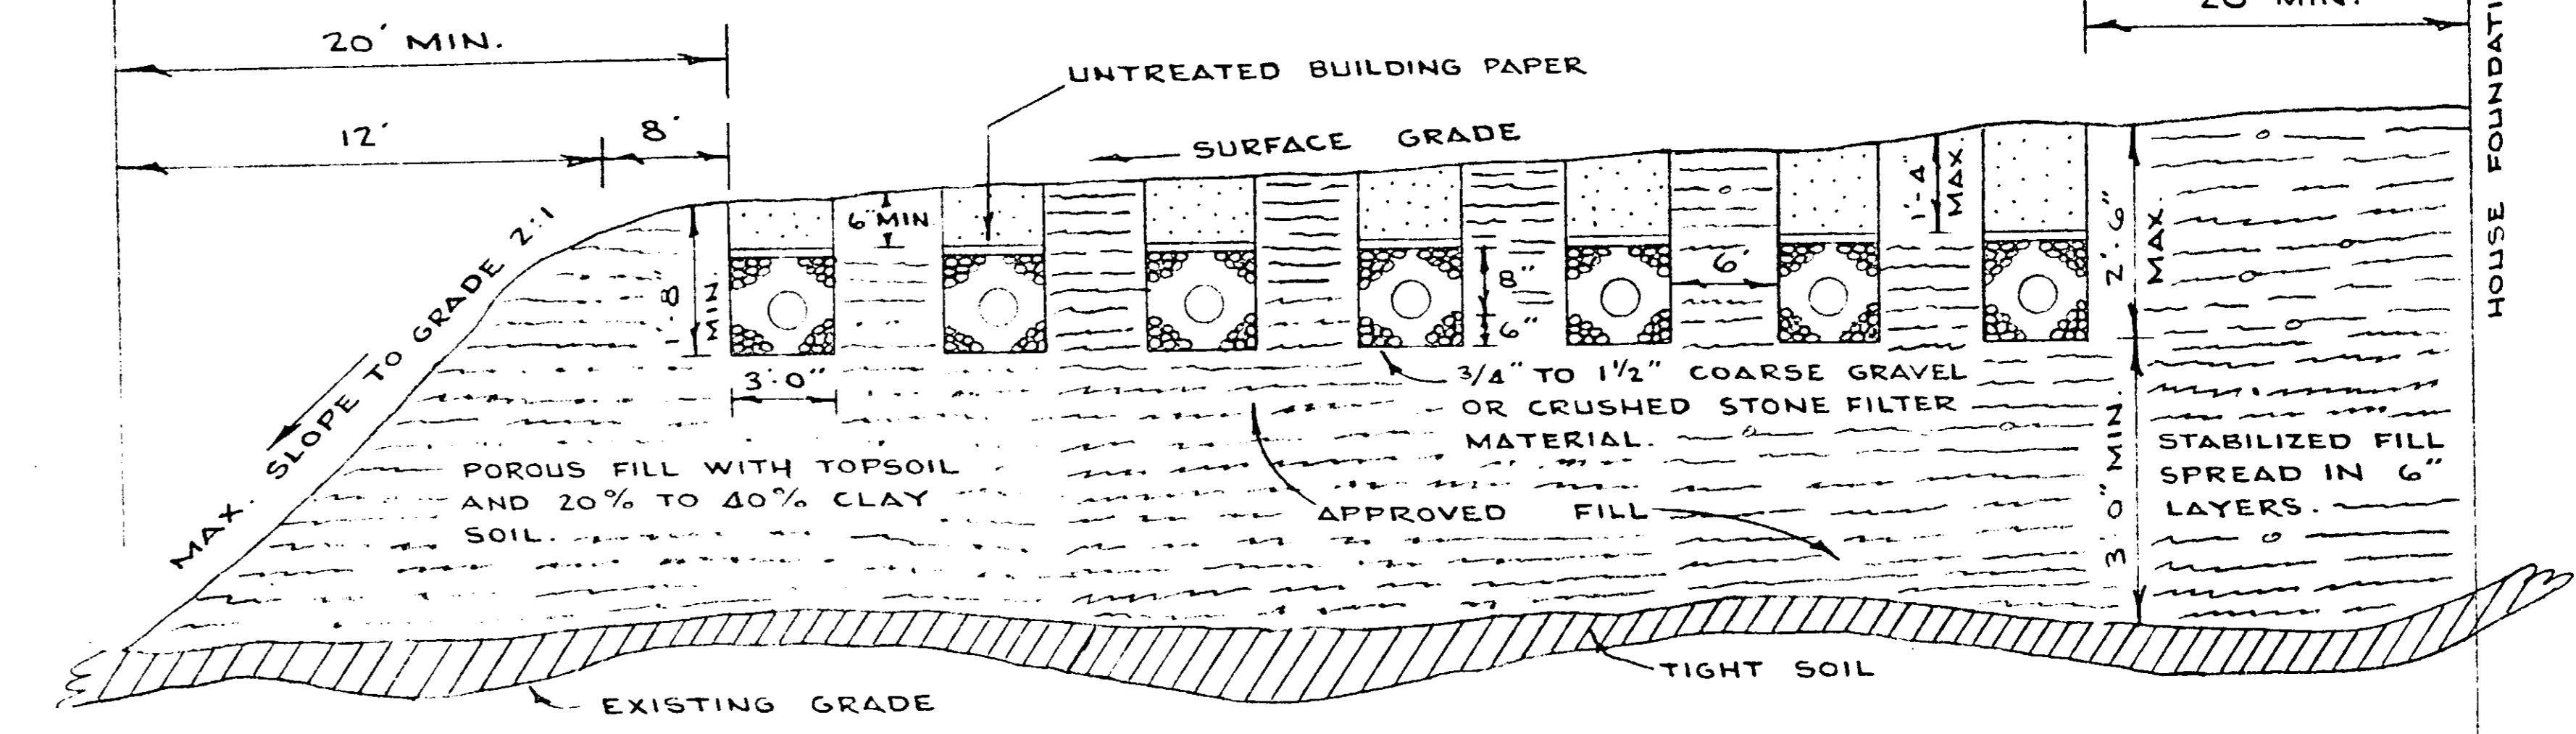


TYPICAL LOT LAYOUTS (SCALE - 1" = 100')


**NOTES**

- TILE FIELD LOCATIONS AS SHOWN MAY NOT BE REVISED WITHOUT APPROVAL OF ALBANY COUNTY HEALTH DEPARTMENT.
- FOR A 3 BEDROOM HOUSE USE A 900 GAL. SEPTIC TANK AND 300 LINEAL FT. OF TILE.
- FOR A 4 BEDROOM HOUSE USE A 1000 GAL. SEPTIC TANK AND 400 LINEAL FT. OF TILE. (SEE TYPICAL LOT LAYOUTS "A" AND "B").
- FOR A 5 BEDROOM HOUSE USE A 1200 GAL. SEPTIC TANK AND 500 LINEAL FT. OF TILE.
- PERIMETER OF FILL TO BE COVERED WITH CLAY BERM TO PREVENT HORIZONTAL FLOW BEYOND EDGES OF FILLED AREA.

**BORINGS (NOT TO SCALE)**

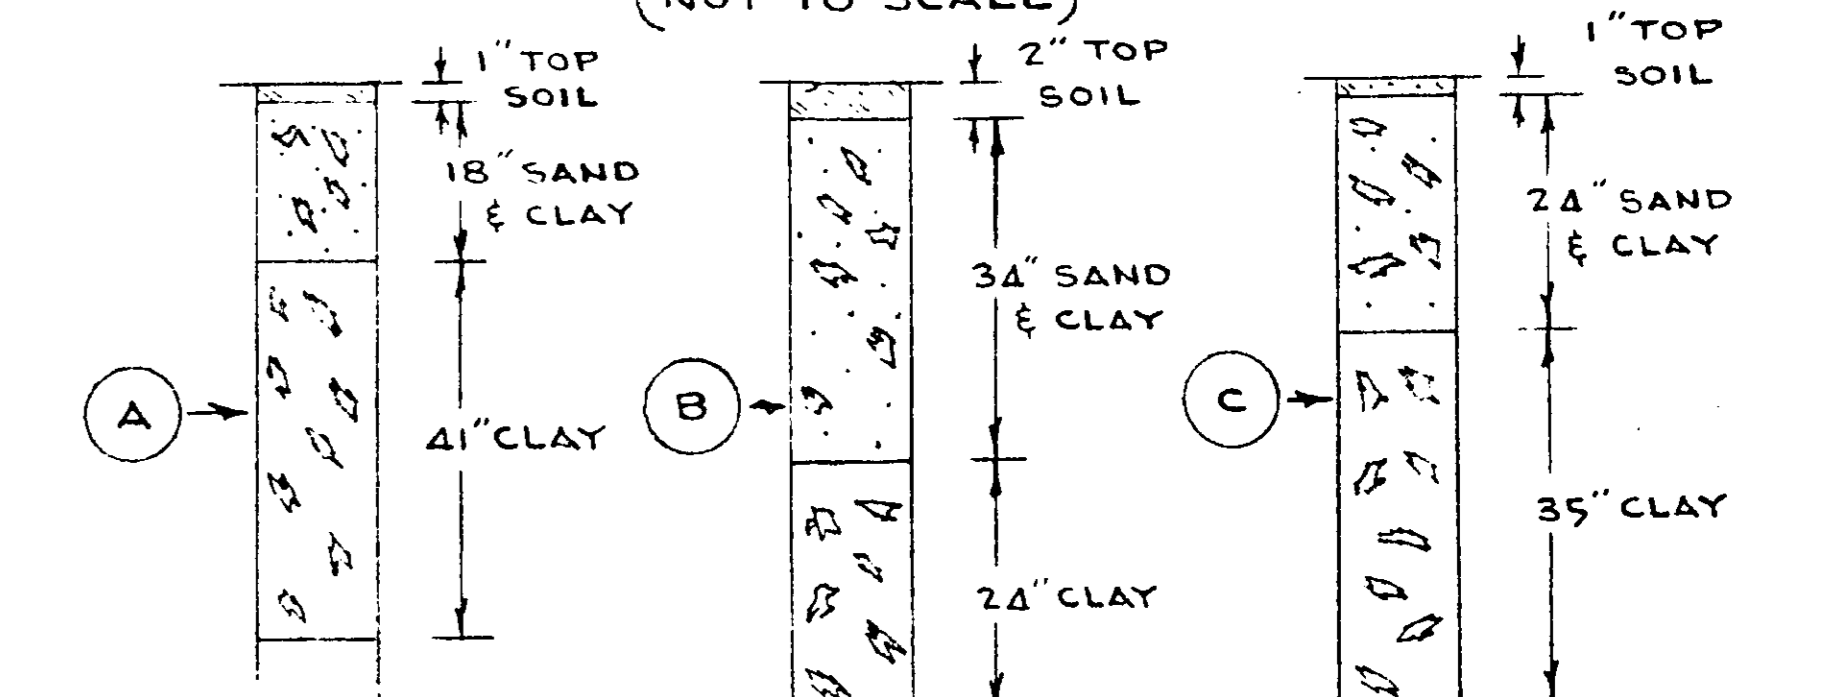

NO WATER TABLE FOUND

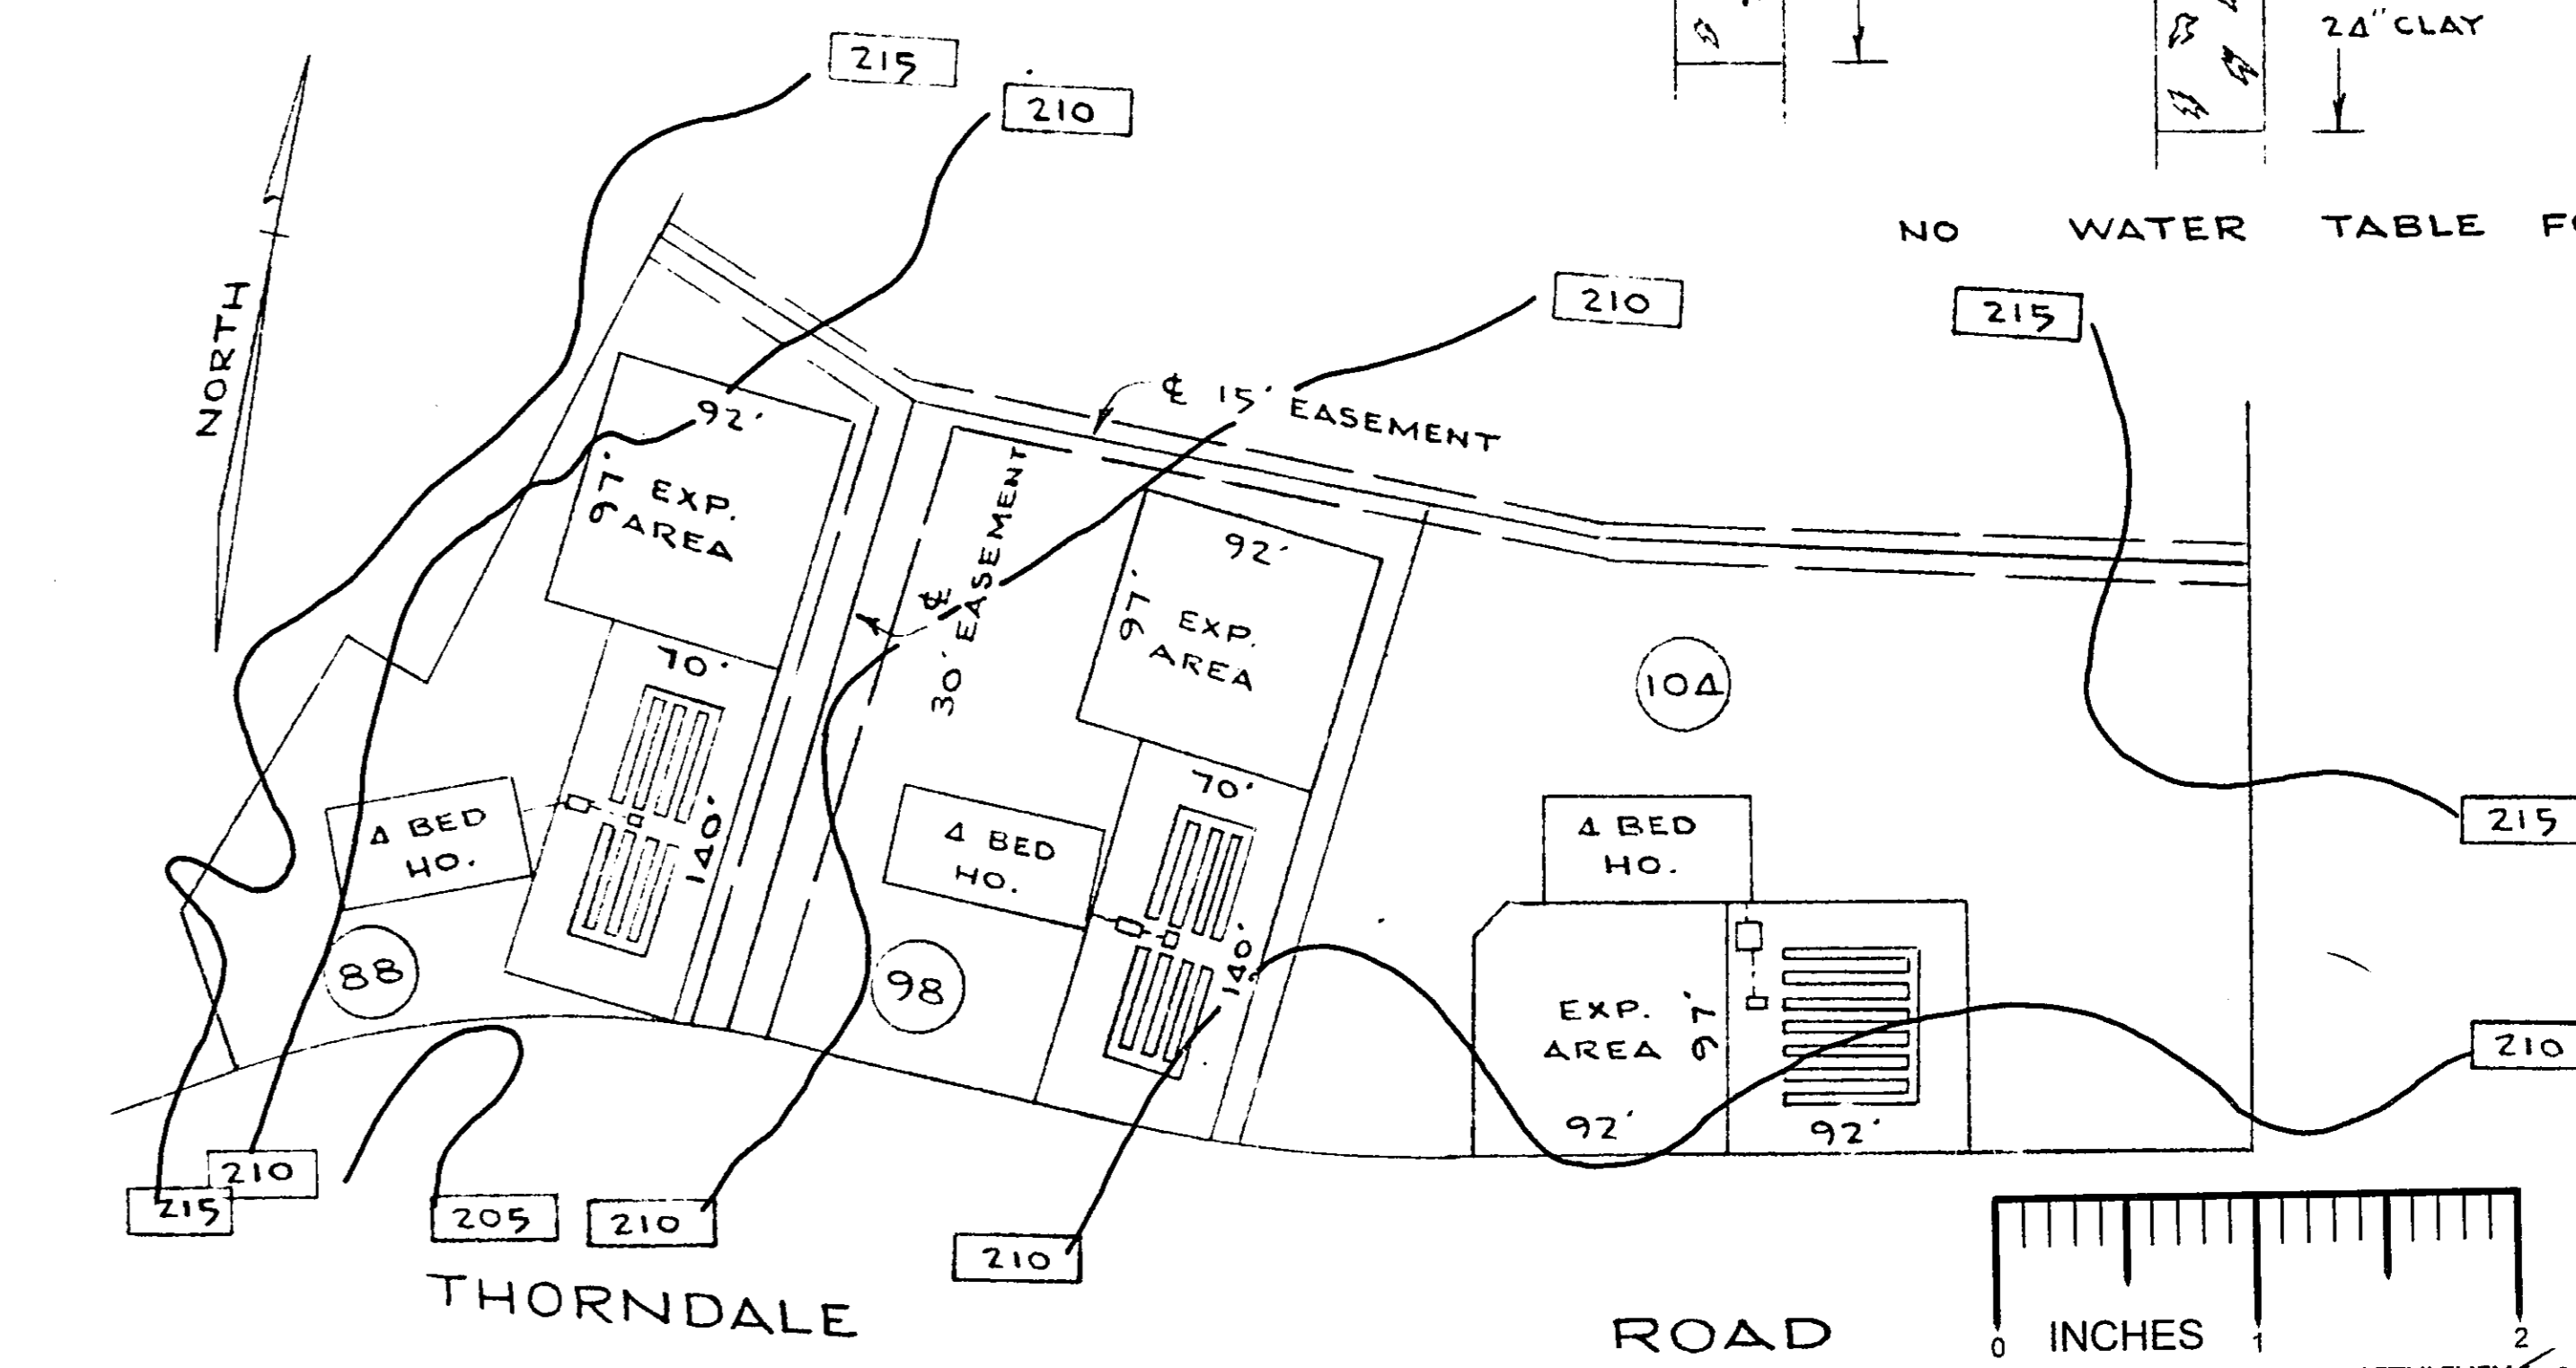

SEWAGE DISPOSAL SYSTEM LOCATIONS (SCALE - 1" = 100')

REVISIONS		
NO.	DATE	DESCRIPTION

**MAP OF SOUTHWOOD EXTENSION NO-2 PROPERTY OF WOODROW J. BEAUREGARD**

TOWN: BETHLEHEM COUNTY: ALBANY  
STATE: NEW YORK DATE: FEB. 14, 1969  
SCALE: AS SHOWN REVISION NO:  
Map Prepared by EDWARD W. BOUTELLE & SON Civil Engineers & Surveyors Delmar, New York  
SHEET FILE NO: 1-2T-F7-0-12-7