
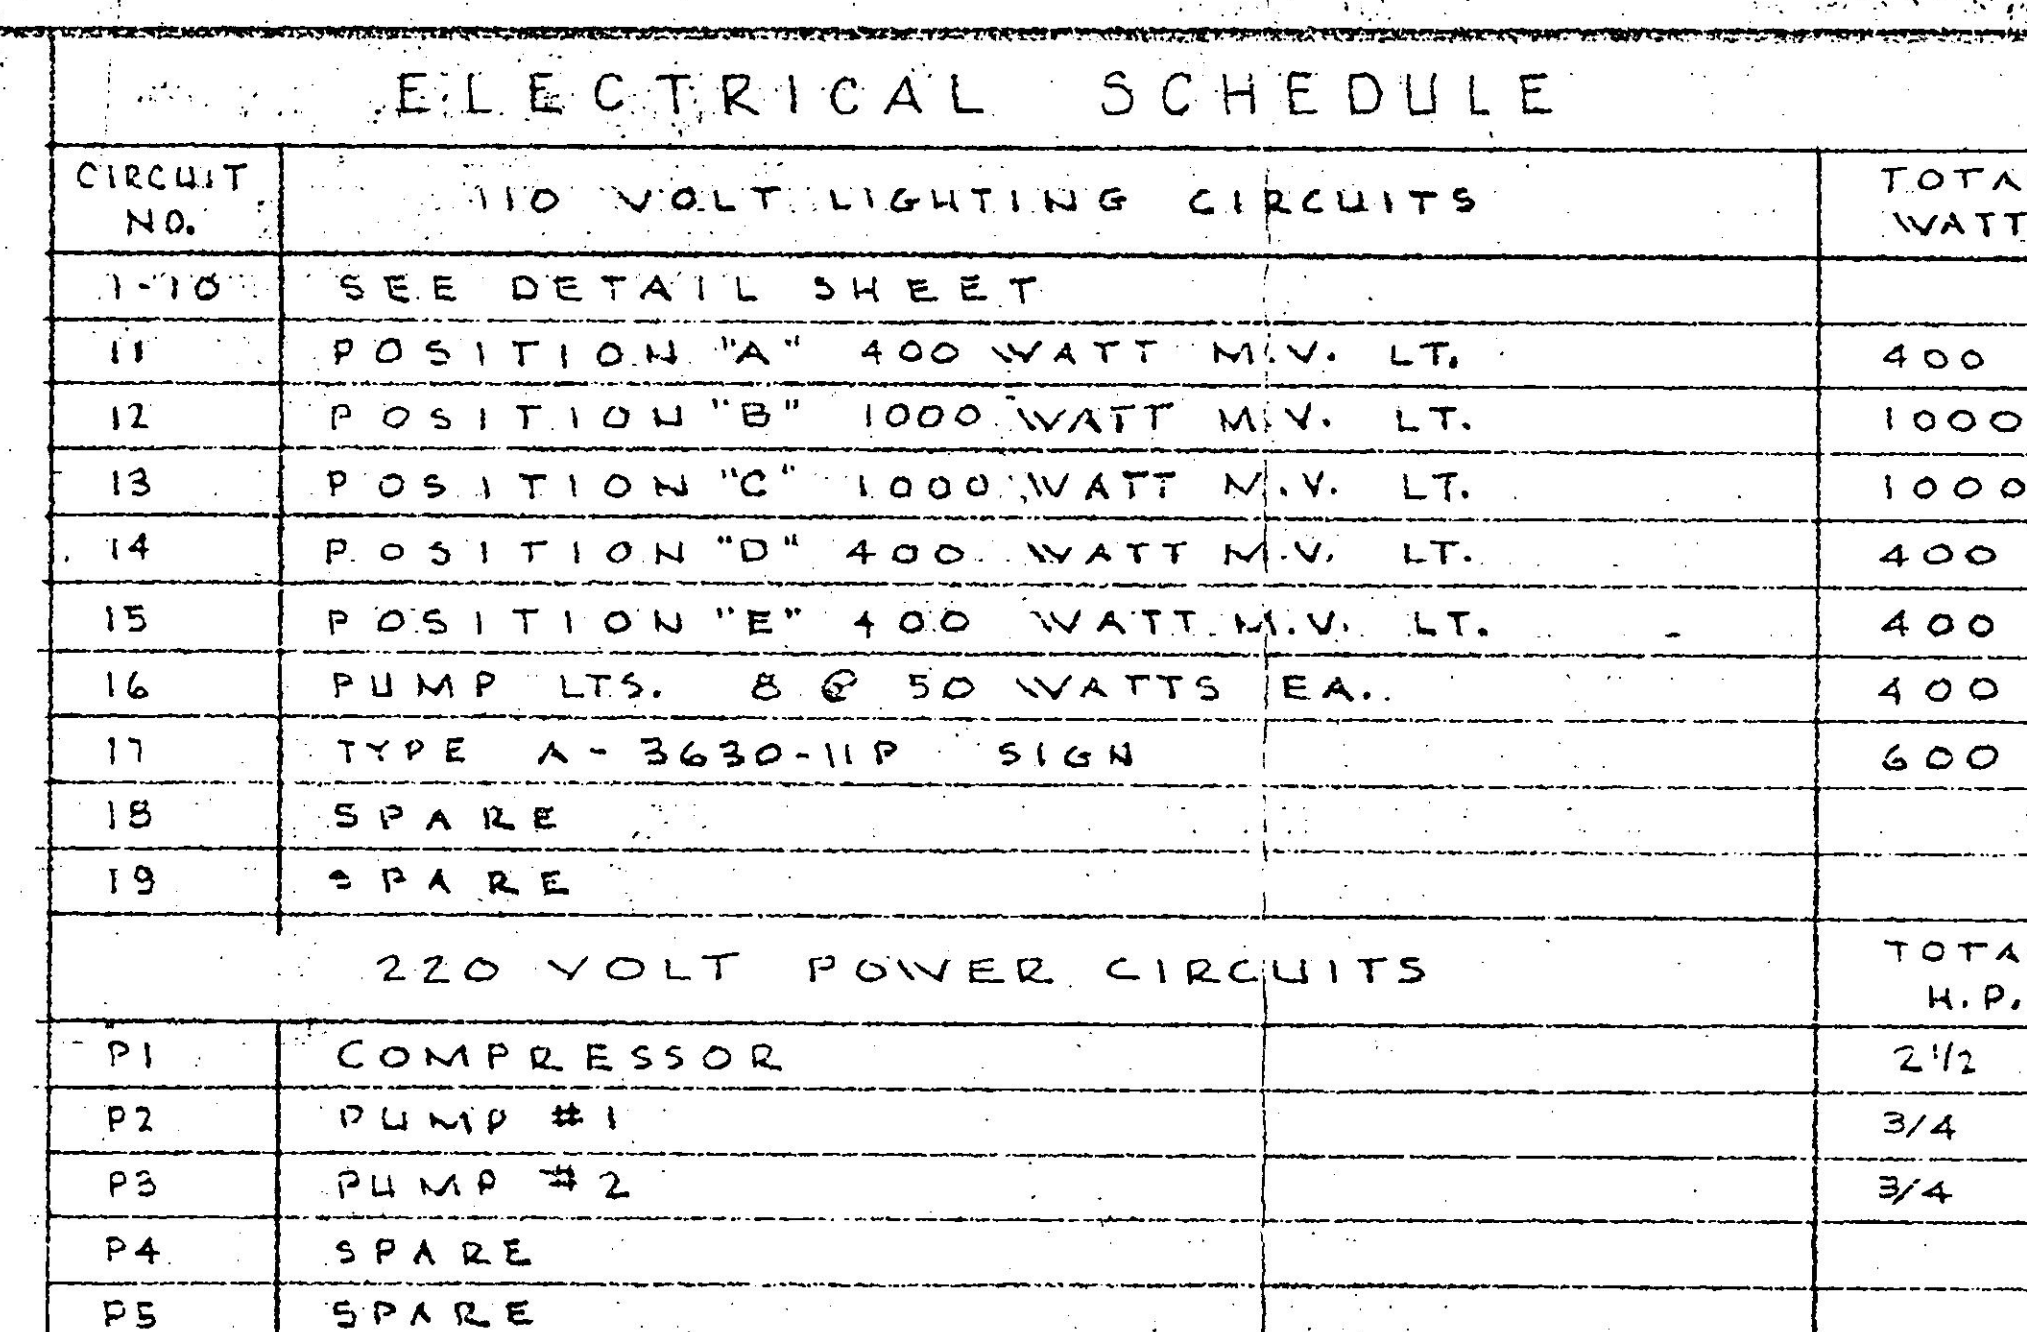


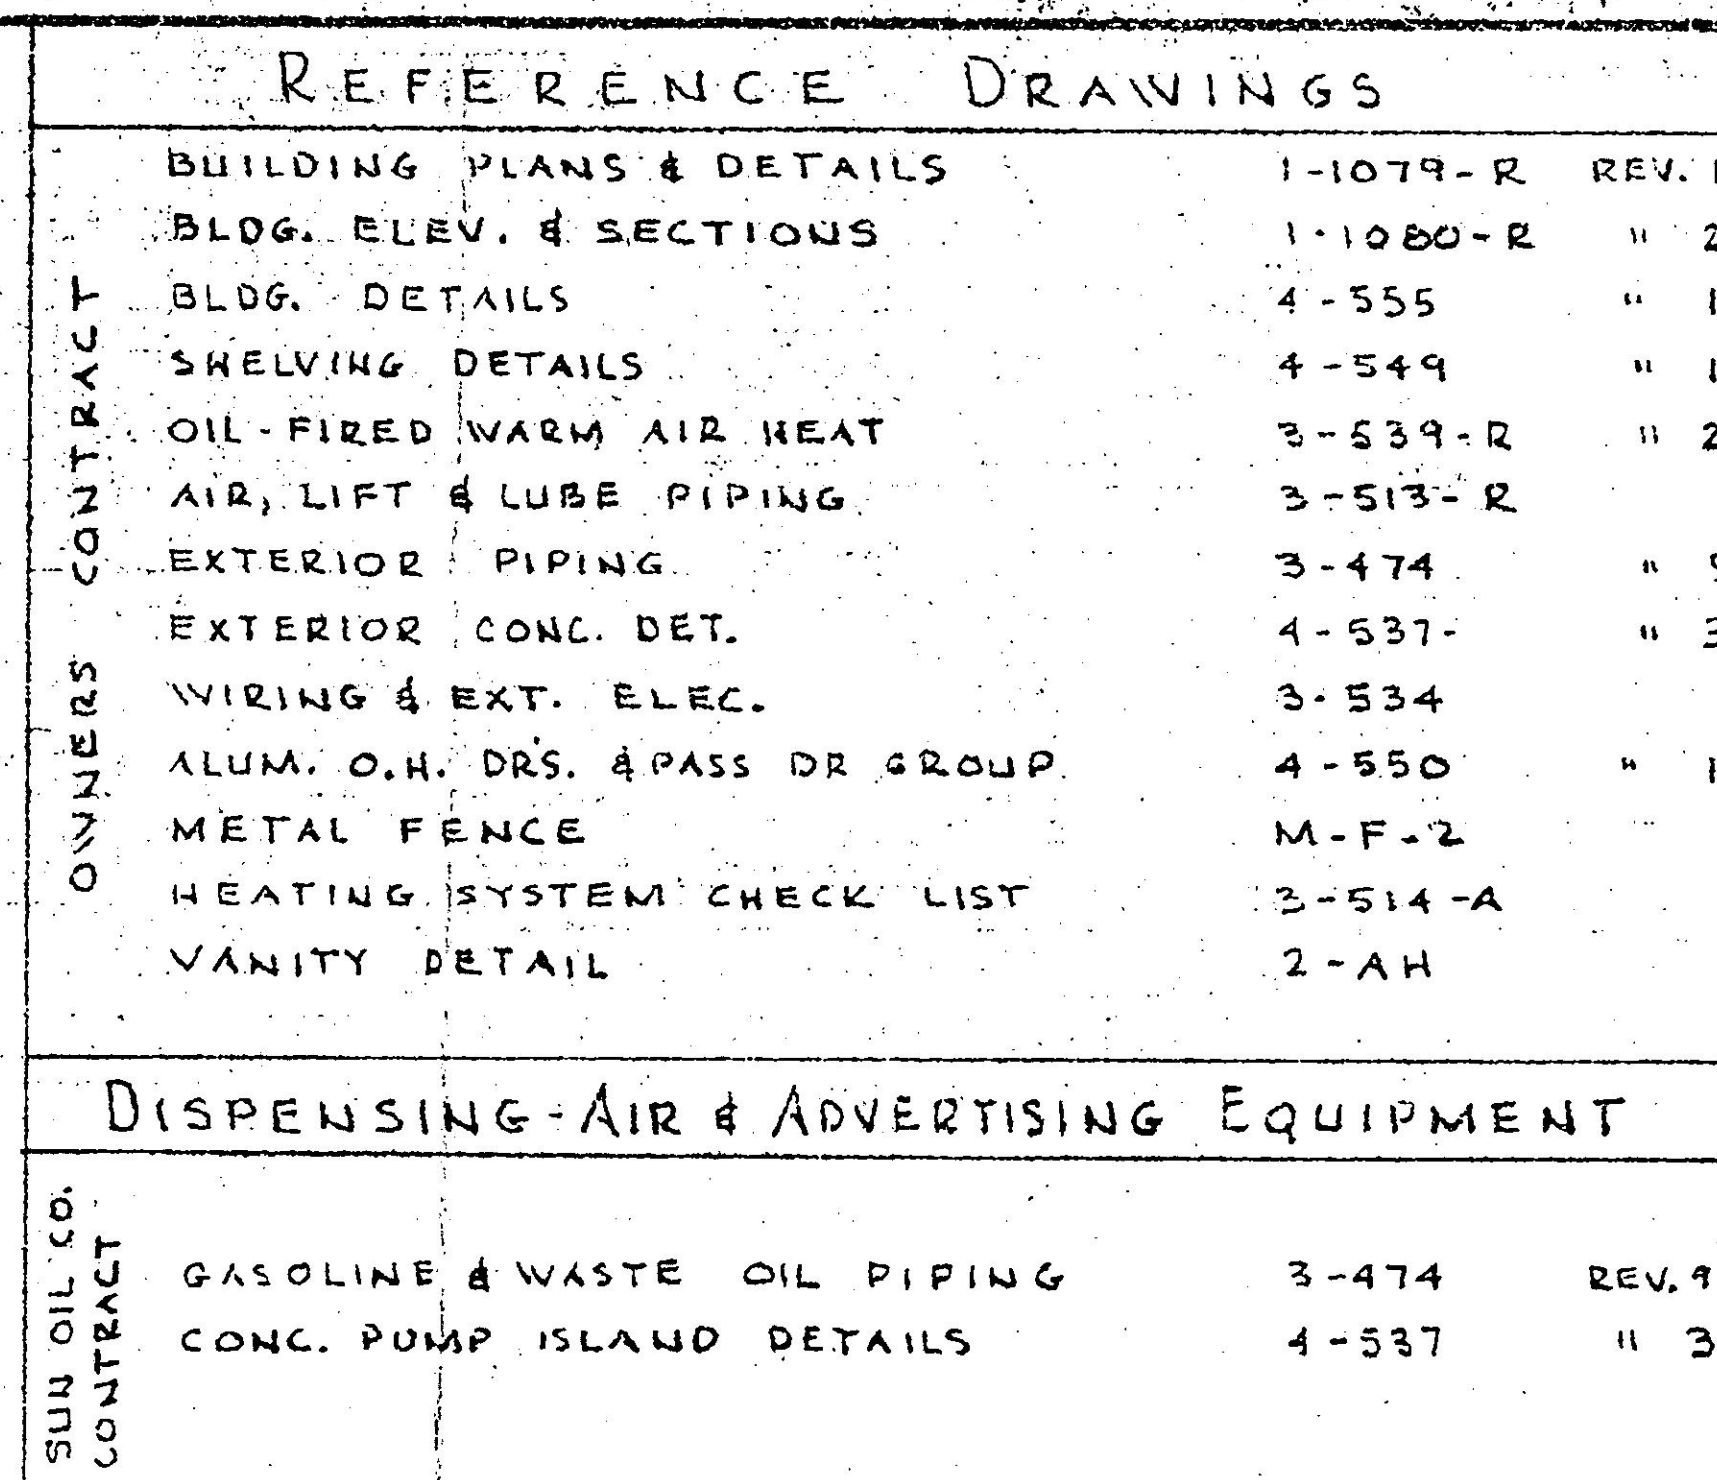




| GENERAL NOTES                            |                              |
|------------------------------------------|------------------------------|
| ALL NEW GRADES                           | SHALL BE SHOWN THUS = 000.00 |
| ALL EXISTING GRADES                      | ARE SHOWN THUS = 000.00      |
| CONTRACTOR SHALL USE METAL ISLAND FORMS. |                              |

# ELECTRICAL NOTES

PANELBOARD SHALL BE A "SQUARE D", FEDERAL OR  
EQUAL SIZE TO SUIT THE NUMBER OF CIRCUITS  
SHOWN IN THE ELECTRICAL SCHEDULE.

WIRING TO BE EXPLOSION PROOF AT PUMPS.

ELECTRICAL WORK SHALL BE IN STRICT  
CONFORMANCE WITH ALL AUTHORITIES  
GOVERNING THIS TYPE OF WORK.

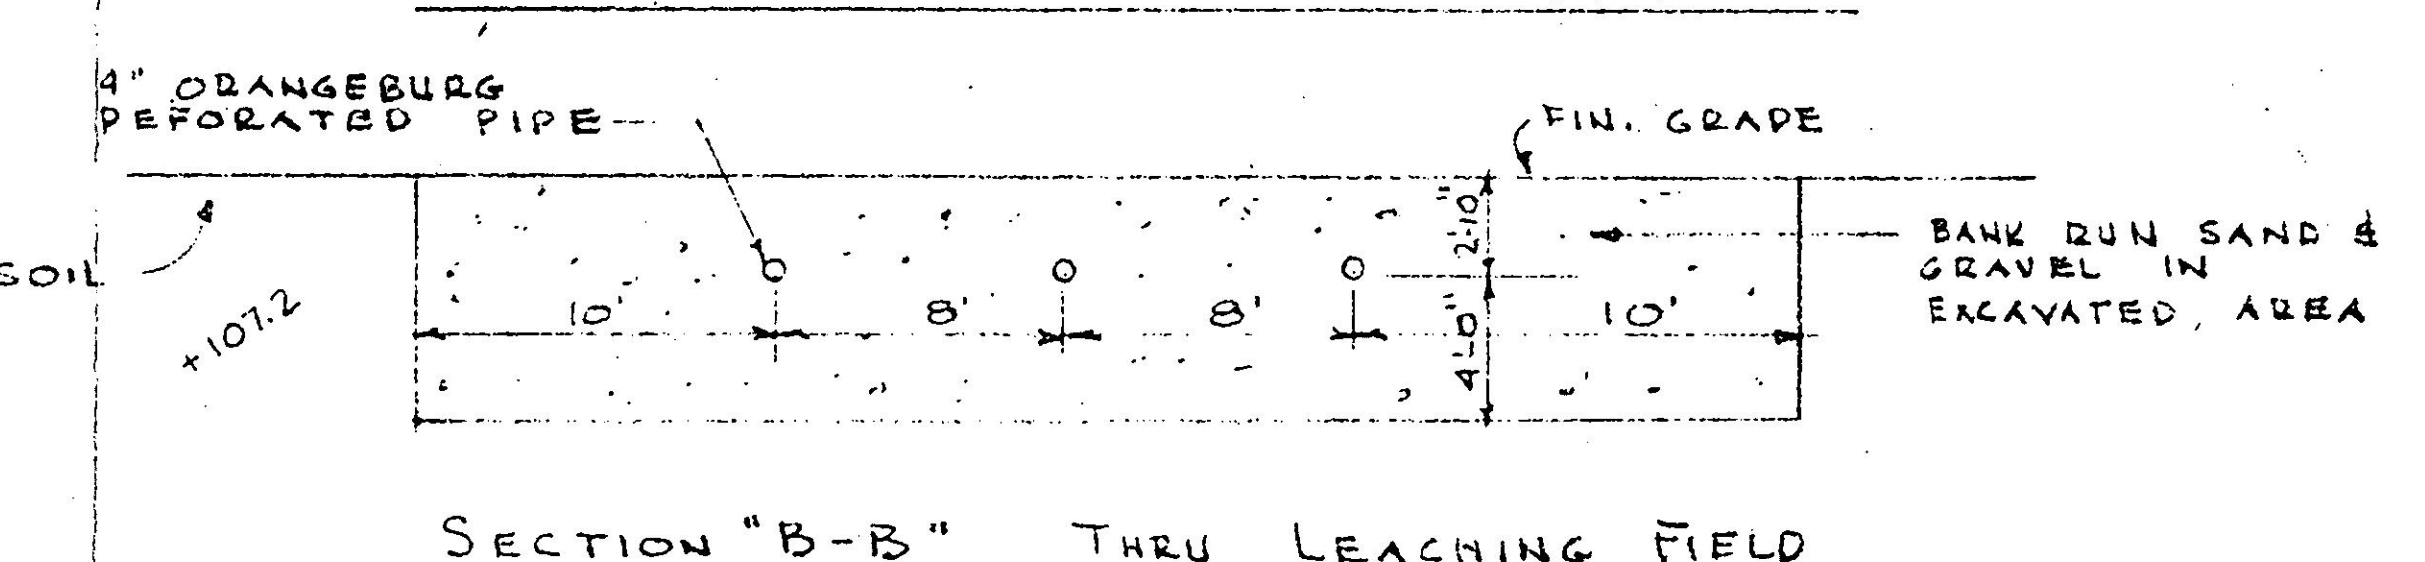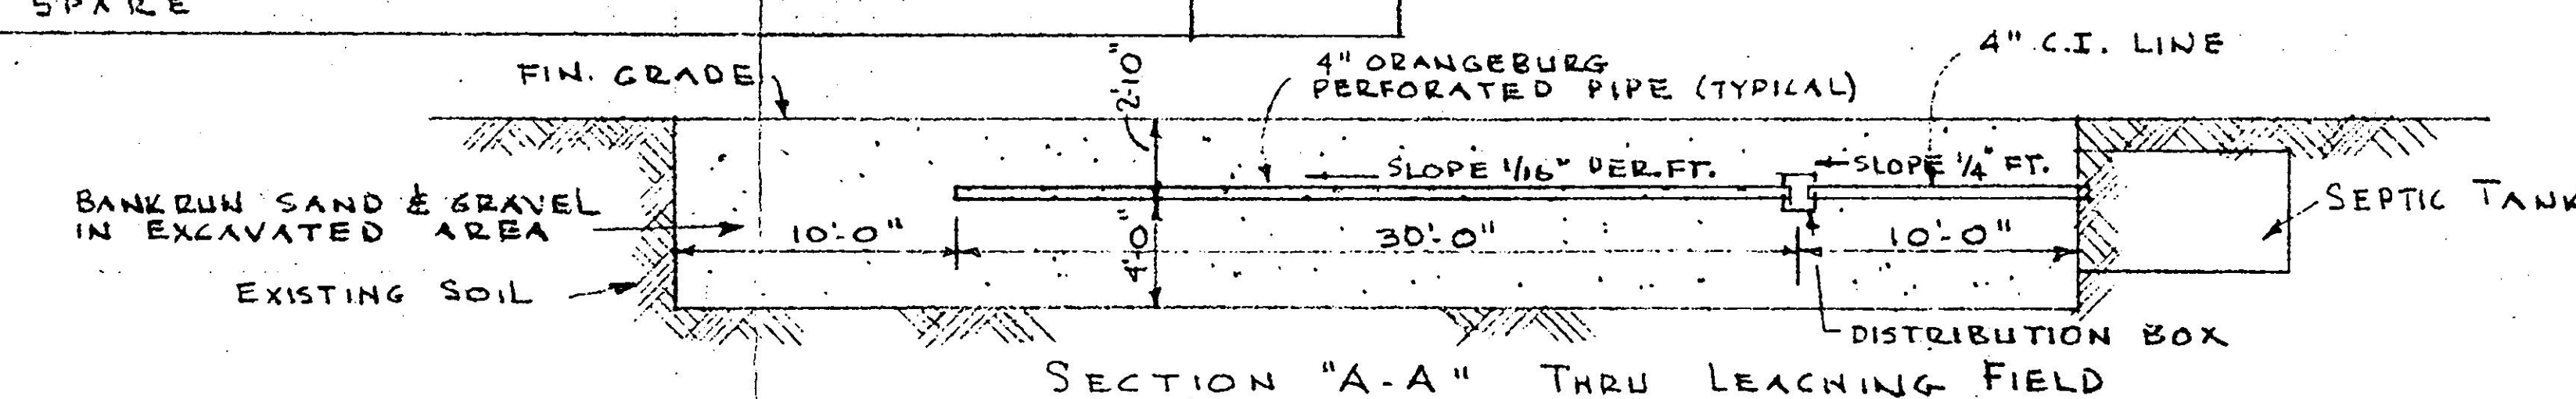

APPROVED

DIRECTOR, DIVISION OF ENVIRONMENTAL  
HEALTH SERVICES

CHARLES A. MCDONALD, C.E.P.E.  
SANITARY ENGINEER

EXAMINED AND APPROVED

These plans for sewage disposal

DATE: FEB. 27, 1963

ALBANY COUNTY DEPT. OF HEALTH

NOTE:  
OWNER SHALL FURNISH APPROX  
80' OF 24" METAL CULVERT PIPE  
FOR INSTALLATION BY STATE.

**SUN OIL COMPANY**  
SALES CONSTRUCTION DEPARTMENT  
STATLER BUILDING BOSTON, MASS.

**PROPOSED SERVICE STATION LAYOUT, WIRING & PIPING**  
215 SOUTHERN BLVD. U.S. RT. 30 BETHLEHEM, N.Y.

DRAWN BY C.M.C. DONALD CHECKED BY DATE 1-11-63  
IN PENCIL SCALE 1/8" = 1'-0"  
N.E.C. 1169-1