
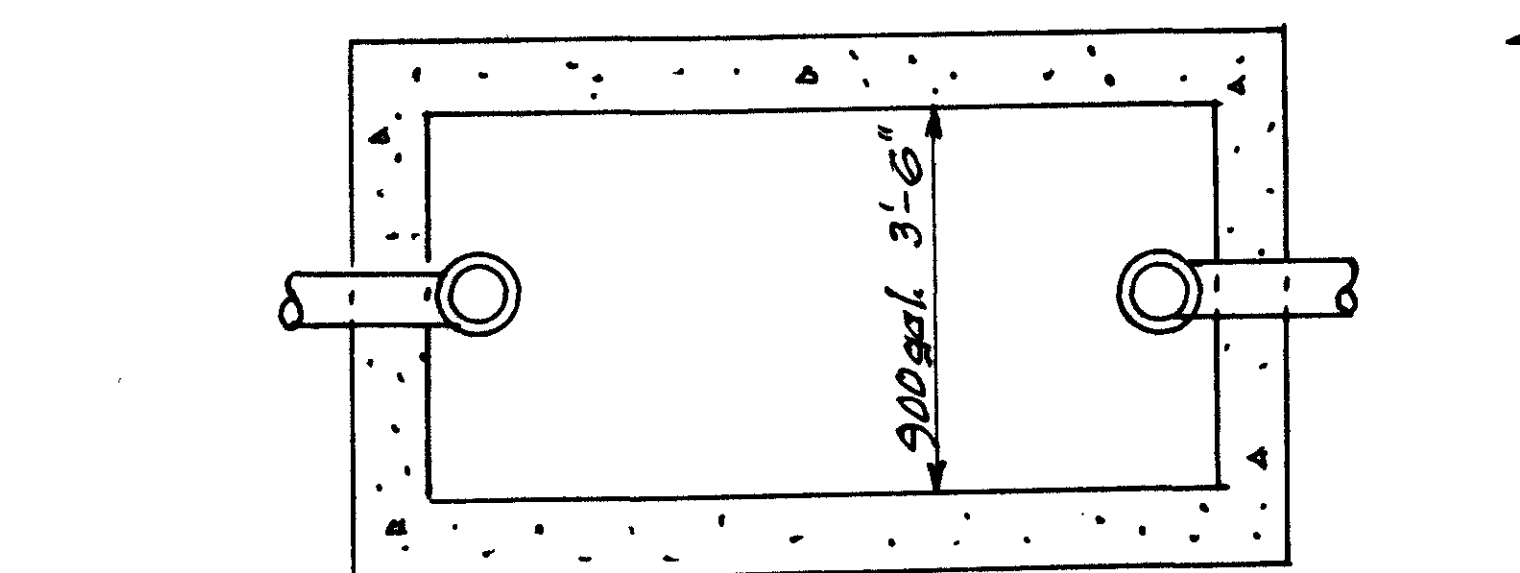
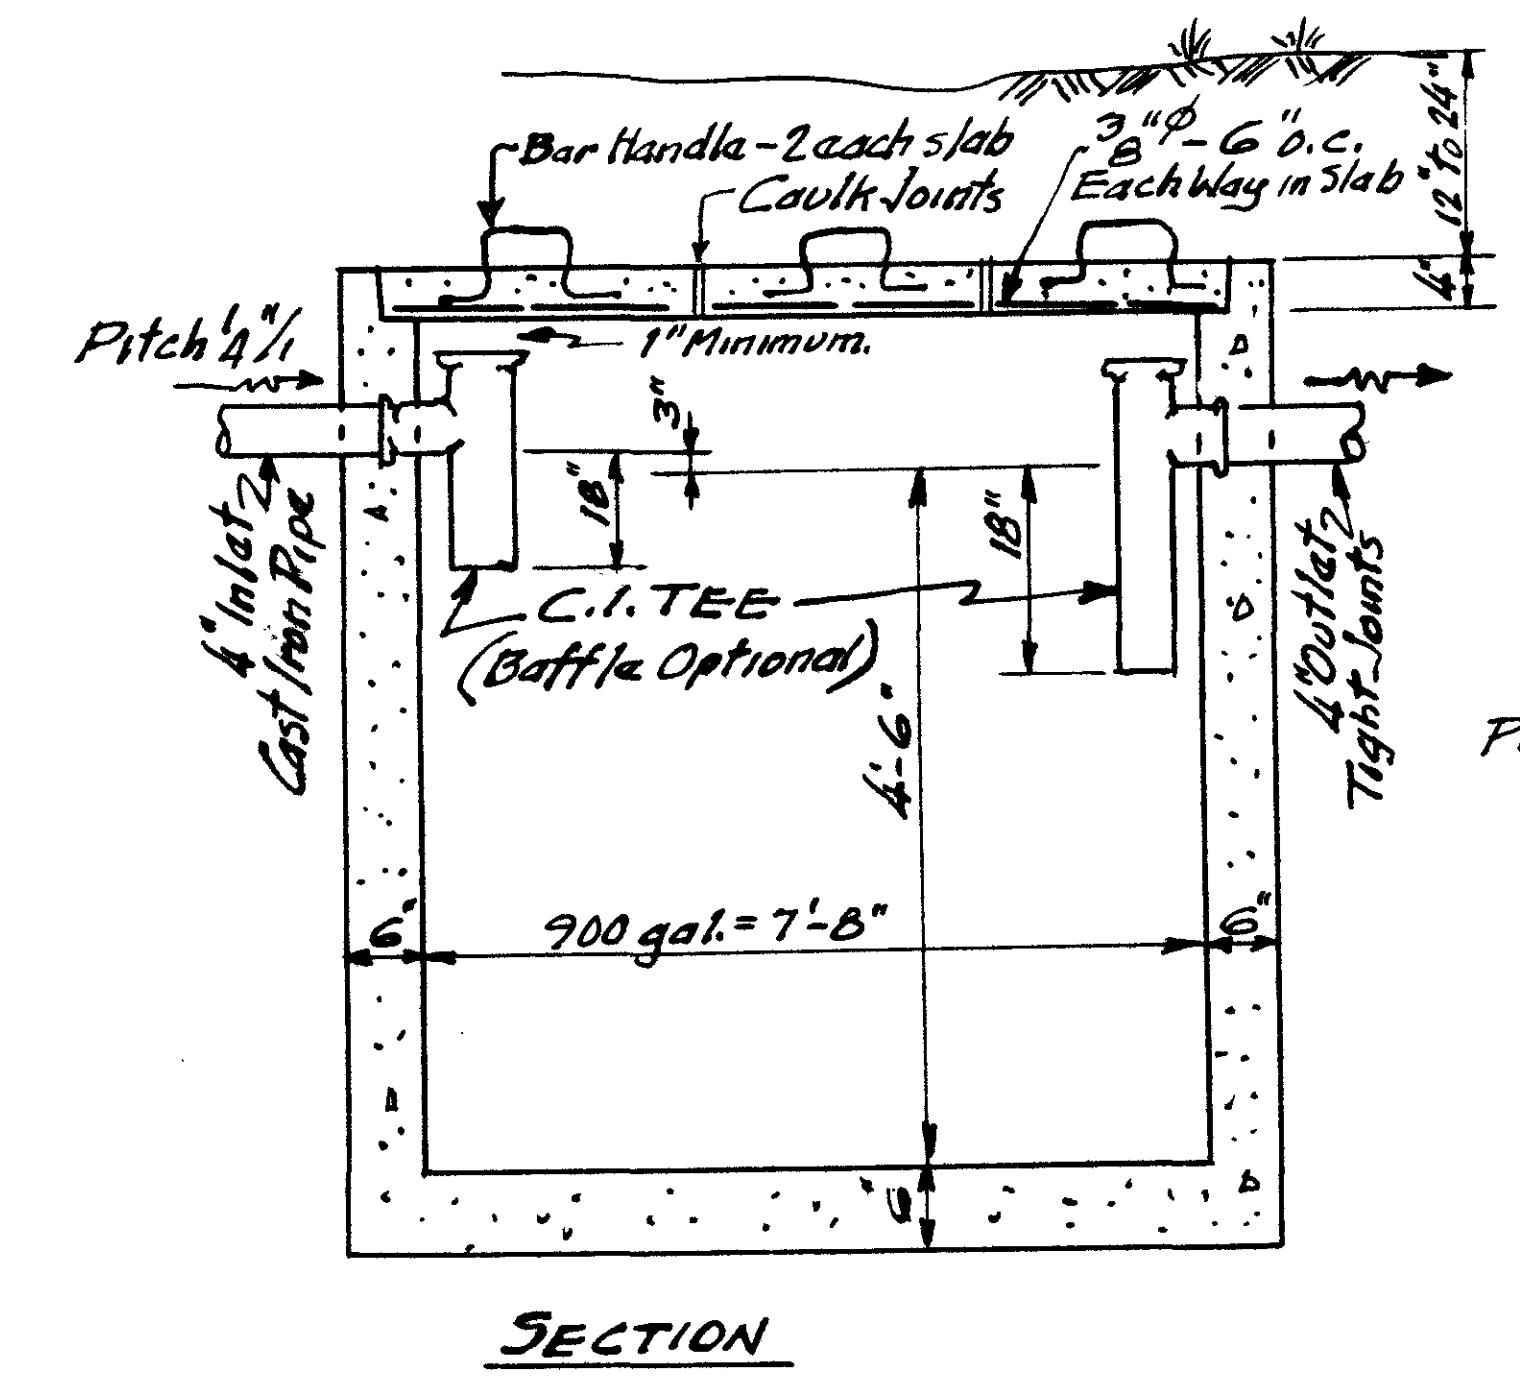
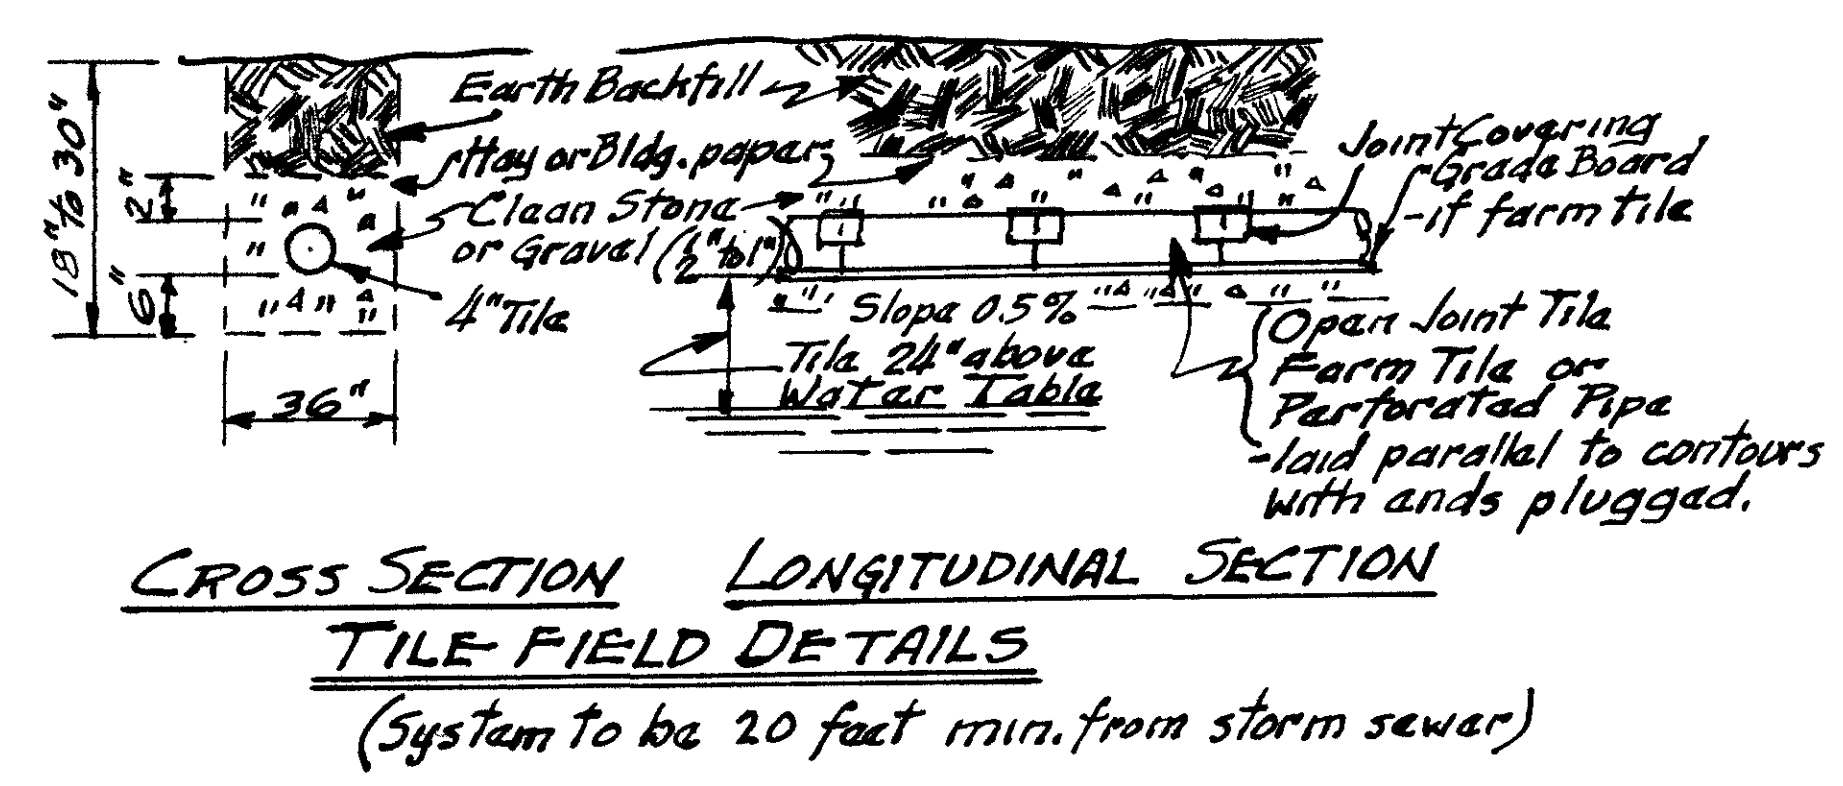


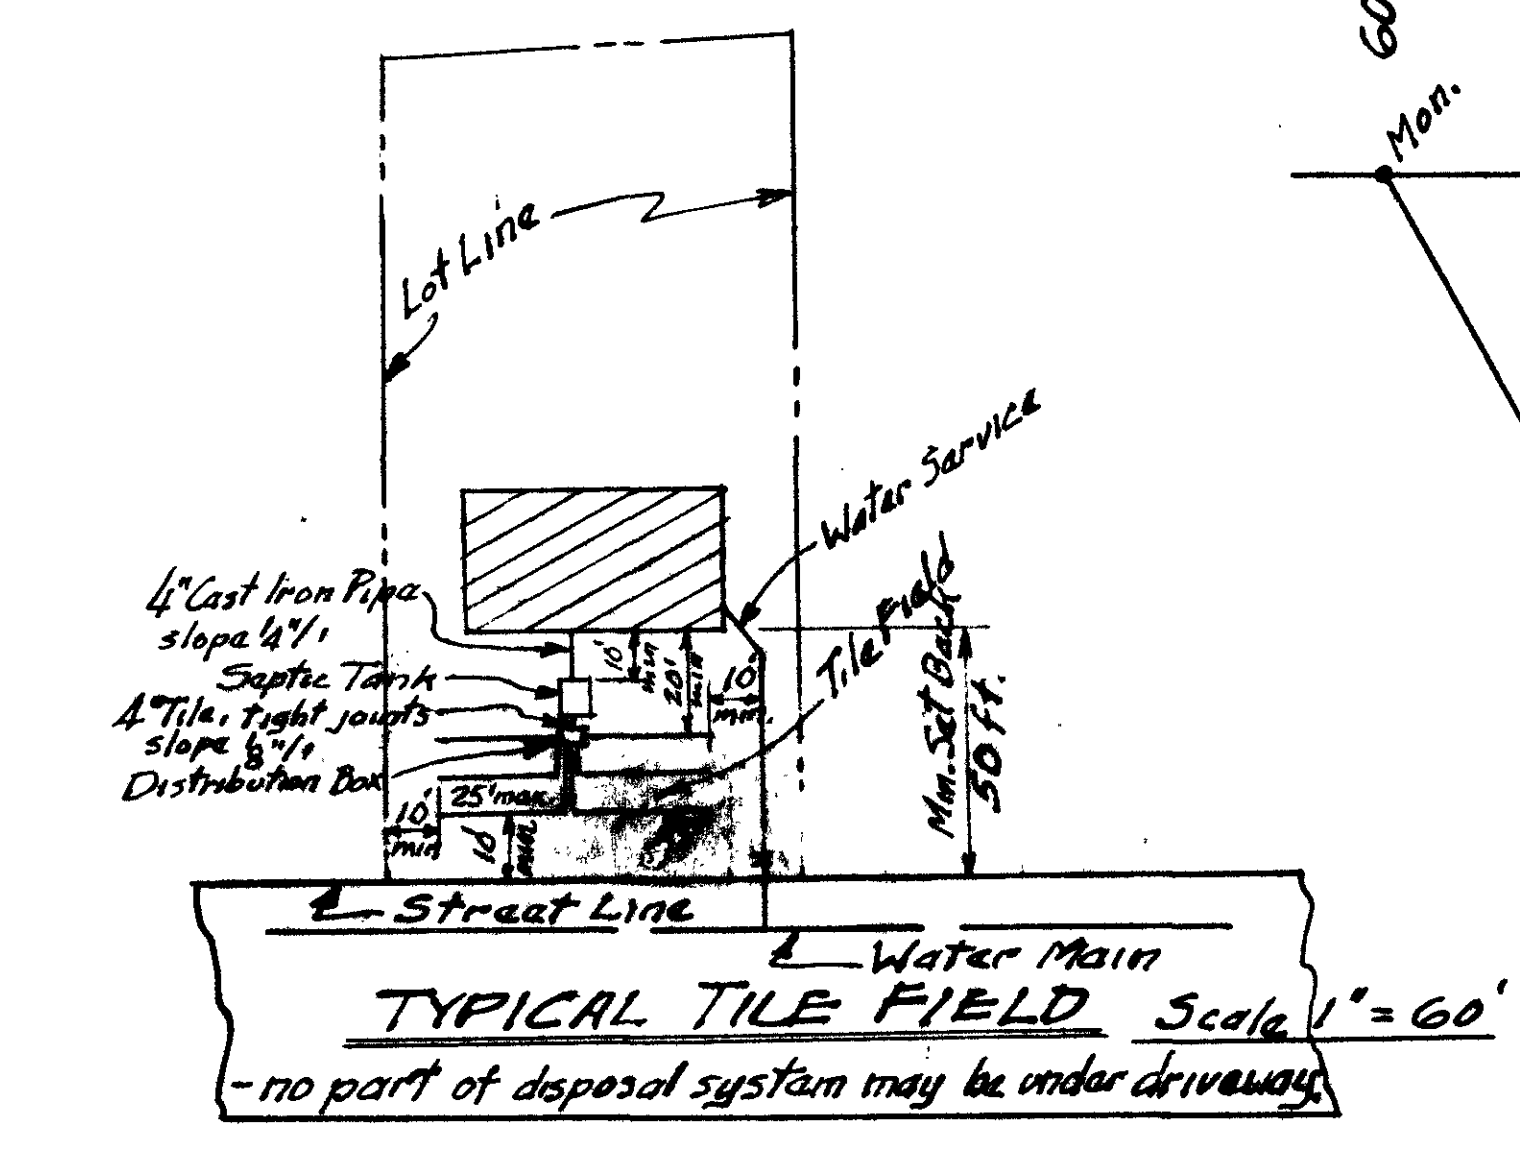

CONCRETE SEPTIC TANK
(Commercial Septic Tank of Approved Type May Be Used.)
Standard Steel Tank 177-51.

SOIL TEST DATA



TEST NO.	TYPE OF SOIL	ELEV. OF WATER TABLE	PERCOLATION TIME	DATE
1A	Sand	El. 209.0	5 min.	June 9, 1965
2A	Sand	El. 206.0	2 min.	
3A	Sand	El. 209.0	6 min.	
1	Sand	El. 208.0	5 min.	Sept. 20, 1957
2	Sand, trace of clay	El. 207.0	8 min.	
3	Sand	El. 209.0	—	
4	Sand	El. 208.0	—	
5	Sand	El. 209.0	—	
6	Sand	El. 209.0	—	
7	Sand	El. 208.0	—	
8	Sand	El. 206.0	—	

SEPTIC TANK SIZE & LENGTH OF TILE

No. of Bedrooms	3	4
Septic Tank Size	900 gal.	1000 gal.
Length of Tile*	120 ft.	150 ft.

*Design for Percolation Time of 15 min. per inch.

- NOTE:**
- Fill to the depth shown must be made.
 - Fill to 3 feet, Lot 15, 18, 24, 33, 35, 36, 37, 40, 41.
 - Fill to 4 feet, Lot 26, 27, 31, 32.
 - Fill to be clean sand or other acceptable porous soil having an equivalent percolation time of one inch in 15 minutes.
 - Soil fill to be left to compact naturally at site of disposal system for at least 6 months before installing tile field. Orangeburg perforated pipe in 8 ft. lengths to be used in fill.
 - Location is in Bethlehem Water District No. 1. Water will be furnished by the Water District.
 - Sewage system to be 20 feet minimum from storm sewer.

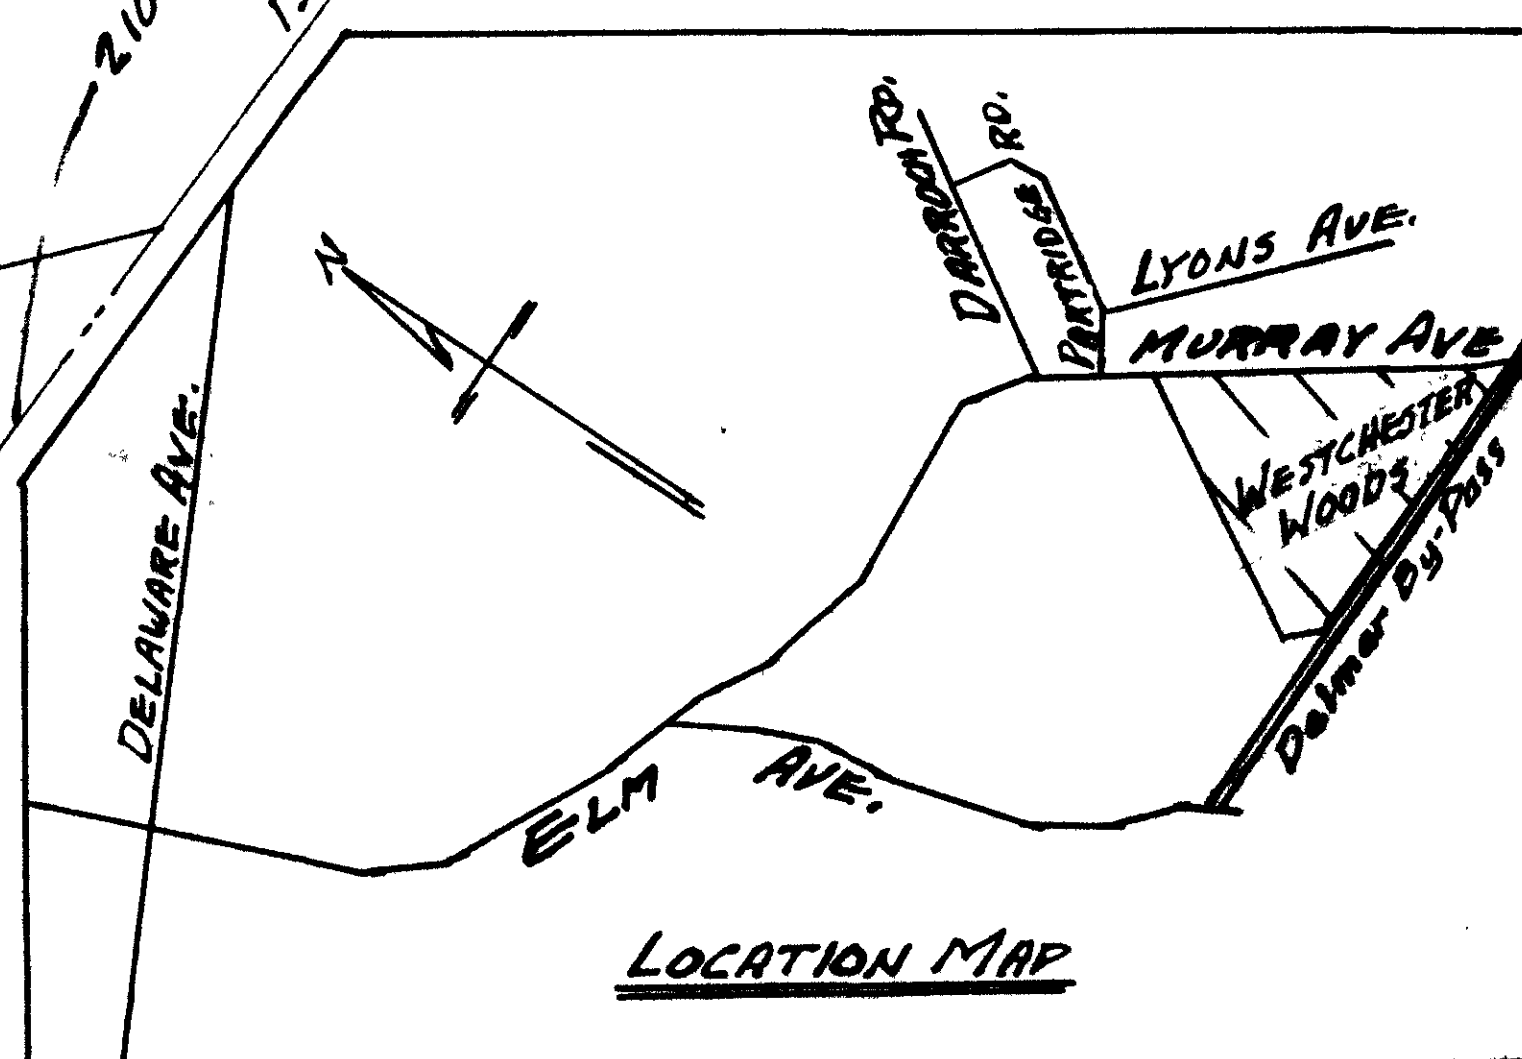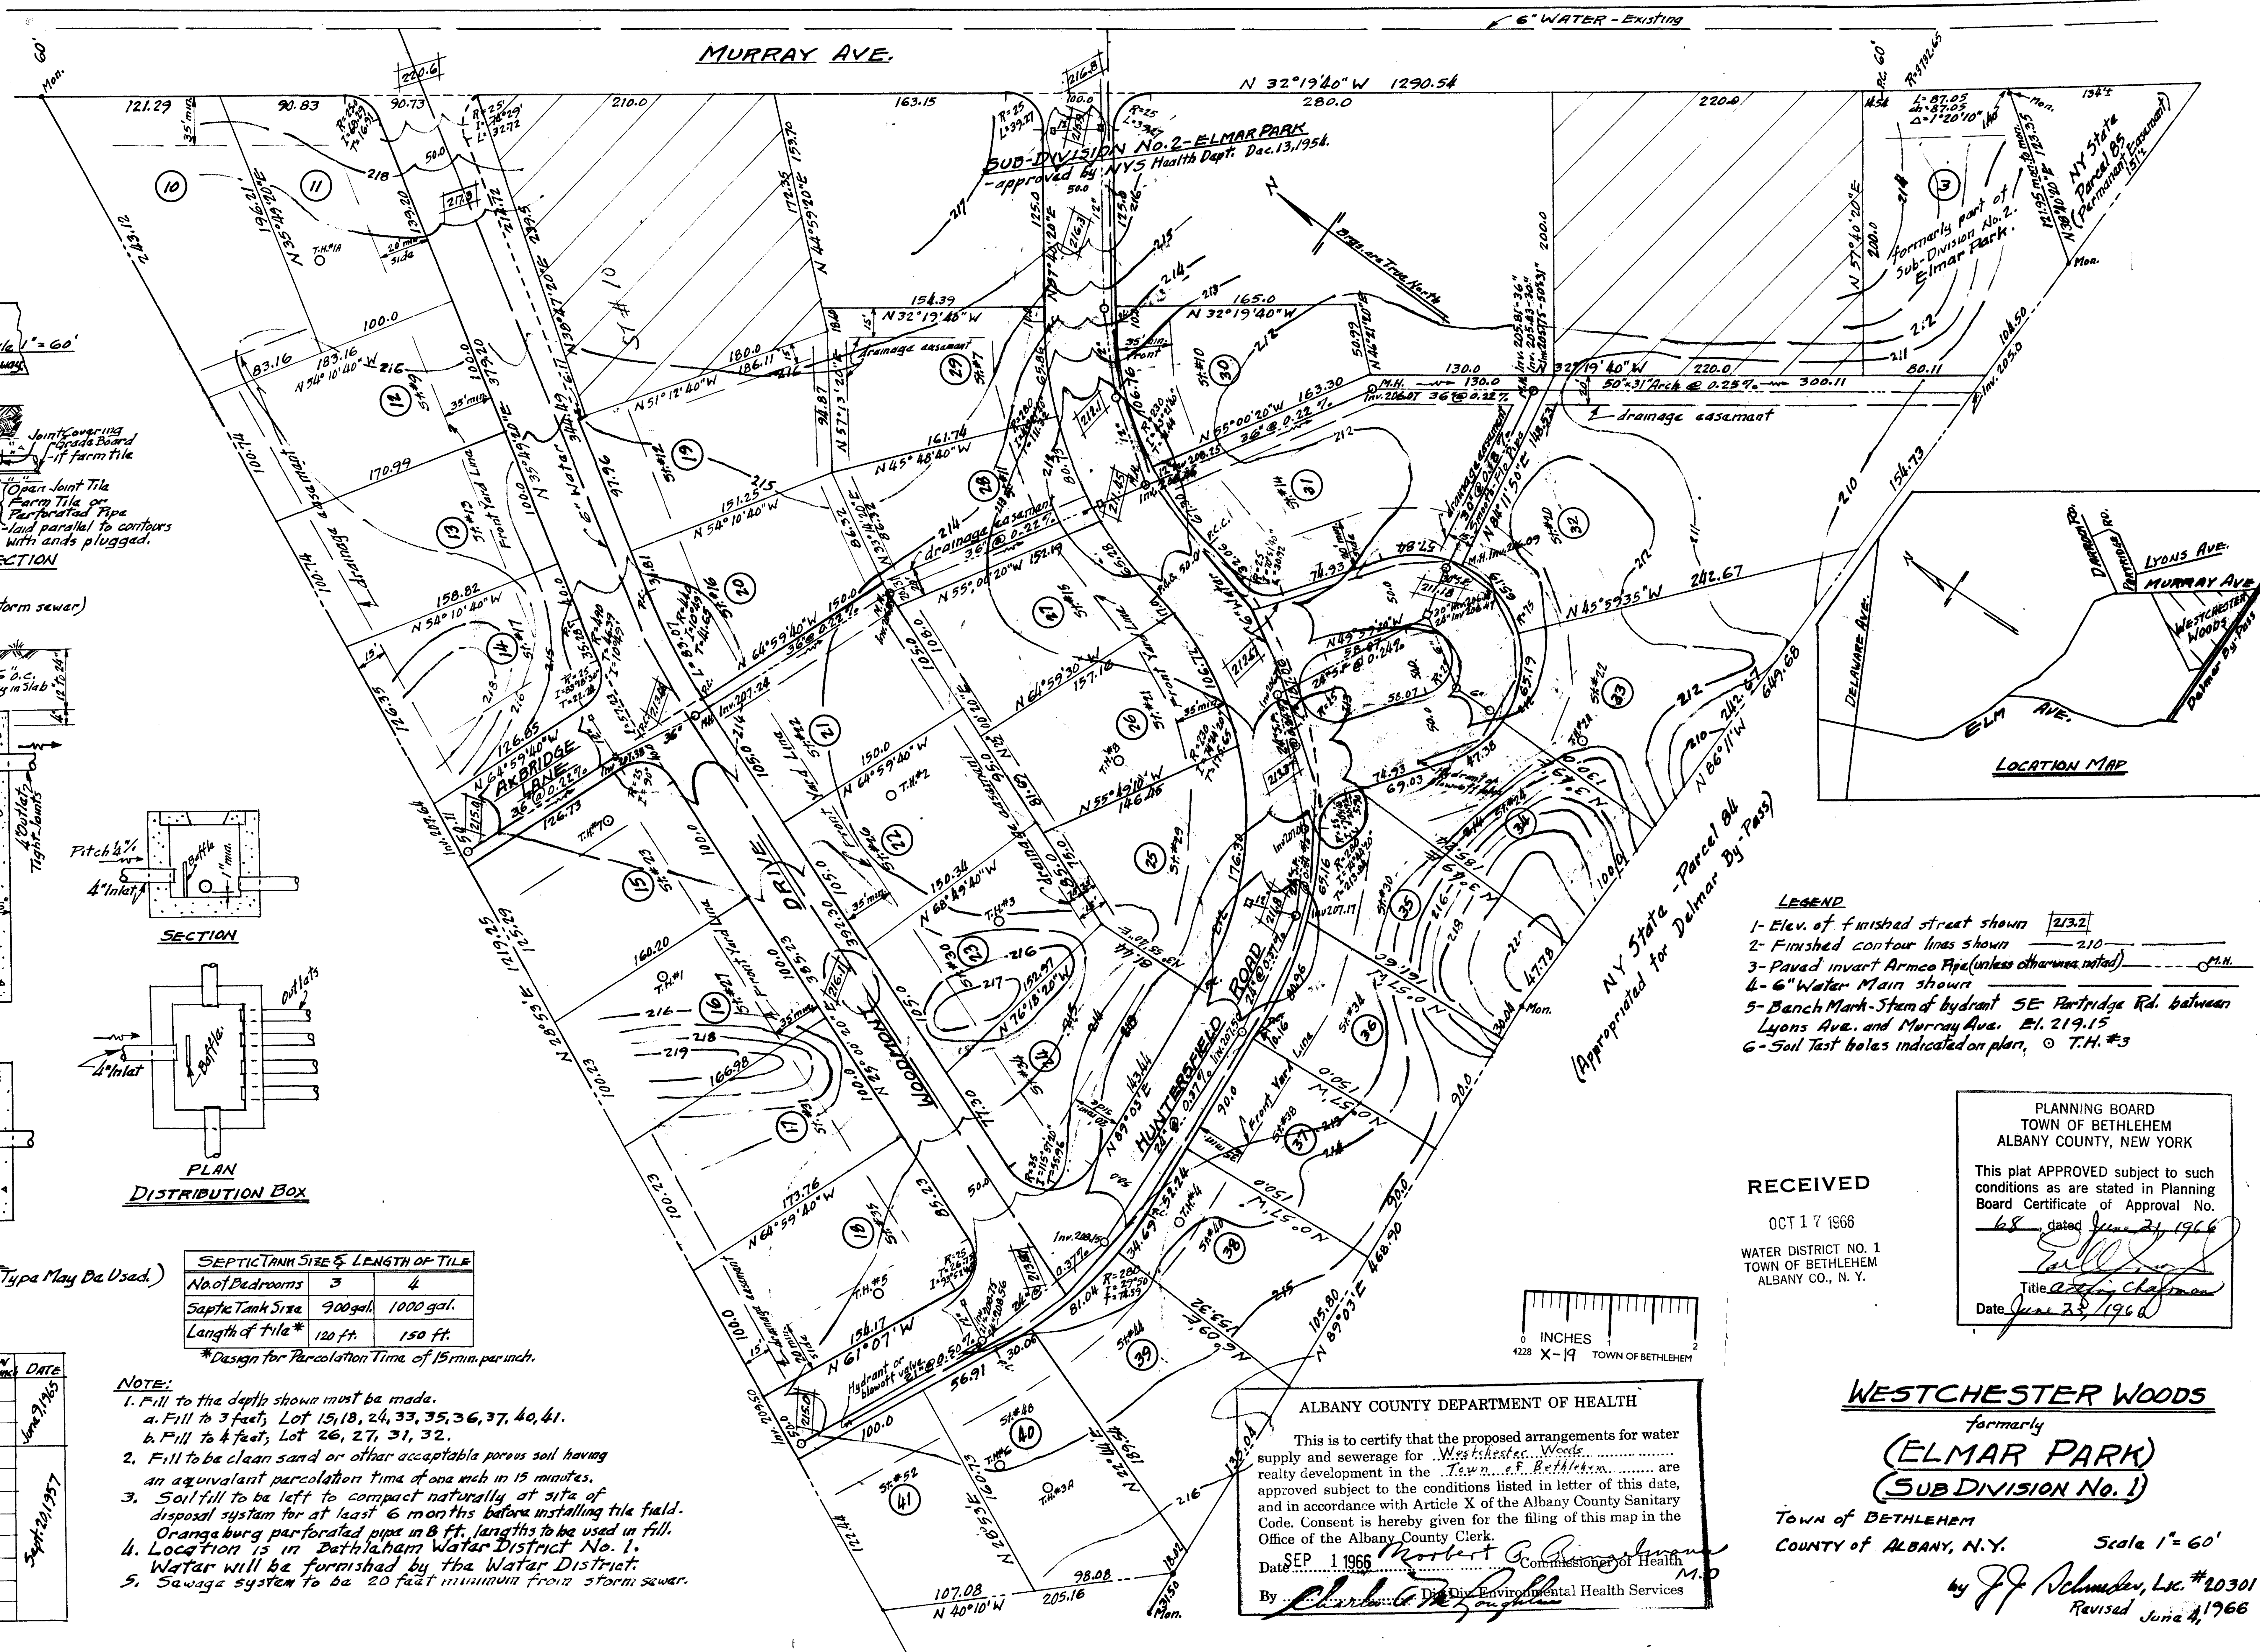

- LEGEND**
- Elev. of finished street shown [213.2]
 - Finished contour lines shown 210
 - Paved invert Armeo Pipe (unless otherwise noted) P.H.
 - 6" Water Main shown
 - Branch Mark - Stem of hydrant SE Partridge Rd. between Lyons Ave. and Murray Ave. El. 219.15
 - Soil Test holes indicated on plan, O.T.H. #3

RECEIVED

OCT 17 1966
WATER DISTRICT NO. 1
TOWN OF BETHLEHEM
ALBANY CO., N. Y.

PLANNING BOARD
TOWN OF BETHLEHEM
ALBANY COUNTY, NEW YORK

This plat APPROVED subject to such conditions as are stated in Planning Board Certificate of Approval No. 68, dated June 24, 1966.

Title: *Elmar Park Subdivision No. 1*
Date: *June 24, 1966*

ALBANY COUNTY DEPARTMENT OF HEALTH

This is to certify that the proposed arrangements for water supply and sewerage for Westchester Woods, a realty development in the Town of Bethlehem, are approved subject to the conditions listed in letter of this date, and in accordance with Article X of the Albany County Sanitary Code. Consent is hereby given for the filing of this map in the Office of the Albany County Clerk.

Date: *SEP 1 1966*
By: *Robert A. [Signature]* Commissioner of Health
M.D.

WESTCHESTER WOODS
formerly
(ELMAR PARK)
(SUB-DIVISION NO. 1)

TOWN OF BETHLEHEM
COUNTY OF ALBANY, N. Y.

Scale 1" = 60'

by *J. J. Schneider, Inc. #20301*
Revised June 4, 1966

