




LEGEND

- CATCH BASIN
- MANHOLE
- ◎ HYDRANT
- ⊕ GATE VALVE
- TEE
- ▲ TRUSS BLOCK
- W— WATER MAIN
- SS— SANITARY SEWER
- - - STORM SEWER

NOTE:
ALL WATER MAINS SHALL
BE 8" DUCTILE IRON.

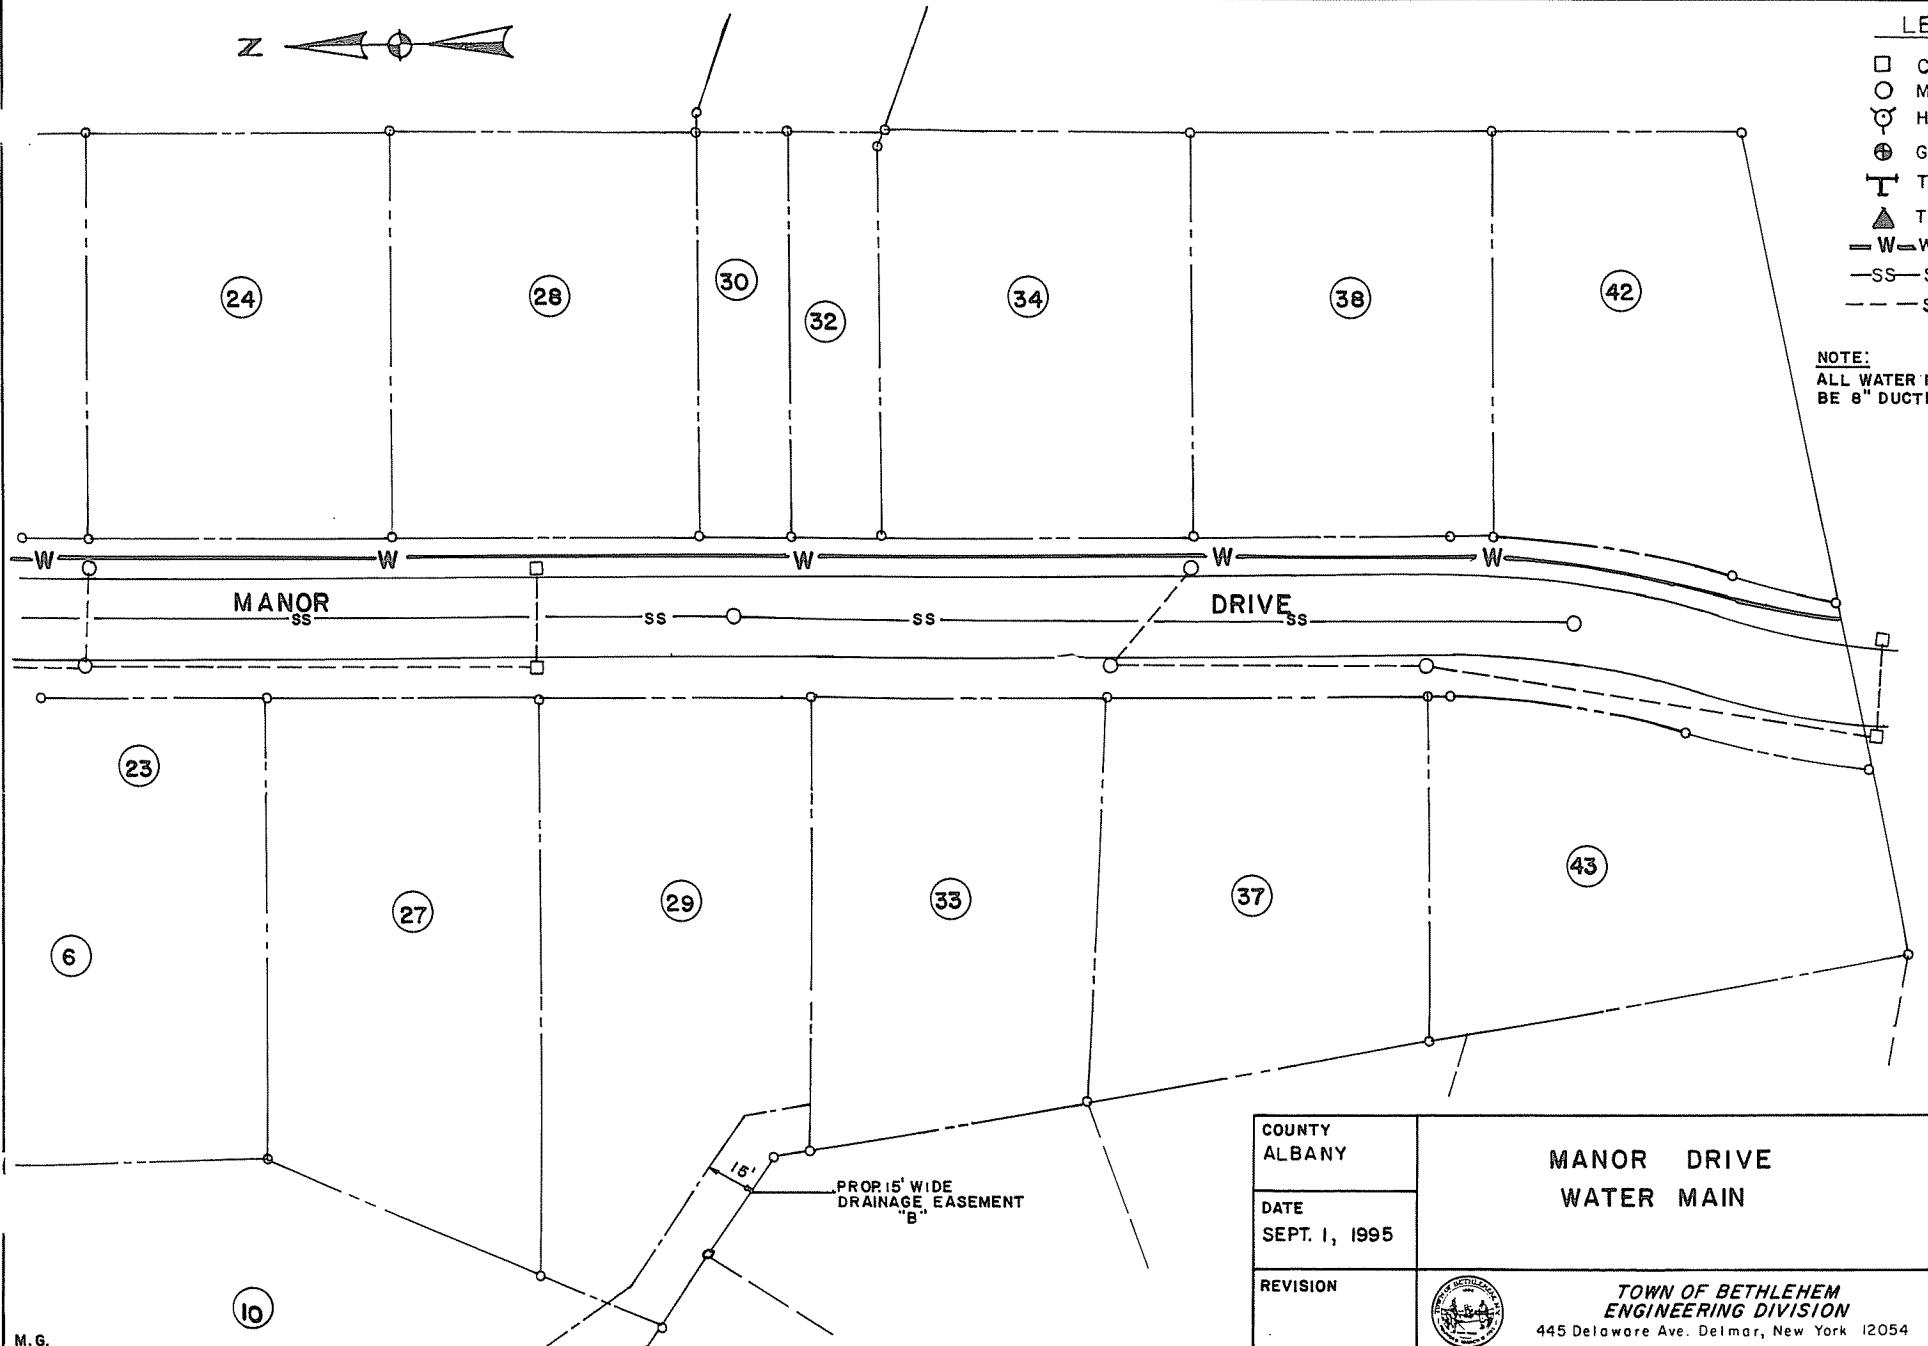

COUNTY
ALBANY

DATE
SEPT. 1, 1995


REVISION

MANOR DRIVE
WATER MAIN

STATE
NEW YORK

SCALE
1" = 40'

TOWN OF BETHLEHEM
ENGINEERING DIVISION
445 Delaware Ave. Delmar, New York 12054



DRAWING NO.